



Sewer System Management Plan

2015 Revision

WDID #: 5SSO10891

Table of Contents

Introduction	1
Element 1: Goals	4
Element 2: Organization	5
Element 3: Legal Authority	9
3.1 Regulatory Requirements for Legal Authority Element	9
3.2 Municipal Code	9
3.3 Prevention of Illicit Discharge	9
3.4 Proper Design and Construction of Sewers and Connenctions	10
3.5 Ensure access for maintenance, inspection, or repair for portions of the lateral owned or maintained by the Public Agency	10
3.6 Limit Discharge of FOG and Other Debris	10
3.7 Enforcement Measures	10
Element 4: Operation and Maintenance Program	11
4.1 Element 4 Appendix	11
4.2 Collection System Map Discussion	11
4.3 Prioritized Preventive Maintenance Discussion	12
4.3.1 Sewer Cleaning	12
4.3.2 Root Control	13
4.3.3 Lift Station Maintenance	13
4.3.4 Odor Control	13
4.3.5 Corrosion Control	13
4.3.6 Investigation of Customer Complaints	14
4.3.7 Maintenance Management and Work Orders	14
4.4 Scheduled Inspections and Contidion Assessment Discussion	14
4.4.1 Manhole Inspection	14
4.4.2 Pipeline Inspection	15
4.4.3 Pump Station Inspection and Assessment	15
4.5 Contingency Equipment and Replacemanet Inventories	15
4.6 Training Discussion	16

Element 5: Design & Construction Standards	17
5.1 Regulatory Requirements for Disign & Construction Standards	17
5.2 Standard Plans and Specifications	17
5.3 Design & Construction Standards Discussion	18
Element 6: Overflow Emergency Response Plan	19
6.1 Regulatory Requirements for Overflow Emergency Response Plan Element	19
6.2 Element 6 Appendix	19
6.3 Overflow Emergecy Response Plan	20
6.4 Claim against the City	106
Element 7: Fats, Oils, and Grease (FOG) Control Program	107
7.1 Regulatory Requirements for FOG Control Element	107
7.2 Element 7 Appendix	107
7.3 Summary of FOG Elements Identified by the State	108
7.4 Fog Control Discussion	109
7.5 Identification and Sewer Cleaning	109
7.6 Legal Authority	109
7.7 Facility Inspection	110
7.8 Public Outreach	110
7.9 FOG Enforcement Actions	110
Element 8: Capacity Management	111
8.1 Regulatory Requirements for Capacity Management	111
8.2 Capacity Evaluation Discussion	111
8.2.1 Hydraulic Model	112
8.2.2 Flow Estimates	112
8.2.3 Capacity Evaluation Criteria	113
8.2.4 Capacity Evaluation Results	113
8.3 Recommended Capacity Projects	113
8.3.1 Design Criteria	113
8.3.2 Recommended Capacity Improvements	114
8.4 CIP Schedule	114
8.5 Financial and Economic Analysis	114

Element 9: Monitoring, Measurement, & Program Modification	115
9.1 Regulatory Requirements for Monitoring, Measurement, & Program Modifications ...	115
9.2 Monitoring and Measurement Discussion	115
9.3 SSMP Modifications	115
Element 10: SSMP Audit	116
10.1 Regulatory Requirements for SSMP Audit	116
10.2 Element 10 Appendix	116
10.3 SSMP Audit Discussion	116
Element 11: Communication Program	117
11.1 Regulatory Requirements for Communication Program	117
11.2 Communication Program Discussion	117
Appendix A	A-1
Appendix B	B-1
Appendix C	C-1
Appendix D	D-1
Appendix E	E-1
Appendix F	F-1
Appendix G	G-1
Appendix H	H-1

List of Figures

Figure I-1 Estimated Size Distribution of Assets	2
Figure I-2 Estimated Age of Sewer System Piping	2
Figure I-3 City of Brentwood Service Boundaries	3
Figure 2-1 Sewer System Organization Chart	5
Figure 2-2 Sewer System Responding Communication Flowchart	7
Figure 4-1 Example Collection System Map	12

INTRODUCTION

This introductory section provides background information on the purpose and organization of this Sewer System Management Plan and provides a brief overview of the City of Brentwood's service area and sewer system.

SSMP Requirement Background

In May 2006, the State Water Resources Control Board ("SWRCB") implemented Order No. 2006-0003-DWQ requiring any municipality which owns or operates a sanitary sewer system greater than 1.0 mile in length and collects and/or conveys untreated or partially treated wastewater to publicly owned treatment plants in the State of California are required to comply with the terms of this order. This SSMP will facilitate the overall management of the City of Brentwood's Sewer System.

Document Organization

This SSMP is intended to meet the requirements of the Statewide General Waste Discharge Requirements ("GWDR"). The organization of this document is consistent with the SWRCB requirements. This SSMP includes eleven elements, as listed below:

- 1. Goals**
- 2. Organization**
- 3. Legal Authority**
- 4. Measures and Activities (Operation and Maintenance Program)**
- 5. Design and Construction Standards (Design and Performance Provisions)**
- 6. Overflow Emergency Response Plan**
- 7. Fats, Oils and Grease Control Program**
- 8. Capacity Management (System Evaluation and Capacity Assurance Plan)**
- 9. Monitoring, Measurement, and Program Modification**
- 10. SSMP Audits**
- 11. Communication Plan**

Each element section is organized into sub-sections, as follows:

1. Description of the SWRCB requirement for that element.
2. Identification of associated appendix and list of supporting information included in the appendix.
3. Discussion of element. The discussion may be split into multiple sub-sections depending on length and complexity.

Supporting information for each element is included in an appendix associated with that section, as applicable. In general, information expected to require relatively frequent updates (such as names and phone numbers of staff) are included in appendices, as well as other supporting information, such as forms or schedules.

City Service Area and Sewer System

The City of Brentwood is located in Eastern Contra Costa County and is surrounded by the Cities of Antioch, Oakley, Knightsen, Discovery Bay, and Byron. As of 2015, the City population is

approximately 57,000 based on City of Brentwood Community Development Department estimates. The projected population growth of the City is to reach 75,000 by the year 2020.

The City of Brentwood’s Wastewater Treatment Plant receives wastewater from approximately 17,204 residential connections and 476 commercial business connections. The City’s sewer system consists of approximately 225 miles of pipe, ranging from 4 inches to 42 inches in diameter, and two lift stations (Sellers and Dreamcatcher). The City provides sewer service to businesses and residents within the City. The City maintains the sewer system with the use of two combination trucks (suction and high pressure jet cleaning hoses) and a CCTV (Closed Circuit Television) van to inspect the City’s infrastructure and laterals. The City also provides maintenance and emergency response services for the entire sewer system.

The tables below (Figures I-1 & I-2) outline the distribution of sewer system assets by size and age.

Estimated Size Distribution of Assets

Diameter of sewer pipe	Gravity Mainlines (%)	Force Mains (%)
6 inches or less	34	0
8 inches	40	0
9 – 18 inches	20	0
19 – 36 inches	5	0
>36 inches	1	0

Figure I-1

Estimated Age of Sewer System Piping

Year of construction	Gravity Mainlines & Forces Mains (%)	Pump Stations ≥75k (gpd)	Pump Stations <75k (gpd)
2000 – Present	75	0	1
1980 – 1999	20	1	0
1960 – 1979	4	0	0
1940 – 1959	1	0	0

Figure I-2

The following map (Figure I-3) shows the City’s legal boundaries (service area), and notes the location of the two sewer lift stations and the Wastewater Treatment Plant.

City of Brentwood Service Boundaries



Figure I-3

Element 1: GOALS

This section identifies the goals the City of Brentwood has developed for the management, operation, and maintenance of all parts of the sewer system. It also evaluates the role of the SSMP in supporting these goals.

Suggested SSMP from the CWEA: *The standards for the operation and maintenance of a wastewater collection system are to properly operate and maintain all portions of the collection system, to report overflows, and to respond effectively to any overflows which may occur. The collection system agency's goals should be at a high level which meets the requirements.*

Goals:

The main goal of the City's SSMP is to minimize the number and impact of sanitary sewer overflows ("SSO") which occur. This plan aims to provide a standard set of protocols to provide consistent, efficient management and operation of the City's collection system. The following list constitutes the SSMP goals:

- 1. Minimize the number and impact of SSOs.**
- 2. Maintain existing infrastructure and plan for future CIP projects.**
- 3. Continue to provide capacity evaluation for the collection system and plan for future growth.**
- 4. Develop a plan to increase the number of staff as needed to meet the obligations of the SSMP.**
- 5. Operate in a safe and efficient manner.**

This SSMP provides quality, consolidated guidelines and procedures for all portions of the City's sewer system management. The SSMP will contribute to the proper management of the collection system and assist the City in minimizing the frequency and impact of SSOs by providing guidance for appropriate maintenance, capacity management, and emergency response.

Element 2: ORGANIZATION

This section of the SSMP identifies the City’s organizational structure, chain of command, and communication flow for responding to SSOs and other related sewer calls. Also, this section identifies who will be responsible for managing and reporting any information related to the Sewer System Management Plan. The organization chart below shows the chain of command used for SSOs.

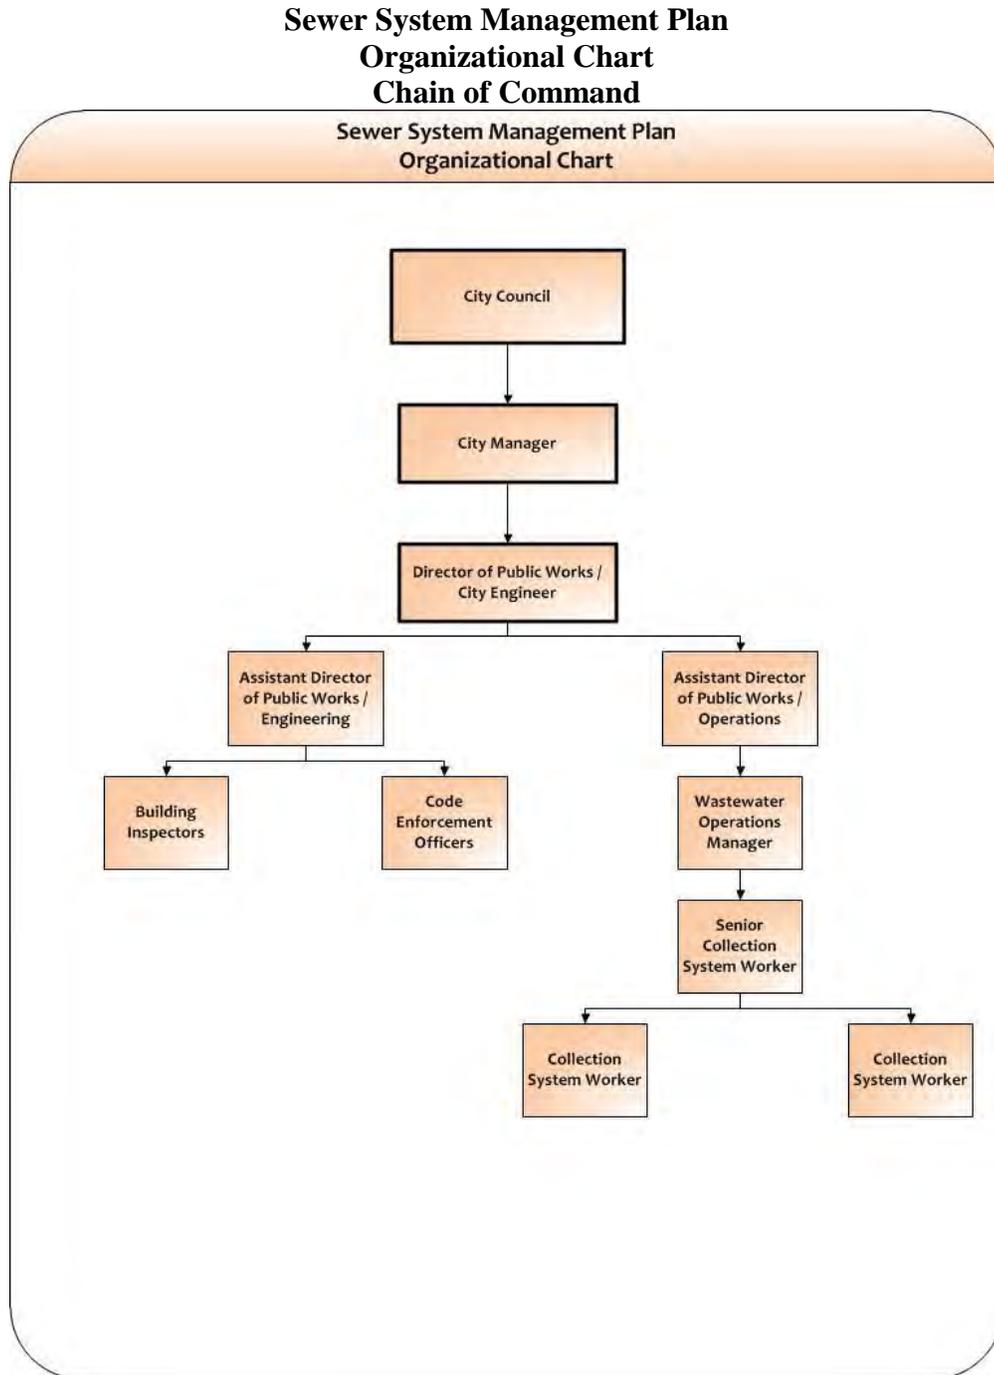


Figure 2-1

The roles established by the SSMP for the Wastewater Collection System staff for the City of Brentwood are as follows:

City Council – Establish policy.

City Manager, Public Works Director, Assistant Public Works Directors, and Wastewater Manager – Enforce policy, plan strategy, lead staff, allocate resources, delegate responsibility, authorize outside contractors to perform services, lead emergency response and may serve as public information officer.

City Engineers – Prepare wastewater collection system planning documents, manage capital improvement projects, and document new and rehabilitated assets.

Inspectors – Ensure new and rehabilitated assets meet agency standards, and work with collection crew in handling emergencies when contractors are involved.

Code Enforcement – Enforce laws and regulations when called on by city staff or when discovering an existing or current violation.

Senior Collection System Worker – Manage field operations and maintenance activities, provide relevant information to management, prepare and implement contingency plans, investigate and report SSOs, and train field crews.

Collection Crew – Conduct preventative and corrective maintenance activities, respond to notification of stoppages and SSOs, and transport equipment to location to correct problem.

The organization chart on the next page shows the responding communication flow chart in the event of notification of a potential SSO.

Communication Flow Chart

Chain of Communication for reporting an SSO:

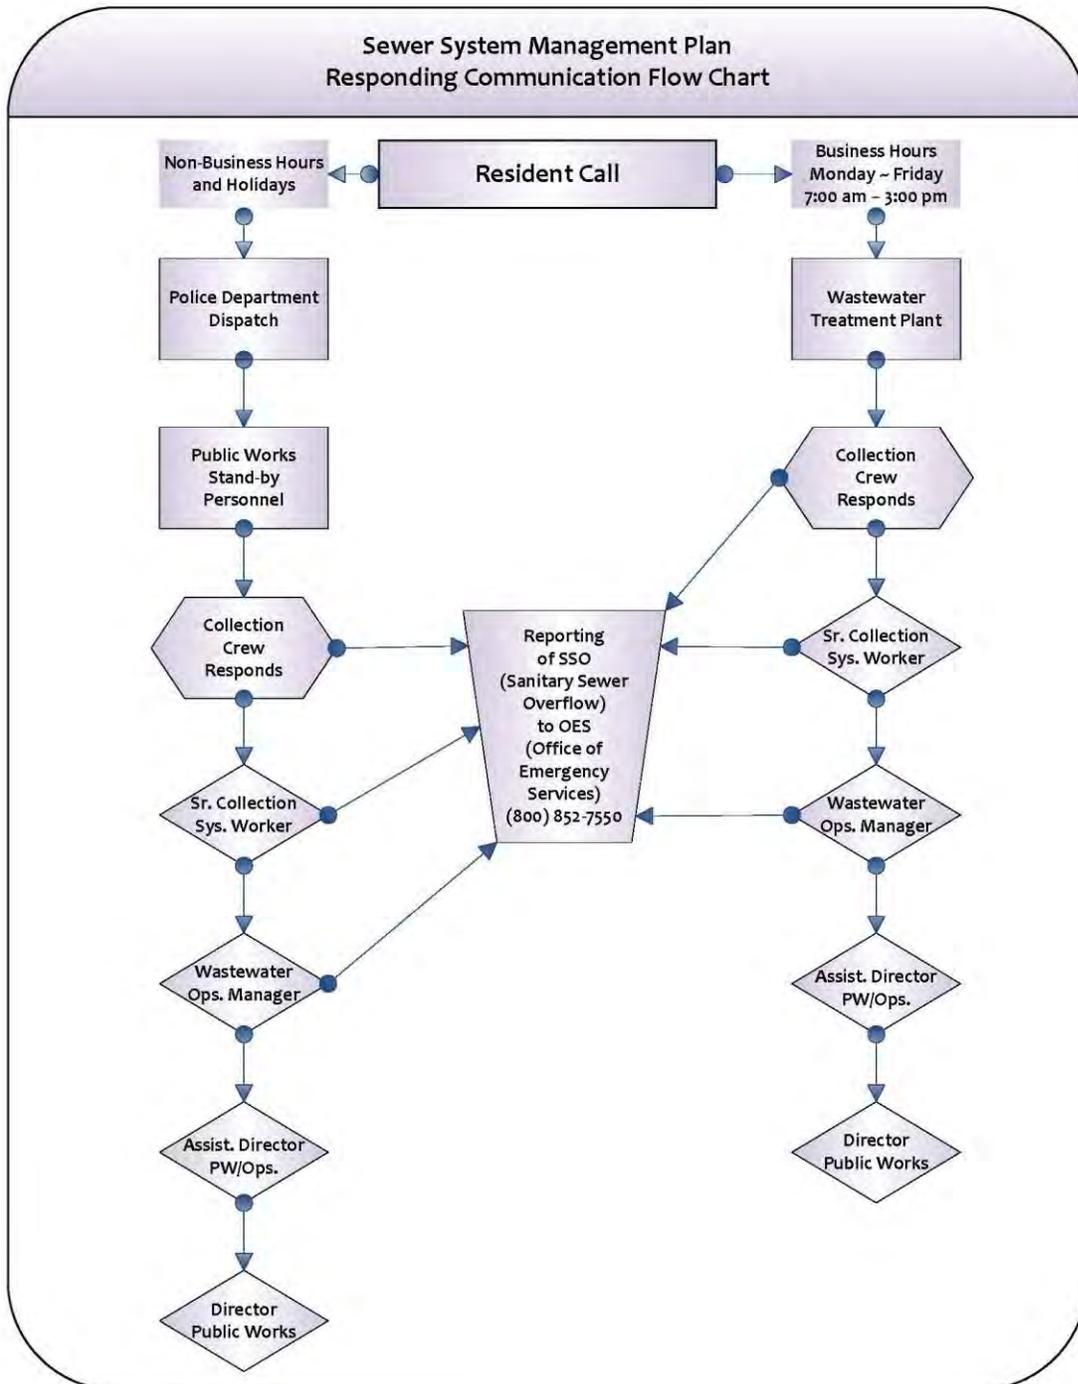


Figure 2-2

As it relates to an SSO, upon receiving a call regarding an overflow, Collection staff is first dispatched to investigate. They would notify the Senior Collection System Worker as to the severity of the overflow. The Senior Collection System Worker would then report to the Wastewater Operations Manager. These are three key elements in the process of reporting an SSO in addition to understanding the category the SSO falls under. When the spill is mitigated and the original problem is determined, a plan will be developed to fix the problem and minimize possible future SSOs at that location. The Wastewater Operations Manager, Senior Collection System Worker, and Collection crew will work as a team to gather data which will be used to document and report the SSO. The City of Brentwood is dedicated to meeting requirements and to maintaining a productive sewer system.

Following are the names of authorized City personnel, their titles, and phone numbers for notification purposes associated with this SSMP.

City Manager – (925) 516-5440
Gustavo “Gus” Vina

Director of Public Works/City Engineer – (925) 516-5420
Vacant

Assistant Director of Public Works/Operations – (925) 516-6000
Chris Ehlers – *(Legally Responsible Official)*

Wastewater Operations Manager – (925) 516-6060
Casey Wichert – *(Legally Responsible Official)*

Wastewater Treatment Plant Supervisor – (925) 516-6060
Ryan LaMunyon – *(Legally Responsible Official)*

Senior Collection System Worker – (925) 516-6060
Vacant – *(Data Submitter)*

City of Brentwood Police Department – (925) 634-6911
Police Department Dispatch – (925) 778-2441

City Stand-by – (925) 382-4157
Rotating On-Call Staff

Collections Staff – (925) 516-6060
Gary Krehbiel – *(Data Submitter)*
Dylan Ulrich – *(Data Submitter)*
Luke Santos – *(Data Submitter)*

Element 3: LEGAL AUTHORITY

This element of the SSMP discusses the City’s Legal Authority, including its Municipal Code. This section fulfills the Legal Authority requirement for the SWRCB (Element 3).

3.1 Regulatory Requirements for Legal Authority Element

SWRCB Requirement: *The City must demonstrate, through collection system use ordinances, service agreements, or other legally binding procedures, that it possesses the necessary legal authority to:*

- a. Prevent illicit discharges into its wastewater collection system (examples may include infiltration (I/I), storm water, chemical dumping, unauthorized debris, etc.);*
- b. Require sewers and connections be properly designed and constructed;*
- c. Ensure access for maintenance, inspection, or repair for portions of the lateral owned or maintained by the Public Agency;*
- d. Limit the discharge of fats, oils, and grease and other debris causing blockage; and*
- e. Enforce any violation of its sewer ordinances.*

3.2 Municipal Code

The legal authority required for the SSMP by the SWRCB is contained within the City’s Municipal Code. One chapter of the Municipal Code is dedicated to the sewer system and can be accessed on the City’s website via the link below:

Chapter 13.04 SEWER SYSTEM – RULES AND REGULATIONS, of the [City’s Municipal Code](#) (updated quarterly)

The electronic version of the municipal code is updated quarterly on the City’s website. Other supporting information for Element 3 is included in Appendix A and includes the following documents:

1. Diagram illustrating lateral maintenance responsibilities.

Portions of this chapter are discussed in the following sub-sections as they pertain to prevention of illicit discharges, proper design and construction of sewer and connections, maintenance access, and enforcement measures.

3.3 Prevention of Illicit Discharge

All measures prohibiting illicit discharges are included in Chapters 13.04.300 – 13.04.315. The specific purpose of these chapters is to prevent the discharge of pollutants into the sewers which would obstruct or damage the collections system, interfere with treatment, or threaten harm to human health or the environment.

3.4 Proper Design and Construction of Sewers and Connections

Regulations pertaining to the design, construction, and inspection of private sewer systems, building sewers, and connections are included in Chapters 13.04.800 – 13.04.850 of the City of Brentwood's Municipal Code.

3.5 Ensure access for maintenance, inspection, or repair for portions of the lateral owned or maintained by the Public Agency

Section 13.04.850 makes it a condition of continuing use and connection to the city sewerage system that the City have access to the lateral to inspect and verify the condition of the lateral.

Effective September 23, 2003, the Brentwood City Council approved a sewer lateral maintenance program for residents of single family homes. The program was implemented to account for the costs associated with the maintenance, repair and/or replacement of the lower lateral located between the property line and main line. Section 13.04.820 states that each residential premises owner will be required to pay a monthly fee for the maintenance, repair, and/or replacement of their lower lateral as set forth by resolution of the city council. The city will be responsible for the lower lateral so long as the lateral maintenance fee is paid. However, the City is not responsible for any sewer lateral of a commercial, industrial, and/or institutional sewer service.

3.6 Limit Discharge of FOG and Other Debris

As discussed under Element 4: Fats, Oils, and Grease (FOG) Control Program, City Municipal Code Sections 13.04.315 prohibits discharge of any substance into the sewer system which has characteristics which could threaten to cause an interference or pass-through in the City's sewer lines. Section 13.04.400 requires any type of business or establishment where grease or other objectionable materials may be discharged into a public or private sewage main or disposal system to have a grease removal device.

3.7 Enforcement Measures

City Municipal Code Title 13 Article 10 lists the various enforcement mechanisms the City can utilize to provide adequate mechanisms to achieve maximum compliance with the sewer system regulations. These mechanisms include, but are not limited to:

- Informal administrative action
- Administrative orders
- Institution of a SEP
- Assessment of charges for obstruction or damage
- Suspension or termination of services
- Administrative citations
- Administrative complaints
- Civil action
- Criminal action

Element 4: OPERATION AND MAINTENANCE PROGRAM

This section of the SSMP discusses the City's operations, maintenance and other related measures and activities. The section fulfills the Operation and Maintenance Program SSMP requirement for the SWRCB (Element 4).

4.1 Element 4 Appendix

Supporting information for Element 4 is included in Appendix B. This appendix includes the following documents:

1. Quadrant Map
2. SSMP Maintenance Log
3. Spare Parts and Equipment Inventory

4.2 Collection System Map Discussion

The City has maps of all sewer and storm drain systems. These maps are kept electronically and accessed via the City's intranet. Each manhole (sewer and storm) in the City limits has been assigned a GPS coordinate for its exact location. The maps show the location of lift stations, manhole ID, pipe size (as indicated on as-built plans), flow direction, and pipe diameter, as well as street names and addresses, and parcels ID numbers. The City is in the process of linking video files of pipeline inspections to the corresponding sections of piping on the maps. An example map is shown below in Figure 4-1.



Figure 4-1

The maps are maintained in the City's GIS files through a software package called GeoVault, and are regularly updated as needed. The GIS files were originally created in 1999 and have continued to grow as the City nears build out.

When errors are discovered on the maps, the error is reported to the GIS system administrator via a work order, or through direct discussion with the system administrator. Maps are updated as new developments are accepted. Hard copies of map books are printed annually and kept in vehicles. Digital based updated maps are available to the Collection System Workers via laptops and tablets.

4.3 Prioritized Preventive Maintenance Discussion

Preventive Maintenance tasks are accomplished by three Collection System Workers. The City prioritizes its preventive maintenance (PM) activities. The preventive maintenance program includes scheduled hot-spot cleaning, quadrant cleaning, regular inspection of pump stations, as well as investigating customer problems and complaints. The follow subsection summarizes the City's preventive maintenance activities.

4.3.1 Sewer Cleaning

a. Hot-Spot Cleaning

Through the daily rounds procedures where heavy grease/problem areas and lift stations are checked, the City is able to identify sections of pipe that need cleaning more often than the normal 4-year cleaning schedule. Sections of pipe that are considered Hot-Spots depend on the history and causes of stoppages or overflows on that pipe.

Approximately 7,500 ft. of sewers (1% of the system) is included in the hot spot cleaning program. Hot-spots are cleaned quarterly using Vaccon hydro-flushers. Hot-spot cleaning is typically a two-man (1 crew) job, occurs monthly, and accounts for ~5% of the Collection System Workers' time.

In rare cases a location may be removed from the hot-spot list. This occurs if there is a direct action that eliminates whatever problem caused the location to be placed on the hot-spot list originally.

b. Quadrant Cleaning

The City's Collections Division maintains a chart that documents and tracks the sewer lines cleaned. The information on this schedule includes grid number, street name, start and finish manhole id number, length of pipe cleaned, amount of debris in the line, and a section to include information if the crew ran into any problems in the line. This process secures the City's goal of maintaining an effective cleaning program.

Areas of the sewer system not included in the hot spot cleaning program are inspected and or cleaned on a 4-year cycle (25% of City's sewer system per year) by splitting the system into four quadrants. This 4-year cycle is consistent with industry standards and is achievable with current staffing

levels. Regular quadrant cleaning is normally a two-man (1 crew) job, unless traffic control requirements or other special circumstances necessitate additional manpower. One such special circumstance is when trunk lines (.18 inch diameter) are cleaned. Trunk line cleaning requires an additional person and/or crew and traffic control measures. Quadrant cleaning accounts for ~20% of the collection System Workers' time.

c. CCTV Inspections

In 2014 the Collections crews began increasing the use of the CCTV equipment for preventive maintenance purposes. Current practice is to inspect the sewer prior to cleaning. If the line is clear and there are no mechanical deficiencies, the line does not need to be cleaned. If there is a significant amount of debris found, the line will be cleaned, or if a mechanical deficiency is found a repair can be scheduled. CCTV inspection accounts for ~40% of the collection System Workers' time.

4.3.2 Root Control

The City of Brentwood does not have a Root Foaming Program because root intrusion is not currently a problem in the City's sewer system. Staff will occasionally remove a root by hand. As the sewer system ages, if roots become an issue, the City will take the necessary steps to begin a foaming program.

4.3.3 Lift Station Maintenance

The City has two lift stations, Sellars and Dreamcatcher. Dreamcatcher serves approximately 20 homes located at the bottom of a hill and has approximately 250' of force-main. Sellars lift station has roughly 40 feet of force-main and serves the south eastern portion of the City. City maintenance staff performs a daily inspection of the City's two lift stations, Sellars and Dreamcatcher, from the surface (no confined space entry). Comprehensive pump station maintenance is performed by City staff to clean wet wells and check for problems with pumps. If pumps have an issue, they are sent out to be overhauled and/or repaired. SOP's for lift station operation have been developed and are attached in Appendix B.

4.3.4 Odor Control

The City receives approximately one (1) to two (2) odor complaints per year. These complaints are often calls which are not sewer related, but are storm water related. When there are complaints, City crews can jet clean sewer lines in the direct area to eliminate any possible odors and attempt to plug holes in manhole lids where odors may be escaping the system. The City does not currently have a formal odor control program.

4.3.5 Corrosion Control

Over 80 percent of the pipe material in the City's collection system is SDR 35 (PVC), which does not need corrosion control. The other 20 percent is vitrified clay (VCP) which also does not require a corrosion control program.

4.3.6 Investigation of Customer Complaints

When the City receives a call regarding a sewer issue (stoppages, overflows, and odors) the information is given to the Collections staff or the standby worker if the call is received after hours, and is responded to accordingly. Staff first makes contact with the home owner and assess the situation. If an issue is identified, a plan to eliminate the issue is developed based on directions listed in the OERP or other SOP. During an after-hours event when a stand by personnel responds, they are directed to call Collections System personnel in if an overflow is observed.

The majority of complaints received by the City are related to stoppages. During work hours, a Collections crew is diverted to investigate the stoppage. Most of the stoppages occur in the upper laterals, and are the responsibility of the homeowner. Although staff respond to all stoppage complaints, they are not responsible for clearing stoppages in laterals from the property line to the house. The City's initial response time goal is 30 minutes.

Sewer call response actions are documented in the City's CMMS program. This documentation contains the relevant information for each call. In the event a call is for an actual SSO, a separate file is generated for that SSO.

4.3.7 Maintenance Management and Work Orders

The City uses a CMMS (Computerized Maintenance Management System) program called Maintenance Connection to generate and track work orders and staff time. Work Orders are generated by either the public calling in or the City staff.

For purposes of maintenance work tracking metrics assessment, the SSMP Maintenance Log in Appendix B is used.

4.4 Scheduled Inspections and Condition Assessment Discussion

The City's manholes, pipelines, and lift stations are assessed during PM inspection/cleaning discussed in section 4.3.1. If abnormal conditions are noticed, a plan for repair/replacement can be developed through the CIP process.

4.4.1 Manhole Inspection

As part of the hot spot and quadrant cleaning program, City maintenance staff visually inspect manholes for corrosion, debris or damage around the base, cracks or holes, condition of manhole steps, and also the manhole ring and lid for damage. The City understands the importance of a robust manhole inspection program. High priority manholes needing to be epoxy lined are prioritized and added to a CIP project.

All new construction projects are inspected by both a City inspector and a member of the collection staff. These inspections help the City verify the new construction is up to code and is not going to be a problem in the near future.

4.4.2 Pipeline Inspection

The City purchased a CCTV truck in January 2004 which has the capability of visually inspecting sewer mains. The truck uses a Cues camera system with Granite XP software. The City has used this truck with its formal coding system to inspect sewer lines and laterals since its purchase.

Collections staff uses the CCTV truck in its Quadrant and Hot Spot cleaning program when it feels there may be an offset, belly, or any deficiency in the lines being cleaned. Also, when there is a sewer backup or plug, and crews respond, the CCTV truck is used once the line is unplugged to inspect the lines for any problems (roots, offset, belly, debris). If a problem is identified, it is fixed by the City crew if it's the City's responsibility, or if it is the property owner's responsibility, a video recording of the line is given to the property owner showing the problem that needs to be fixed.

Lateral sewer lines are not routinely inspected. If residents call and report a problem Collections staff will respond with a push camera to inspect the lateral. If a lateral must be cleaned, it is inspected after being cleaned to ensure there are no additional problems with the lateral.

4.4.3 Pump Station Inspection and Assessment

The City has two lift stations, Sellers and Dreamcatcher, which are in excellent condition. The Sellers lift station was part of a CIP project in 2010 which completely refurbished the existing site. It was redesigned in a way so if a lift station failure occurred, the City is able to use the existing site with external pumps and generators without disrupting traffic or flows. The Dreamcatcher lift station is supplied by 20 houses at the southwest end of town. It was accepted into the City's sewer system in 2007 and is comparatively new as well.

The City inspects both lift stations daily. These daily inspections consist of a visual check of the wet wells, checking and cleaning of floats if needed, recording the hours on the meters for each pump at both stations, reading of PG&E meter numbers, checking for alarms on SCADA screen, and checking levels of wet well.

The lift stations are gone through at length every one to two years. Extensive maintenance includes cleaning out the wet well with pressure washing, use of the hydro-vac truck to remove debris, and removing pumps for inspection and repairs if necessary.

4.5 Contingency Equipment and Replacement Inventories

The City maintains an equipment inventory. All sewer maintenance equipment and replacement parts are stored at the City's Corporation Yard. Equipment and spare parts are replaced as necessary based on the estimated useful and remaining life of the product. The City's spare parts and equipment inventory list is included in Appendix B.

The City keeps spare parts in inventory to minimize the sanitary sewer system down time during a needed repair. Spare parts include manhole rings and lids, hoses, couplings,

nozzle heads for maintenance and emergency response equipment, and 4, 6, and 8 inch diameter PVC spare pipe.

Pump stations and the City's trunk mains are considered to be "critical" parts of the system. Emergency equipment stored by the City for the effective response to a crisis in these areas is sewer bypass pumps, emergency backup generator, and the combination jet-vac trucks. The City finds having adequate inventory for responding to all emergencies is of the highest priority.

The City maintains an emergency trailer which can be used in the event emergency repairs to the collection system are needed. This trailer is stocked with generators, compressors, plugs, barriers, cones, etc. In addition to Collections System personnel, Public Works stand-by staff members are trained to respond to after-hours calls with the trailer, ensuring the fastest response time to overflow occurrences.

4.6 Training Discussion

The City budgets for training its Collection System operations and maintenance staff each year. Providing training opportunities to enable all Collection System operations and maintenance staff to remain certified is a goal and requirement of the City. The City assists with certification by reimbursing the employees the original test fees once the certification test is passed. Current staff certifications include:

- 5 Collection System Worker II's
- 1 Collection System Worker I

The City uses numerous outside programs, as well as providing in-house and on-the-job training for sewer maintenance crews. Training programs used by the City include:

- CWEA
- Vendor sponsored training (i.e. Trench Plate shoring class)
- In-house training by supervisor and lead workers; and
- Safety meetings by experienced staff and/or vendors (i.e. Safety Fair).

The City has established a cross-training program where all qualified employees of the City (must have a Class B license) have the capability of training in other departments with some monetary benefits. This training must be approved by all affected department supervisors/managers. Once approved, the training is conducted by a member of the collection staff. The trainee has the opportunity to learn all facets of the job including operating the hydro-vac trucks, pipe and manhole cleaning and examination, lift station and hot spot check, and all tasks included in the collection crew cross-training program. To pass the cross-training, the individual must demonstrate competency in all skill sets including driving the trucks in order to get signed off as competent.

Element 5: DESIGN & CONSTRUCTION STANDARDS

This section of the SSMP discusses the City’s design and construction standards. This section fulfills the Design and Performance Provisions SSMP requirements for the SWRCB (Element 5).

5.1 Regulatory Requirements for Design & Construction Standards

SWRCB Requirement: *The City must have design and construction standards and construction standards and specifications for the installation of new sewer systems, pump stations and other appurtenances; and for the rehabilitation and repair of existing sewer systems. The City must also have procedures and standards for inspecting and testing the installation of new sewers, pumps, and other appurtenances and for rehabilitation and repair projects.*

5.2 Standard Plans and Specifications

Supporting information for Element 5 is located in the following sections of the City’s Standard Plans and Specifications:

Section	Title
120-1.01	Description
120-1.02	Materials
120-1.03	Excavation and Backfill
120-1.04	Bedding and Initial Backfill
120-1.05	Pipe Laying
120-1.06	Pipe Joints
120-1.07	Existing Manholes
120-1.08	Sewer Structures
120-1.09	Coating Manholes
120-1.10	Trench Resurfacing
120-1.11	Testing
Detail	Title
SS-1	Standard Sewer Service
SS-2	Sanitary Sewer Manhole
SS-3	Large Sanitary Sewer Manhole
SS-4	Sanitary Terminal Manhole Base
SS-5	Utility Crossing
SS-6a	Grease Interceptor Details
SS-6b	Grease Interceptor Notes
SS-7	Sewer Backflow Relief Devices

A complete copy of the Standard Plans and Specifications can be accessed on the City’s website via the link below:

1. [Standard Plans and Specifications, Section 120](http://www.brentwoodca.gov/civicaax/filebank/blobdload.aspx?BlobID=25823)
<http://www.brentwoodca.gov/civicaax/filebank/blobdload.aspx?BlobID=25823>

5.3 Design & Construction Standards Discussion

Section 120 of the City's Standard Specifications addresses Sanitary Sewer Installation. This section includes specifications on pipe, manhole, cleanout, and sewer lateral materials and construction methods, as well as sewer line pressure testing, acceptance, and final inspection by CCTV. These requirements provide reasonable assurance sewers constructed to these specifications will perform adequately with minimal infiltration or maintenance problems and will maintain their structural integrity for the duration of their intended useful lives. The City's Standard Specifications are updated regularly to help prevent future problems in the City's sewer system.

Many of the specifications included in Section 120 of the City's Standard Specifications also apply to sewer pipeline rehabilitation and repair projects. Additional specifications related to sewer rehabilitation and repair will be added as needed when such projects are implemented by the City, or will be included in project-specific specifications.

The City owns two lift stations and does not anticipate any additional pump stations being built. Therefore, pump station plans and specifications are not included in the Standards. Design standards and construction specifications for pump stations will be developed as needed on a project-specific basis should any new pump stations or pump station rehabilitation projects be implemented.

Element 6: OVERFLOW EMERGENCY RESPONSE PLAN

This section of the SSMP provides an overview and summary of the City's emergency response documents and procedures for sewer overflows. Standard Operating Procedures pertaining to the sewer collection system are attached in Appendix B. This section contains the Overflow Emergency Response Plan and satisfies the SWRCB (Element 6) SSMP requirements.

6.1 Regulatory Requirements for Overflow Emergency Response Plan Element

SWRCB Requirement: *The collection system agency shall develop and implement an overflow emergency response plan which identifies measures to protect public health and the environment. At a minimum, this plan must include the following:*

- A. Proper notification procedures so the primary responders and regulatory agencies are informed of all SSOs in a timely manner;*
- B. A program to ensure appropriate response to all overflows;*
- C. Procedures to ensure prompt notification to appropriate regulatory agencies and other potentially affected entities (e.g. health agencies, regional water boards, water suppliers, etc.) of all SSOs which potentially affect public health or reach the waters of the State in accordance with the MRP. All SSOs shall be reported in accordance with the MRP, the California Water Code, other State Law, and other applicable Regional Water Board WDR or NPDES permit requirements. The SSMP should identify the officials who will receive immediate notification;*
- D. Procedures to ensure appropriate staff and contractor personnel are aware of and follow the Emergency Response Plan and are appropriately trained;*
- E. Procedures to address emergency operations, such as traffic and crowd control and other necessary response activities; and*
- F. A program to ensure all reasonable steps are taken to contain untreated wastewater and prevent discharge of untreated wastewater to waters of the United States and minimize or correct any adverse impact on the environment resulting from the SSOs, including such accelerated or additional monitoring as may be necessary to determine the nature and impact of the discharge.*

6.2 Element 6 Appendix

Supporting information for Element 6 is included in Appendix C. This appendix includes the following documents:

1. Water Quality Monitoring Plan
2. City Map with Creek Sampling Locations

6.3 Overflow Emergency Response Plan

The Overflow Emergency Response Plan (OERP) is a stand-alone document but is included in this SSMP in its entirety for ease of reference. The OERP was update in 2014 by DKF Solutions. The updated OERP includes the information required by the SWRCB, including the new SSO categories for reporting purposes, and the requirement for a Technical Report for SSOs greater than 50,000 gallons.

City of Brentwood

Overflow Emergency Response Plan



Effective Date: _____

Revised Date: _____

Approved by: _____

Signature: _____

Date: _____

Prepared by David Patzer, DKF Solutions Group
(707) 373-9709 dpatzer@dkfsolutions.com

Sanitary Sewer Overflow Emergency Response Plan (OERP)

(ref. SWRCB Order No. 2006-0003-DWQ Element VI)

- 1. Purpose
- 2. Policy
- 3. Definitions as used in this OERP
- 4. State Regulatory Requirements for OERP Element of SSMP
- 5. Goals
- 6. Sanitary Sewer Overflow (SSO) Detection and Notification
- 7. SSO Response Procedures
- 8. Recovery and Cleanup
- 9. Water Quality
- 10. Sewer Backup Into/Onto Private Property Claims Handling Policy
- 11. Notification, Reporting, Monitoring and Recordkeeping Requirements
- 12. Post SSO Event Debriefing
- 13. Failure Analysis Investigation
- 14. SSO Response Training
- 15. High Priority Assets
- 16. Authority
- 17. References

Appendix A: Regulatory Notifications Packet

Instructions..... Envelope

Regulatory Reporting Guide **A-1**

Category 1 SSO Reporting Checklist..... -2a

Category 2 and 3 SSO Reporting Checklist..... -2b

Appendix B: Sanitary Sewer Backup Packet

Response Instructions envelope label

Response Flowchart **B-1**

Bubbled Toilets Letter -2

First Responder Form -3

Declination of Sewage Cleaning Services -4

Lodging Authorization Form..... -5

Sewer Overflow Report..... -6

Start Time Determination Form..... -7

Volume Estimation Methods

- Eyeball Estimation -8a
- Duration and Flow Rate Photo Comparison -8b
- Upstream Lateral Connections -8c

Lateral TV Report..... -9

Claims Submittal Checklist -10

Collection System Failure Analysis Form -11

Customer Service Packet

- Instructions..... -envelope
- Customer Information CS-1
- Claim Form -2
- Cleanout Riser Information Handout..... -3
- Sewer Spill Reference Guide..... pamphlet

Regulatory Notifications Packet See contents list above

Door Hanger n/a

Sewer Spill Reference Guide..... pamphlet

Appendix C: Sanitary Sewer Overflow Packet

Instructions and Chain of Custody Envelope Label
Responding to a Sanitary Sewer Overflow **C-1**
Sewer Overflow Report..... -2
Start Time Determination Form..... -3
Volume Estimation Methods
 Eyeball Estimation -4a
 Duration and Flow Rate Photo Comparison -4b
 Upstream Lateral Connections -4c
Collection System Failure Analysis Form -5
Regulatory Notifications Packet See contents list above
Sewer Spill Reference Guide..... pamphlet
Public Posting n/a
Door Hanger n/a

Appendix D: Field Sampling Kit

Procedures for Sampling Receiving Waters and Posting
Warnings after a Sewage Spill..... **D-1**
Sample Collection Chain of Custody Record..... -2

Appendix E: Contractor Orientation

Appendix F: Sewer Service Request Form

Sanitary Sewer Overflow Emergency Response Plan

(ref. SWRCB Order No. 2006-0003-DWQ Element VI)

1. Purpose

The purpose of the City of Brentwood's Overflow Emergency Response Plan (OERP) is to support an orderly and effective response to Sanitary Sewer Overflows (SSOs). The OERP provides guidelines for City personnel to follow in responding to, cleaning up, and reporting SSOs that may occur within the City's service area. This OERP satisfies the SWRCB Statewide General Waste Discharge Requirements (GWDR), which require wastewater collection agencies to have an Overflow Emergency Response Plan.

2. Policy

The City's employees are required to report all wastewater overflows found and to take the appropriate action to secure the wastewater overflow area, properly report to the appropriate regulatory agencies, relieve the cause of the overflow, and ensure that the affected area is cleaned as soon as possible to minimize health hazards to the public and protect the environment. The City's goal is to respond to sewer system overflows as soon as possible following notification. The City will follow reporting procedures in regards to sewer spills as set forth by the Central Valley Regional Water Quality Control Board (CVRWQCB) and the California State Water Resources Control Board (SWRCB).

3. Definitions As Used In This OERP

CALIFORNIA INTEGRATED WATER QUALITY SYSTEM (CIWQS): Refers to the State Water Resources Control Board online electronic reporting system that is used to report SSOs, certify completion of the SSMP, and provide information on the sanitary sewer system.

FROG – Fats, Roots, Oils, and Grease: FOG refers to fats, oils, and grease typically associated with food preparation and cooking activities that can cause blockages in the sanitary sewer system. Tree root invasion (R) presents an additional problem. If a mat of root hair forms in the sewer line it slows the flow of wastewater and exacerbates the rate of accumulation of FOG materials.

LEGALLY RESPONSIBLE OFFICIAL (LRO): Refers to an individual who has the authority to certify reports and other actions that are submitted through CIWQS.

MAINLINE SEWER: Refers to City wastewater collection system piping that is not a private lateral connection to a user.

MAINTENANCE HOLE OR MANHOLE: Refers to an engineered structure that is intended to provide access to a sanitary sewer for maintenance and inspection.

NOTIFICATION OF AN SSO: Refers to the time at which the City becomes aware of an SSO event through observation or notification by the public or other source.

NUISANCE - California Water Code section 13050, subdivision (m), defines nuisance as anything that meets all of the following requirements:

- a. Is injurious to health, or is indecent or offensive to the senses, or an obstruction to the free use of property, so as to interfere with the comfortable enjoyment of life or property.

- b. Affects at the same time an entire community or neighborhood, or any considerable number of persons, although the extent of the annoyance or damage inflicted upon individuals may be unequal.
- c. Occurs during, or as a result of, the treatment or disposal of wastes.

PREVENTATIVE MAINTENANCE: Refers to maintenance activities intended to prevent failures of the wastewater collection system facilities (e.g. cleaning, CCTV, inspection).

PRIVATE LATERAL SEWAGE DISCHARGES – Sewage discharges that are caused by blockages or other problems within a privately owned lateral.

SANITARY SEWER BACKUP (BACKUP) – When blockages or flow conditions cause wastewater to backup into buildings and on private property.

SANITARY SEWER OVERFLOW (SSO) - Any overflow, spill, release, discharge or diversion of untreated or partially treated wastewater from a sanitary sewer system. SSOs include:

- (i) Overflows or releases of untreated or partially treated wastewater that reach waters of the United States;
- (ii) Overflows or releases of untreated or partially treated wastewater that do not reach waters of the United States; and
- (iii) Wastewater backups into buildings and on private property that are caused by blockages or flow conditions within the publicly owned portion of a sanitary sewer system.

SSOs that include multiple appearance points resulting from a single cause will be considered one SSO for documentation and reporting purposes in CIWQS.

NOTE: Wastewater backups into buildings caused by a blockage or other malfunction of a building lateral that is privately owned are not SSOs.

SSO Categories:

- Category 1: Discharge of untreated or partially treated wastewater of any volume resulting from a sanitary sewer system failure or flow condition that either:
- Reaches surface water and/or drainage channel tributary to a surface water; or
 - Reached a Municipal Separate Storm Sewer System (MS4) and was not fully captured and returned to the sanitary sewer system or otherwise captured and disposed of properly.

- Category 2: Discharge of untreated or partially treated wastewater greater than or equal to 1,000 gallons resulting from a sanitary sewer system failure or flow condition that either:
- Does not reach surface water, a drainage channel, or an MS4, or
 - The entire SSO discharged to the storm drain system was fully recovered and disposed of properly.

- Category 3: All other discharges of untreated or partially treated wastewater resulting from a sanitary sewer system failure or flow condition.

SANITARY SEWER SYSTEM: Any publicly-owned system of pipes, pump stations, sewer lines, or other conveyances, upstream of a wastewater treatment plant headworks used to collect and convey wastewater to the publicly owned treatment facility. Temporary storage and conveyance facilities (such as vaults, temporary

pipings, construction trenches, wet wells, impoundments, tanks, etc.) are considered to be part of the sanitary sewer system, and discharges into these temporary storage facilities are not considered to be SSOs.

SENSITIVE AREA: Refers to areas where an SSO could result in a fish kill or pose an imminent or substantial danger to human health (e.g. parks, aquatic habitats, etc.)

SEWER SERVICE LATERAL: Refers to the piping that conveys sewage from the building to the City's wastewater collection system.

UNTREATED OR PARTIALLY TREATED WASTEWATER: Any volume of waste discharged from the sanitary sewer system upstream of a wastewater treatment plant headworks.

WATERS OF THE STATE: Waters of the State (or waters of the United States) means any surface water, including saline waters, within the boundaries of California. In case of a sewage spill, storm drains are considered to be waters of the State unless the sewage is completely contained and returned to the wastewater collection system and that portion of the storm drain is cleaned.

4. State Regulatory Requirements for Element 6, Overflow Emergency Response Plan

GWDR Requirement

The collection system agency shall develop and implement an overflow emergency response plan that identifies measures to protect public health and the environment. At a minimum, this plan must include the following:

- (a) Proper notification procedures so that the primary responders and regulatory agencies are informed of all SSOs in a timely manner;
- (b) A program to ensure appropriate response to all overflows;
- (c) Procedures to ensure prompt notification to appropriate regulatory agencies and other potentially affected entities (e.g. health agencies, regional water boards, water suppliers, etc.) of all SSOs that potentially affect public health or reach the waters of the State in accordance with the Monitoring and Reporting Program (MRP). All SSOs shall be reported in accordance with this MRP, the California Water Code, other State Law, and other applicable Regional Water Board Waste Discharge Requirements or National Pollutant Discharge Elimination System (NPDES) permit requirements. The Sewer System Management Plan should identify the officials who will receive immediate notification;
- (d) Procedures to ensure that appropriate staff and contractor personnel are aware of and follow the Emergency Response Plan and are appropriately trained;
- (e) Procedures to address emergency operations, such as traffic and crowd control and other necessary response activities; and
- (f) A program to ensure that all reasonable steps are taken to contain untreated wastewater and prevent discharge of untreated wastewater to Waters of the United States and minimize or correct any adverse impact on the environment resulting from the SSOs, including such accelerated or additional monitoring as may be necessary to determine the nature and impact of the discharge.

The Sewer System Management Plan and critical supporting documents are made available to the public on the City's website at <http://www.brentwoodca.gov/gov/pw/sewer/default.asp>.

5. Goals

The City's goals with respect to responding to SSOs are:

- Work safely;
- Respond quickly to minimize the volume of the SSO;

- Eliminate the cause of the SSO;
- Prevent sewage system overflows or leaks from entering the storm drain system or receiving waters to the maximum extent practicable;
- Contain the spilled wastewater to the extent feasible;
- Minimize public contact with the spilled wastewater;
- Mitigate the impact of the SSO;
- Meet the regulatory reporting requirements;
- Evaluate the causes of failure related to certain SSOs; and
- Revise response procedures resulting from the debrief and failure analysis of certain SSOs.

6. SSO Detection and Notification

ref. SWRCB Order No. 2006-0003-DWQ VI(a)

The processes that are employed to notify the City of the occurrence of an SSO include: observation by the public, receipt of an alarm, or observation by City staff during the normal course of their work.

The City operates two wastewater lift stations. In the event of any pump failure, the high level sensor activates the SCADA alarm system and the City is contacted. To prevent overflow, wastewater from the wet well can either be pumped into a vacuum truck for disposal to a nearby sanitary sewer manhole, or bypassed around the station into the sanitary sewer system.

6.1 PUBLIC OBSERVATION

Public observation is the most common way that the City is notified of blockages and spills. Contact numbers and information for reporting sewer spills and backups are in the phone book. The City's telephone number for reporting sewer problems is (925) 516-6060.

Normal Work Hours

When a report of a sewer spill or backup is made during normal work hours, administrative staff receives the call and then completes the Sewer Service Request Form (Appendix F). The caller is then forwarded to the Collections Crew.

After Hours


After hours the main number has a message directing caller to call Police Department Dispatch. Dispatch will take caller info and contact the Public Works Standby Employee who will contact a Collections Maintenance Worker II (if unavailable the PW Standby Employee will contact the Wastewater Operations Manager).

When calls are received, either during normal work hours or after hours, the individual receiving the call will collect the following information and complete the Sewer Service Request Form:

- Time and date of call
- Specific location of potential problem
- Nature of call
- In case of SSO, estimated start time of overflow
- Caller's name and telephone number
- Caller's observation (e.g., odor, duration, location on property, known impacts, indication if surface water impacted, appearance at cleanout or manhole)
- Other relevant information

The following is an overview of receiving a sewage overflow or backup report:

Figure 6.1 Overview of Receiving a Sewage Overflow or Backup Report Procedure

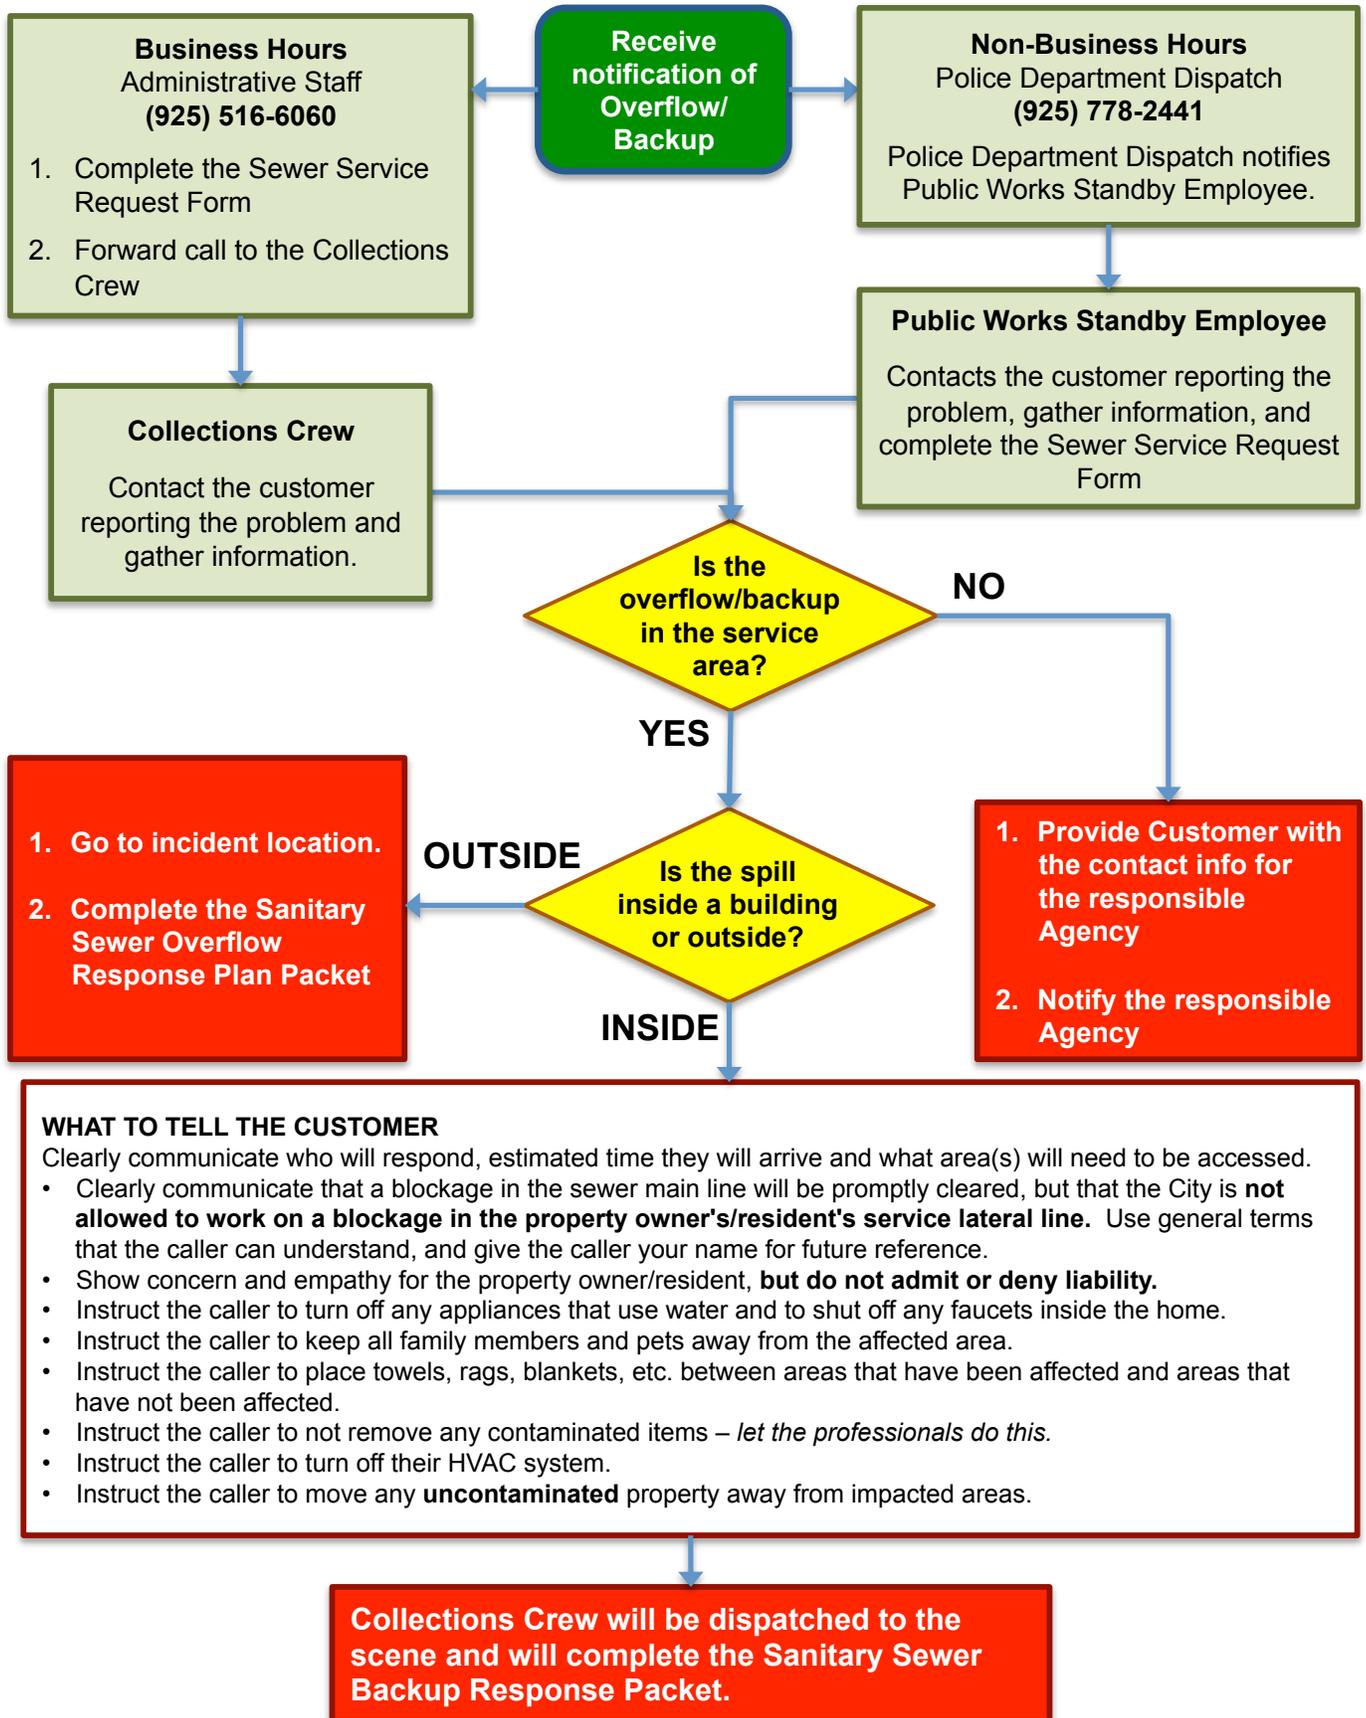

6.2 CITY STAFF OBSERVATION

City staff conducts periodic inspections of its sewer system facilities as part of their routine activities. Any problems noted with the sewer system facilities are reported to appropriate City staff that, in turn, responds to emergency situations. Work orders are issued to correct non-emergency conditions.

6.3 CONTRACTOR OBSERVATION

The following procedures are to be followed in the event that a contractor/plumber causes or witnesses a Sanitary Sewer Overflow. If the contractor/plumber causes or witnesses an SSO they should:

1. Immediately notify the City
2. Protect storm drains
3. Protect the public
4. Provide Information to the City Collections Crew such as start time, appearance point, suspected cause, weather conditions, etc.
5. Direct ALL media and public relations requests to the Public Information Officer


7. SSO Response Procedures

ref. SWRCB Order No. 2006-0003-DWQ Element 6(b)

7.1 Sewer Overflow/Backup Response Summary

The City will respond to SSOs as soon as feasible following notification of an overflow/backup or unauthorized discharge. The following (Figure 7.1) is an overview of the response activities.

Figure 7.1 Overview of SSO/Backup Response

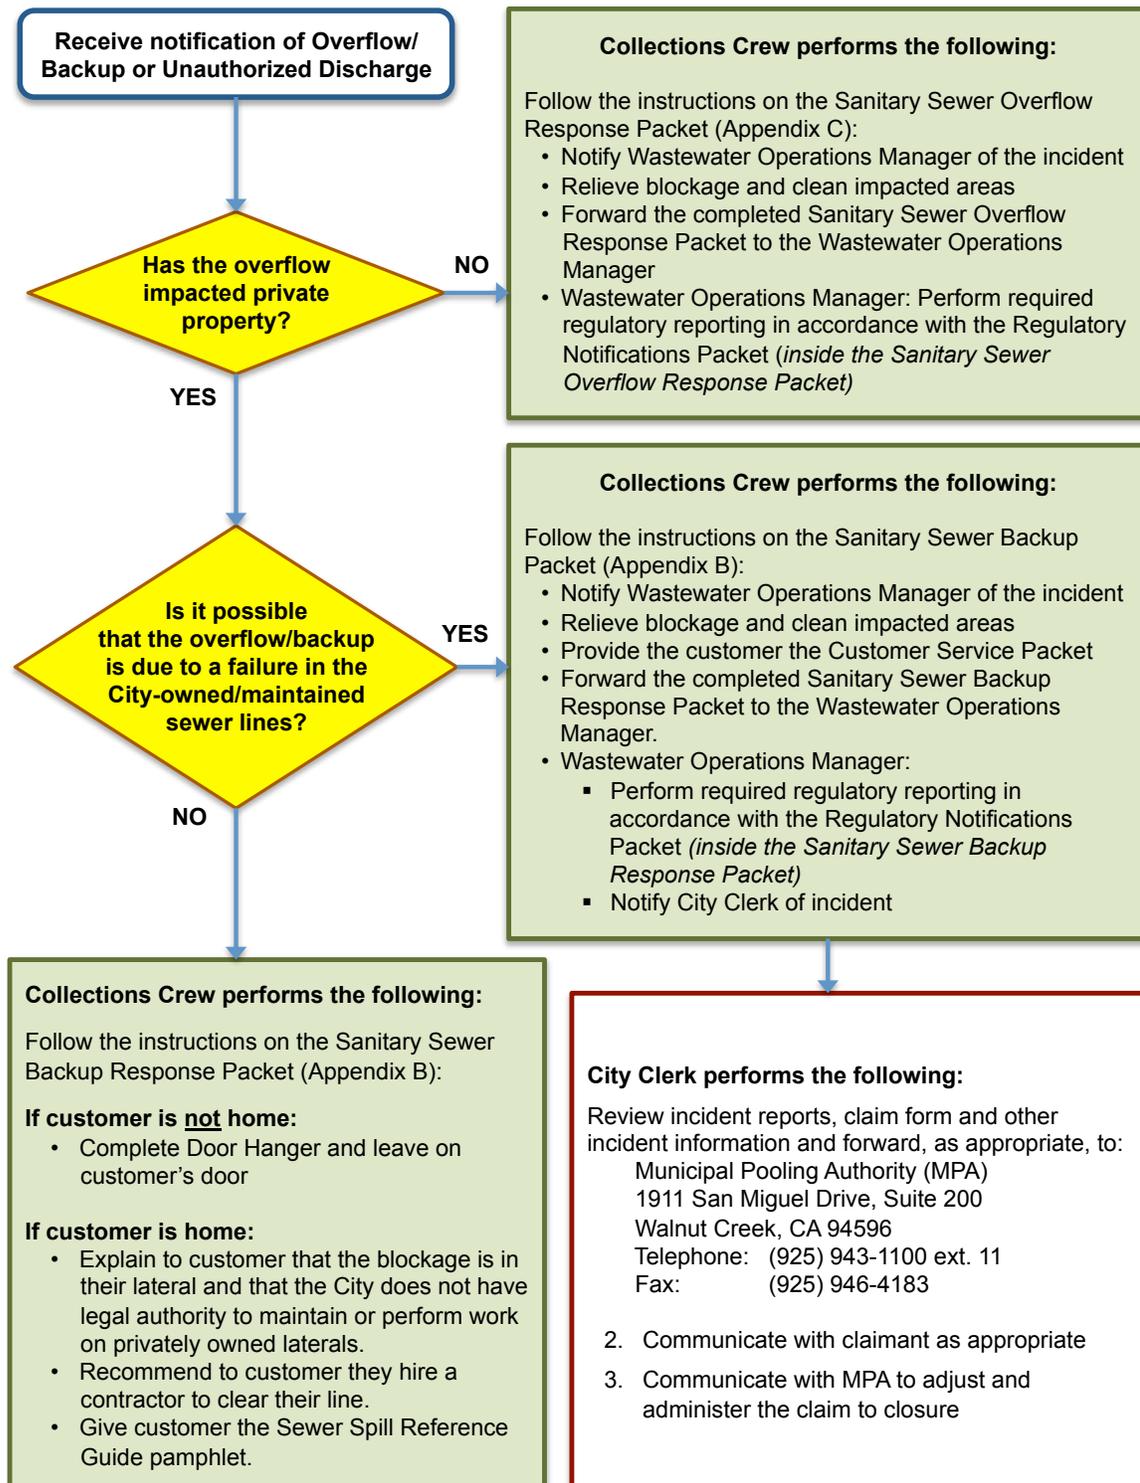

7.2 First Responder Priorities

The first responder's priorities are:

- To follow safe work practices.
- To respond promptly with the appropriate and necessary equipment.
- To contain the spill wherever feasible.
- To restore the flow as soon as practicable.
- To minimize public access to and/or contact with the spilled sewage.
- To promptly notify the Wastewater Operations Manager in event of major SSO.
- To return the spilled sewage to the sewer system.
- To restore the area to its original condition (or as close as possible).

7.3 Safety

The first responder is responsible for following safety procedures at all times. Special safety precautions must be observed when performing sewer work. There may be times when City personnel responding to a sewer system event are not familiar with potential safety hazards peculiar to sewer work. In such cases it is appropriate to take the time to discuss safety issues, consider the order of work, and check safety equipment before starting the job.

7.4 Initial Response

The first responder must respond to the reporting party/problem site and visually check for potential sewer stoppages or overflows.

The first responder will:

- Note arrival time at the site of the overflow/backup.
- Verify the existence of a public sewer system spill or backup.
- Determine if the overflow or blockage is from a public or private sewer.
- Identify and assess the affected area and extent of spill.
- Contact caller if time permits.
- If the spill is large or in a sensitive area, document conditions upon arrival with photographs. Decide whether to proceed with clearing the blockage to restore the flow or to initiate containment measures. The guidance for this decision is:
 - Small spills (i.e., spills that are easily contained) – proceed with clearing the blockage.
 - Moderate or large spill where containment is anticipated to be simple – proceed with the containment measures.
 - Moderate or large spills where containment is anticipated to be difficult – proceed with clearing the blockage; however, whenever deemed necessary, call for additional assistance and implement containment measures.
- Take steps to contain the SSO. For detailed procedures refer to Appendix B: Sanitary Sewer Backup Procedures, and Appendix C: Sanitary Sewer Overflow Packet.

7.5 Initiate Spill Containment Measures

The first responder will attempt to contain as much of the spilled sewage as possible using the following steps:

- Determine the immediate destination of the overflowing sewage.
- Plug storm drains using air plugs, sandbags, and/or plastic mats to contain the spill, whenever appropriate. If spilled sewage has made contact with the storm drainage system, attempt to contain the spilled sewage by plugging downstream storm drainage facilities.

- Contain/direct the spilled sewage using dike/dam or sandbags.
- Pump around the blockage/pipe failure.

For detailed procedures refer to Appendix C: Sanitary Sewer Overflow Packet.

7.6 Restore Flow

Using the appropriate cleaning equipment, set up downstream of the blockage and hydro-clean upstream from a clear manhole. Attempt to remove the blockage from the system and observe the flows to ensure that the blockage does not reoccur downstream. If the blockage cannot be cleared within a reasonable time from arrival, or sewer requires construction repairs to restore flow, then initiate containment and/or bypass pumping. If other assistance is required, immediately contact the Wastewater Operations Manager. For detailed procedures refer to Appendix C: Sanitary Sewer Overflow Packet.

7.7 Equipment

This section provides a list of specialized equipment that may be used to support this Overflow Emergency Response Plan.

- *Closed Circuit Television (CCTV) Inspection Unit* – A CCTV Inspection Unit is required to determine the root cause for all SSOs from gravity sewers.
- *Camera* -- A digital or disposable camera is required to record the conditions upon arrival, during clean up, and upon departure.
- *Emergency Response Trucks* -- A utility body pickup truck, or open bed is required to store and transport the equipment needed to effectively respond to sewer emergencies. The equipment and tools will include containment and clean up materials.
- *Portable Generators, Portable Pumps, Piping, and Hoses* – Equipment used to bypass pump, divert, or power equipment to mitigate an SSO.
- *Combination Sewer Cleaning Trucks* -- Combination high velocity sewer cleaning trucks with vacuum tanks are required to clear blockages in gravity sewers, vacuum spilled sewage, and wash down the impacted area following the SSO event.
- *Air plugs, sandbags and plastic mats*
- *Portable Lights*

Standard operating procedures for equipment that may be necessary in the event of a sanitary sewer overflow or backup can be found in the Public Works office or on the equipment.

8. Recovery and Cleanup

ref. SWRCB Order No. 2006-0003-DWQ Element 6(e)

The recovery and cleanup phase begins immediately after the flow has been restored and the spilled sewage has been contained to the extent possible. The SSO recovery and cleanup procedures are:

8.1 Estimate the Volume of Spilled Sewage

Use the methods outlined in the Sanitary Sewer Backup Packet (Appendix B), Sanitary Sewer Overflow Packet (Appendix C), and/or the Field Guide to estimate the volume of the spilled sewage. Wherever

possible, document the estimate using photos and/or video of the SSO site before and during the recovery operation.

8.2 Recovery of Spilled Sewage

Vacuum up and/or pump the spilled sewage and rinse water, and discharge it back into the sanitary sewer system.

8.3 Clean-up and Disinfection

Clean up and disinfection procedures will be implemented to reduce the potential for human health issues and adverse environmental impacts that are associated with an SSO event. The procedures described are for dry weather conditions and will be modified as required for wet weather conditions. Where cleanup is beyond the capabilities of the City Collections Crew, a cleanup contractor will be used.

Private Property

City crews are responsible for the cleanup when the property damage is minor in nature and is outside of private building dwellings, such as in front, side and backyards, easements, etc. In all other cases, affected property owners can call a water damage restoration contractor to complete the cleanup and restoration. If the overflow into property is the definite cause of City system failure, the property owner can call out a water damage restoration contractor to complete the cleanup and restoration. In both cases, City claim forms may be issued if requested by the property owners.

Hard Surface Areas

Collect all signs of sewage solids and sewage-related material either by protected hand or with the use of rakes and brooms. Wash down the affected area with clean water and/or deozyme or similar non-toxic biodegradable surface disinfectant until the water runs clear. The flushing volume will be approximately three times the estimated volume of the spill. Take reasonable steps to contain and vacuum up the wastewater. Allow area to dry. Repeat the process if additional cleaning is required.

Landscaped and Unimproved Natural Vegetation

Collect all signs of sewage solids and sewage-related material either by protected hand or with the use of rakes and brooms. Wash down the affected area with clean water until the water runs clear. The flushing volume will be approximately three times the estimated volume of the spill. Either contain or vacuum up the wash water so that none is released. Allow the area to dry. Repeat the process if additional cleaning is required.

Natural Waterways

The Department of Fish and Wildlife will be notified by CalOES for SSOs greater than or equal to 1,000 gallons.

Wet Weather Modifications

Omit flushing and sampling during heavy storm events (i.e., sheet of rainwater across paved surfaces) with heavy runoff where flushing is not required and sampling would not provide meaningful results.

8.4 Public Notification

Signs will be posted and barricades put in place to keep vehicles and pedestrians away from contact with spilled sewage. Contra Costa Environmental Health instructions and directions regarding placement and language of public warnings, if any, will be followed. Additionally, the Wastewater Operations Manager will use their best judgment regarding supplemental sign placement in order to protect the public and local environment. Signs will not be removed until directed by Contra Costa Environmental Health, the Wastewater Operations Manager or designee.

Creeks, streams and beaches that have been contaminated as a result of an SSO will be posted at visible access locations until the risk of contamination has subsided to acceptable background bacteria levels. The area and warning signs, once posted, will be checked every day to ensure that they are still in place. Photographs of sign placement will be taken.

In the event that an overflow occurs at night, the location will be inspected first thing the following day. The field crew will look for any signs of sewage solids and sewage-related material that may warrant additional cleanup activities.

When contact with the local media is deemed necessary, the Public Works Director or their designee will provide the media with all relevant information.

9. Water Quality

ref. SWRCB Order No. 2006-0003-DWQ Element 6(f)

9.1 Waters of the State

Marsh Creek is in the City of Brentwood's service area. In the event that these Waters of the State are impacted by a sanitary sewer overflow, contractor(s) on the City's current Contractor List will be contacted as necessary.

9.2 Water Quality Sampling and Testing

Water quality sampling and testing is required for Category 1 SSOs of 50,000 gallons or greater to determine the extent and impact of the SSO. The water quality sampling procedures must be implemented within 48 hours and include the following:

- The first responders will collect samples as soon as possible after the discovery and mitigation of the SSO event.
- The water quality samples will be collected from upstream of the spill, from the spill area, and downstream of the spill in flowing water (e.g. creeks). The water quality samples will be collected near the point of entry of the spilled sewage.
- The samples shall then be brought to the City of Brentwood Wastewater Treatment Plant Laboratory.

9.3 Water Quality Monitoring Plan

The City Water Quality Monitoring Plan will be implemented immediately upon discovery of any Category 1 SSO of 50,000 gallons or more in order to assess impacts from SSOs to surface waters. The SSO Water Quality Monitoring Program will:

1. Contain protocols for water quality monitoring.
2. Account for spill travel time in the surface water and scenarios where monitoring may not be possible (e.g. safety, access restrictions, etc.)
3. Require water quality analyses for ammonia and bacterial indicators to be performed by an accredited or certified laboratory.
4. Require monitoring instruments and devices used to implement the SSO Water Quality Monitoring Program to be properly maintained and calibrated, including any records to document maintenance and calibration, as necessary, to ensure their continued accuracy.
5. Within 48 hours of the City becoming aware of the SSO, require water quality sampling for ammonia and total and fecal coliform.
6. Observe proper chain of custody procedures.

9.4 SSO Technical Report

The City will submit an SSO Technical Report to the CIWQS Online SSO Database within 45 calendar days of the SSO end date for any SSO in which 50,000 gallons or greater are spilled to surface waters. The Wastewater Operations Manager will supervise the preparation of this report and will certify this report. This report, which does not preclude the Water Boards from requiring more detailed analyses if requested, shall include at a minimum, the following:

Causes and Circumstances of the SSO:

- Complete and detailed explanation of how and when the SSO was discovered.
- Diagram showing the SSO failure point, appearance point(s), and final destination(s).
- Detailed description of the methodology employed and available data used to calculate the volume of the SSO and, if applicable, the SSO volume recovered.
- Detailed description of the cause(s) of the SSO.
- Copies of original field crew records used to document the SSO.
- Historical maintenance records for the failure location.

City's Response to SSO:

- Chronological narrative description of all actions taken by the City to terminate the spill.
- Explanation of how the SSMP Overflow Emergency Response Plan was implemented to respond to and mitigate the SSO.
- Final corrective action(s) completed and/or planned to be completed, including a schedule for actions not yet completed.

Water Quality Monitoring:

- Description of all water quality sampling activities conducted including analytical results and evaluation of the results.
- Detailed location map illustrating all water quality sampling points.

10. Sewer Backup Into/Onto Private Property Claims Handling Policy

It is the policy of the City that a claims form shall be offered to anyone wishing to file a claim. The following procedures will be observed for all sewer overflows/backups into/onto private property:

- City Collections Crew will offer a City claim form irrespective of fault whenever it is possible that the sanitary sewer backup may have resulted from an apparent blockage in the City-owned sewer lines or whenever a City customer requests a claim form. The claim may later be rejected if subsequent investigations into the cause of the loss indicate the City was not at fault.
- It is the responsibility of the Collections Crew to gather information regarding the incident and notify the Wastewater Operations Manager or his/her designee.
- It is the responsibility of the City Clerk to review all claims and to oversee the adjustment and administration of the claim to closure.

11. Notification, Reporting, Monitoring and Recordkeeping Requirements

ref. SWRCB Order No. 2006-0003-DWQ Element 6(c)

In accordance with the Statewide General Waste Discharge Requirements for Sanitary Sewer Systems (SSS GWDRs), the City of Brentwood maintains records for each sanitary sewer overflow. Records include:

- Documentation of response steps and/or remedial actions
- Photographic evidence to document the extent of the SSO, field crew response operations, and site conditions after field crew SSO response operations have been completed. The date, time, location, and direction of photographs taken will be documented.
- Documentation of how any estimations of the volume of discharged and/or recovered volumes were calculated including all assumptions made.

Regulator required notifications are outlined in Section 11.1 on the following page.

11.1 Regulator Required Notifications

ELEMENT	REQUIREMENT	METHOD
NOTIFICATION	Within two hours of becoming aware of any Category 1 SSO greater than or equal to 1,000 gallons discharged to surface water or spilled in a location where it probably will be discharged to surface water, the City will notify the California Office of Emergency Services (CalOES) and obtain a notification control number.	Call Cal OES at: (800) 852-7550
REPORTING	<ul style="list-style-type: none"> • Category 1 SSO: The City will submit draft report within three business days of becoming aware of the SSO and certify within 15 calendar days of SSO end date. • Category 2 SSO: The City will submit draft report within 3 business days of becoming aware of the SSO and certify within 15 calendar days of the SSO end date. • Category 3 SSO: The City will submit certified report within 30 calendar days of the end of month in which SSO the occurred. • SSO Technical Report: The City will submit within 45 calendar days after the end date of any Category 1 SSO in which 50,000 gallons or greater are spilled to surface waters. • “No Spill” Certification: The City will certify that no SSOs occurred within 30 calendar days of the end of the month or, if reporting quarterly, the quarter in which no SSOs occurred. • Collection System Questionnaire: The City will update and certify every 12 months 	Enter data into the CIWQS Online SSO Database ¹ (http://ciwqs.waterboards.ca.gov/) certified by the Legally Responsible Official(s) ² . All information required by CIWQS will be captured in the Sanitary Sewer Overflow Report. Certified SSO reports may be updated by amending the report or adding an attachment to the SSO report within 120 calendar days after the SSO end date. After 120 days, the State SSO Program Manager must be contacted to request to amend an SSO report along with a justification for why the additional information was not available prior to the end of the 120 days.
WATER QUALITY MONITORING	The City will conduct water quality sampling within 48 hours after initial SSO notification for Category 1 SSOs in which 50,000 gallons or greater are spilled to surface waters.	Water quality results will be uploaded into CIWQS for Category 1 SSOs in which 50,000 gallons or greater are spilled to surface waters.
RECORD KEEPING	The City will maintain the following records: <ul style="list-style-type: none"> • SSO event records. • Records documenting Sanitary Sewer Management Plan (SSMP) implementation and changes/updates to the SSMP. • Records to document Water Quality Monitoring for SSOs of 50,000 gallons or greater spilled to surface waters. • Collection system telemetry records if relied upon to document and/or estimate SSO Volume. 	Self-maintained records shall be available during inspections or upon request.

¹ In the event that the CIWQS online SSO database is not available, the Wastewater Operations Manager will notify SWRCB by phone in accordance with the time schedules identified above. In such an event, the City will submit the appropriate reports using the CIWQS online SSO database when the database becomes available. A copy of all documents that certify the submittal in fulfillment of this section shall be retained in the SSO file.

² The City always has at least one LRO. Any change in the LRO(s) including deactivation or a change to contact information, will be submitted to the SWRCB within 30 days of the change by calling (866) 792-4977 or emailing help@ciwqs.waterboards.ca.gov.

For reporting purposes, if one SSO event of whatever category results in multiple appearance points in a sewer system, a single SSO report is required in CIWQS that includes the GPS coordinates for the location of the SSO appearance point closest to the failure point, blockage or location of the flow condition that cause the SSO, and descriptions of the locations of all other discharge points associated with the single SSO event.

11.2 Complaint Records

The City maintains records of all complaints received whether or not they result in sanitary sewer overflows. These complaint records include:

- Date, time, and method of notification
- Date and time the complainant or informant first noticed the SSO or occurrence related to the call
- Narrative description describing the complaint
- A statement from the complainant or informant, if they know, of whether or not the potential SSO may have reached waters of the state
- Name, address, and contact telephone number of the complainant or informant reporting the potential SSO (if not reported anonymously)
- Follow-up return contact information for each complaint received (if not reported anonymously)
- Final resolution of the complaint with the original complainant
- Work service request information used to document all feasible and remedial actions taken

This information is collected on the Sewer Service Request Form. All service requests are filed by month and are entered into the City's Computerized Maintenance Management System (CMMS). This information will be maintained for a minimum of five years whether or not they result in an SSO.

12. Post SSO Event Debriefing

ref. SWRCB Order No. 2006-0003-DWQ Element 6(d)

Every SSO event is an opportunity to evaluate the City response and reporting procedures. Each overflow event is unique, with its own elements and challenges including volume, cause, location, terrain, climate, and other parameters.

As soon as possible after Category 1 and Category 2 SSO events all of the participants, from the person who received the call to the last person to leave the site, will meet to review the procedures used and to discuss what worked and where improvements could be made in preventing or responding to and mitigating future SSO events. The results of the debriefing will be documented and tracked to ensure the action items are completed as scheduled.

13. Failure Analysis Investigation

ref. SWRCB Order No. 2006-0003-DWQ Element 6(d)

The objective of the failure analysis investigation is to determine the "root cause" of the SSO and to identify corrective action(s) needed that will reduce or eliminate future potential for the SSO to recur or for other SSOs to occur.

The investigation will include reviewing all relevant data to determine appropriate corrective action(s) for the line segment. The investigation will include:

- Reviewing and completing the Sanitary Sewer Overflow Report (in Appendix B and Appendix C) and any other documents related to the incident
- Reviewing the incident timeline and other documentation regarding the incident
- Reviewing communications with the reporting party and witness
- Reviewing volume estimate, volume recovered estimate, volume estimation assumptions and associated drawings
- Reviewing available photographs
- Interviewing staff that responded to the spill
- Reviewing past maintenance records
- Conducting a CCTV inspection to determine the condition of all line segments immediately following the SSO and reviewing the video and logs,
- Reviewing any Fats, Oils, Roots and Grease (FROG) related information or results
- Post SSO debrief records
- Interviews with the public at the SSO location

The product of the failure analysis investigation will be the determination of the root cause and the identification and scheduling of the corrective actions. The Collection System Failure Analysis Form (in Appendix B and Appendix C) will be used to document the investigation.

14. SSO Response Training

ref. SWRCB Order No. 2006-0003-DWQ Element 6(d)

This section provides information on the training that is required to support this Overflow Emergency Response Plan.

14.1 Initial and Annual Refresher Training

All City personnel who may have a role in responding to, reporting, and/or mitigating a sewer system overflow will receive training on the contents of this OERP. All new employees will receive training before they are placed in a position where they may have to respond. Current employees will receive annual refresher training on this plan and the procedures to be followed. The City will document all training.

Affected employees will receive annual training on the following topics by knowledgeable trainers:

- The City's Overflow Emergency Response Plan and Sanitary Sewer Management Plan
- Sanitary Sewer Overflow Volume Estimation Techniques
- Researching and documenting Sanitary Sewer Overflow Start Times
- Impacted Surface Waters: Response Procedures
- State Water Resources Control Board Employee Knowledge Expectations
- Employee Core Competency Evaluations on Sanitary Sewer Operations
- Water Quality Sampling Plan

The City will verify that annual safety training requirements are current for each employee, and that employees are competent in the performance of all core competencies. This will be verified through electronic testing, interviews and observations. The City will address, through additional training/instruction, any identified gaps in required core competencies.

Through SWRCB Employee Knowledge Expectations training the employee will be able to answer the following:

1. Please briefly describe your name and job title.

2. Please describe for us approximately when you started in this field and how long you have worked for your agency.
3. Please expand on your current position duties and role in responding in the field to any SSO complaints.
4. Please describe your SOPs used to respond/mitigate SSOs when they occur.
5. Describe any training your agency provides or sends you to for conducting spill volume estimates.
6. We are interested in learning more about how your historical SSO response activities have worked in the field. We understand from discussions with management earlier that you use the OERP from the SSMP. Please elaborate on how you implement and utilize the procedures in the plan.
7. Historically, before any recent changes, can you please walk us through how you would typically receive and respond to any SSO complaints in the field?
8. Can you tell us who is responsible for estimating SSO volumes discharged? If it is you, please describe how you go about estimating the SSO volume that you record on the work order/service request forms?
9. What other information do you collect or record other than what is written on the work order form?
10. Describe if and when you ever talk with people that call in SSOs (either onsite or via telephone) to further check out when the SSO might have occurred based on what they or others know? If you do this, can you tell us where this information is recorded?
11. We understand you may be instructed to take pictures of some sewer spills/backups into structures. Other than these SSOs, when else would you typically take any pictures of an SSO?
12. Please walk us through anything else you'd like to add to help us better understand how your field crews respond and mitigate SSO complaints.

14.2 SSO Response Drills

Periodic training drills or field exercises will be held to ensure that employees are up to date on these procedures, equipment is in working order, and the required materials are readily available. The training drills will cover scenarios typically observed during sewer related emergencies (e.g. mainline blockage, mainline failure, and lateral blockage). The results and the observations during the drills will be recorded and action items will be tracked to ensure completion.

14.3 SSO Training Record Keeping

Records will be kept of all training that is provided in support of this plan. The records for all scheduled training courses and for each overflow emergency response training event and will include date, time, place, content, name of trainer(s), and names and titles of attendees.

14.4 Contractors Working On City Sewer Facilities

All construction contractors working on City sewer facilities will be required to develop a project-specific OERP, will provide project personnel with training regarding the content of the contractor's OERP and their role in the event of an SSO, and to follow that OERP in the event that they cause or observe an SSO. Emergency response procedures shall be discussed at project pre-construction meetings, regular project meetings and after any contractor involved incidents.

All service contractors will be provided, and required to observe contractor procedures. See Appendix E: Contractor Orientation.

15. High Priority Assets

The following assets need to be monitored and inspected prior to, during, and following an extreme weather event or natural disaster:

Critical Asset	Location	Monitor and Inspection Description
Sellars Lift Station	3490 Sellars Avenue	Check wet well level, pump operation
Dreamcatcher Lift Station	1049 Pacific Grove Court	Check wet well level, pump operation

16. Authority

- Health & Safety Code Sections 5410-5416
- CA Water Code Section 13271
- Fish & Wildlife Code Sections 5650-5656
- State Water Resources Control Board Order No. 2006-0003-DWQ
- State Water Resources Control Board Order 2013-009-DWQ effective September 9, 2013

17. References

- Sanitary Sewer Overflow and Backup Response Field Guide, 2013, DKF Solutions Group, LLC
- Appendix A: Regulatory Notifications Packet
- Appendix B: Sanitary Sewer Backup Packet
- Appendix C: Sanitary Sewer Overflow Packet
- Appendix D: Field Sampling Kit
- Appendix E: Contractor Orientation
- Appendix F: Sewer Service Request Form

Appendix A
REGULATORY NOTIFICATIONS PACKET

Regulatory Notifications Packet

Instructions:

1. Receive call from on-site Collections Crew reporting a Sanitary Sewer Overflow.
2. Open this packet.
3. Refer to the Regulatory Reporting Guide for instructions.
4. Use the SSO Reporting Checklist (A-2) for the appropriate category of spill to document that all notifications are made according to the reporting schedule.

Contents:

<u>Form</u>	<u>Page Number</u>
Regulatory Reporting Guide	A-1
Reporting Checklists	-2

Print on 6"x9" envelope

Regulatory Notifications Packet
Regulatory Reporting Guide

Reporting Instructions

Deadline	See reverse side for definitions of the categories of spills of untreated or partially treated wastewater from publically owned sanitary sewer system			Spill from Private Lateral
	Category 1	Category 2	Category 3	
2 hours after awareness of SSO	<ul style="list-style-type: none"> If the SSO is greater than or equal to 1,000 gallons, call CalOES at (800) 852-7550. If there was any private property damage, contact the City Clerk 	If there was any private property damage, contact the City Clerk	If there was any private property damage, contact the City Clerk	-
48 Hours after awareness of SSO	If 50,000 gal or more were not recovered, begin water quality sampling and initiate impact assessment	-	-	-
3 Days after awareness of SSO	Submit Draft Spill Report in the CIWQS* database	Submit Draft Spill Report in the CIWQS* database	-	-
15 Days after response conclusion	Certify Spill Report in CIWQS*. Update as needed until 120 days after SSO end time	Certify Spill Report in the CIWQS* database. Update as needed until 120 days after SSO end time	-	-
30 Days after end of calendar month in which SSO occurred	-	-	Certify Spill Report in the CIWQS* database. Update as needed until 120 days after SSO end time	-
45 days after SSO end time	If 50,000 gal or more were not recovered, submit SSO Technical Report using CIWQS*	-	-	-

* In the event that the CIWQS online SSO database is not available, notify the State Water Resources Control Board (SWRCB) by phone or email until the CIWQS online SSO database becomes available: (See contact information on Side B)

Note: For reporting purposes, if one SSO event results in multiple appearance points, complete one SSO report in the CIWQS SSO Online Database, and report the location of the SSO failure point, blockage or location of the flow condition that caused the SSO, in the CIWQS SSO Online Database, including all the discharge points associated with the SSO event.

Regulatory Notifications Packet
Regulatory Reporting Guide

Contact Information:

Contact	Telephone/Email
CalOES	(800) 852-7550
City Clerk	(925) 516-5440
State Water Resources Control Board (SWRCB):	
Russell Norman, P.E.	(916) 323-5598 Russell.Norman@waterboards.ca.gov
Victor Lopez, Water Resources Control Engineer	(916) 323-5511 Victor.Lopez@waterboards.ca.gov

Authorized Personnel

The following personnel are authorized to perform regulatory reporting:

Job Title	Contact Information	✓ If LRO*
Wastewater Operations Manager	(925) 516-6070	✓
Collections Maintenance Worker II	(925) 428-0516	

*The City's Legally Responsible Official (LRs) is authorized to electronically sign and certify SSO reports in CIWQS

Definitions of Spill Categories

The response crew will complete the SSO Report form in the SSO Packet to document how the category was determined.

Category	Definition
Category 1:	Discharge of untreated or partially treated wastewater of any volume resulting from a sanitary sewer system failure or flow condition that either: <ul style="list-style-type: none"> • Reaches surface water and/or drainage channel tributary to a surface water; or • Reached a Municipal Separate Storm Sewer System (MS4) and was not fully captured and returned to the sanitary sewer system or otherwise captured and disposed of properly.
Category 2:	Discharge of untreated or partially treated wastewater greater than or equal to 1,000 gallons resulting from a sanitary sewer system failure or flow condition that either: <ul style="list-style-type: none"> • Does not reach surface water, a drainage channel, or an MS4, or • The entire SSO discharged to the storm drain system was fully recovered and disposed of properly.
Category 3:	All other discharges of untreated or partially treated wastewater resulting from a sanitary sewer system failure or flow condition

**Regulatory Notifications Packet
Category 1 SSO Reporting Checklist**

A-2a

Use this Checklist for Category 1 SSOs only

STEP 1: Receive call from crew.

STEP 2: 2-hour Notification

- If the spill is greater than or equal to 1,000 gallons, notify CalOES at (800) 852-7550 within 2 hours of the time the agency was notified of the spill.
 - o Date Called: _____
 - o Time Called: _____ : _____ AM PM
 - o CalOES Control Number: _____
- If there was any private property damage, contact the City Clerk at (925) 516-5440.

STEP 3: Within 48-Hours after awareness of SSO

- Only if 50,000 gallons or more was not recovered, implement Water Quality Monitoring Plan.

STEP 4: Within 3 Days after awareness of SSO

- Submit a Draft Spill Report using the CIWQS online reporting database.

STEP 5: Within 15 Days after response conclusion

- Certify the Spill Report using the CIWQS online reporting database. Updates to the Spill Report may be made for up to 120 days following the conclusion of the SSO Response.

STEP 6: Within 45 Days after SSO end time

- Within 45 days after the SSO end time, submit an SSO Technical Report using the CIWQS online reporting database only if 50,000 gallons or more was spilled to surface waters.

**Regulatory Notifications Packet
Category 2 & 3 SSO Reporting Checklist**

A-2b

Use this Checklist for Category 2 and 3 SSOs only

STEP 1: Receive call from crew.

STEP 2: 2-hour Notification

- If there was any private property damage, contact the City Clerk at (925) 516-5440.

STEP 2: Submit Draft Spill Report (Category 2 only)

- Submit a Draft Spill Report using the CIWQS online reporting database within 3 days after awareness of Category 2 SSO.

STEP 3: Certify Spill Report

- Certify the Spill Report using the CIWQS online reporting database:
 - Category 2 SSO: Within 15 days after the conclusion of the response
 - Category 3 SSO: Within 30 days after the end of the calendar month in which the SSO occurred
- Updates to the Spill Report may be made for up to 120 days following the conclusion of the SSO Response.

Appendix B

SANITARY SEWER BACKUP RESPONSE PACKET

**Sanitary Sewer Backup Response Packet
Table of Contents**

<u>Form</u>	<u>Form Number</u>
Instructions and Chain of Custody	envelope label
Backup Response Flowchart.....	B-1
Bubbled Toilets Letter	-2
First Responder Form.....	-3
Declination of Sewage Cleaning Services.....	-4
Lodging Authorization Form	-5
Sewer Overflow Report	-6
Start Time Determination	7
Volume Estimation Forms	-8a, -8b, -8c
Lateral CCTV Report.....	-9
Claims Submittal Checklist.....	-10
Collection System Failure Analysis Form.....	-11
Customer Service Packet	
Instructions	envelope
Customer Information	CS-1
Claim Form	-2
Sewer Spill Reference Guide	pamphlet
Regulatory Notifications Packet	
Instructions	envelope
Regulatory Reporting Guide	A-1
Category 1 SSO Reporting Checklist	-2a
Category 2 & 3 SSO Reporting Checklist.....	-2b
Door Hanger	
Sewer Spill Reference Guide Pamphlet	

For pre-assembled packets contact DKF Solutions Group at (707) 373.9709 or losscontrol@sbcglobal.net

In the event of a Sewer Backup into a home/business READ THIS FIRST



- If this is a Category 1 SSO greater than or equal to 1,000 gallons, IMMEDIATELY contact CalOES at (800) 852-7550 within 2 hours of the City's awareness of the SSO

- If the backup is into/onto private property and possibly due to a problem in the public sewer, notify Michael Groff, MPA Liability Claims Manager, at (925) 943-1100 ext. 11

- If instructed to call out a cleaning contractor, contact one of the following:
 Restoration Management Company (Benicia): (209) 547-2220
 Paul Davis: (925) 516-0120

- For any media requests contact:
 Public Information Officer, Captain Tom Hansen, at (925) 634-6911

Don't forget photos!



Collections Crew:

- Follow the instructions on the Sewer Backup Response Flowchart (B-1).
 Note: If multiple dwelling units are affected, use one packet per unit and check here:

- If indicated on the flowchart, give the customer the Bubbled Toilets Letter and/or the Customer Service Packet and have them initial here:
Customer acknowledgement of receipt of Bubbled Toilets Letter: _____
Customer acknowledgement of receipt of Customer Service Packet: _____

- Place completed forms in this envelope, complete the Chain of Custody record (right) and forward this packet to the Wastewater Operations Manager.

Print Name: _____

Initial: _____

Date: _____

Time: _____

Wastewater Operations Manager:

- Follow the instructions on the bottom of the Sewer Backup Response Flowchart (B-1).
- Complete the Regulatory Notifications Packet.
- Complete the Claims Submittal Checklist.
- Complete the Chain of Custody record (right) and forward this packet to the City Clerk.

Print Name: _____

Initial: _____


Date: _____

Time: _____

City Clerk:

- Refer to the Claims Submittal Checklist.

Sanitary Sewer Backup Response Packet
Backup Response Flowchart

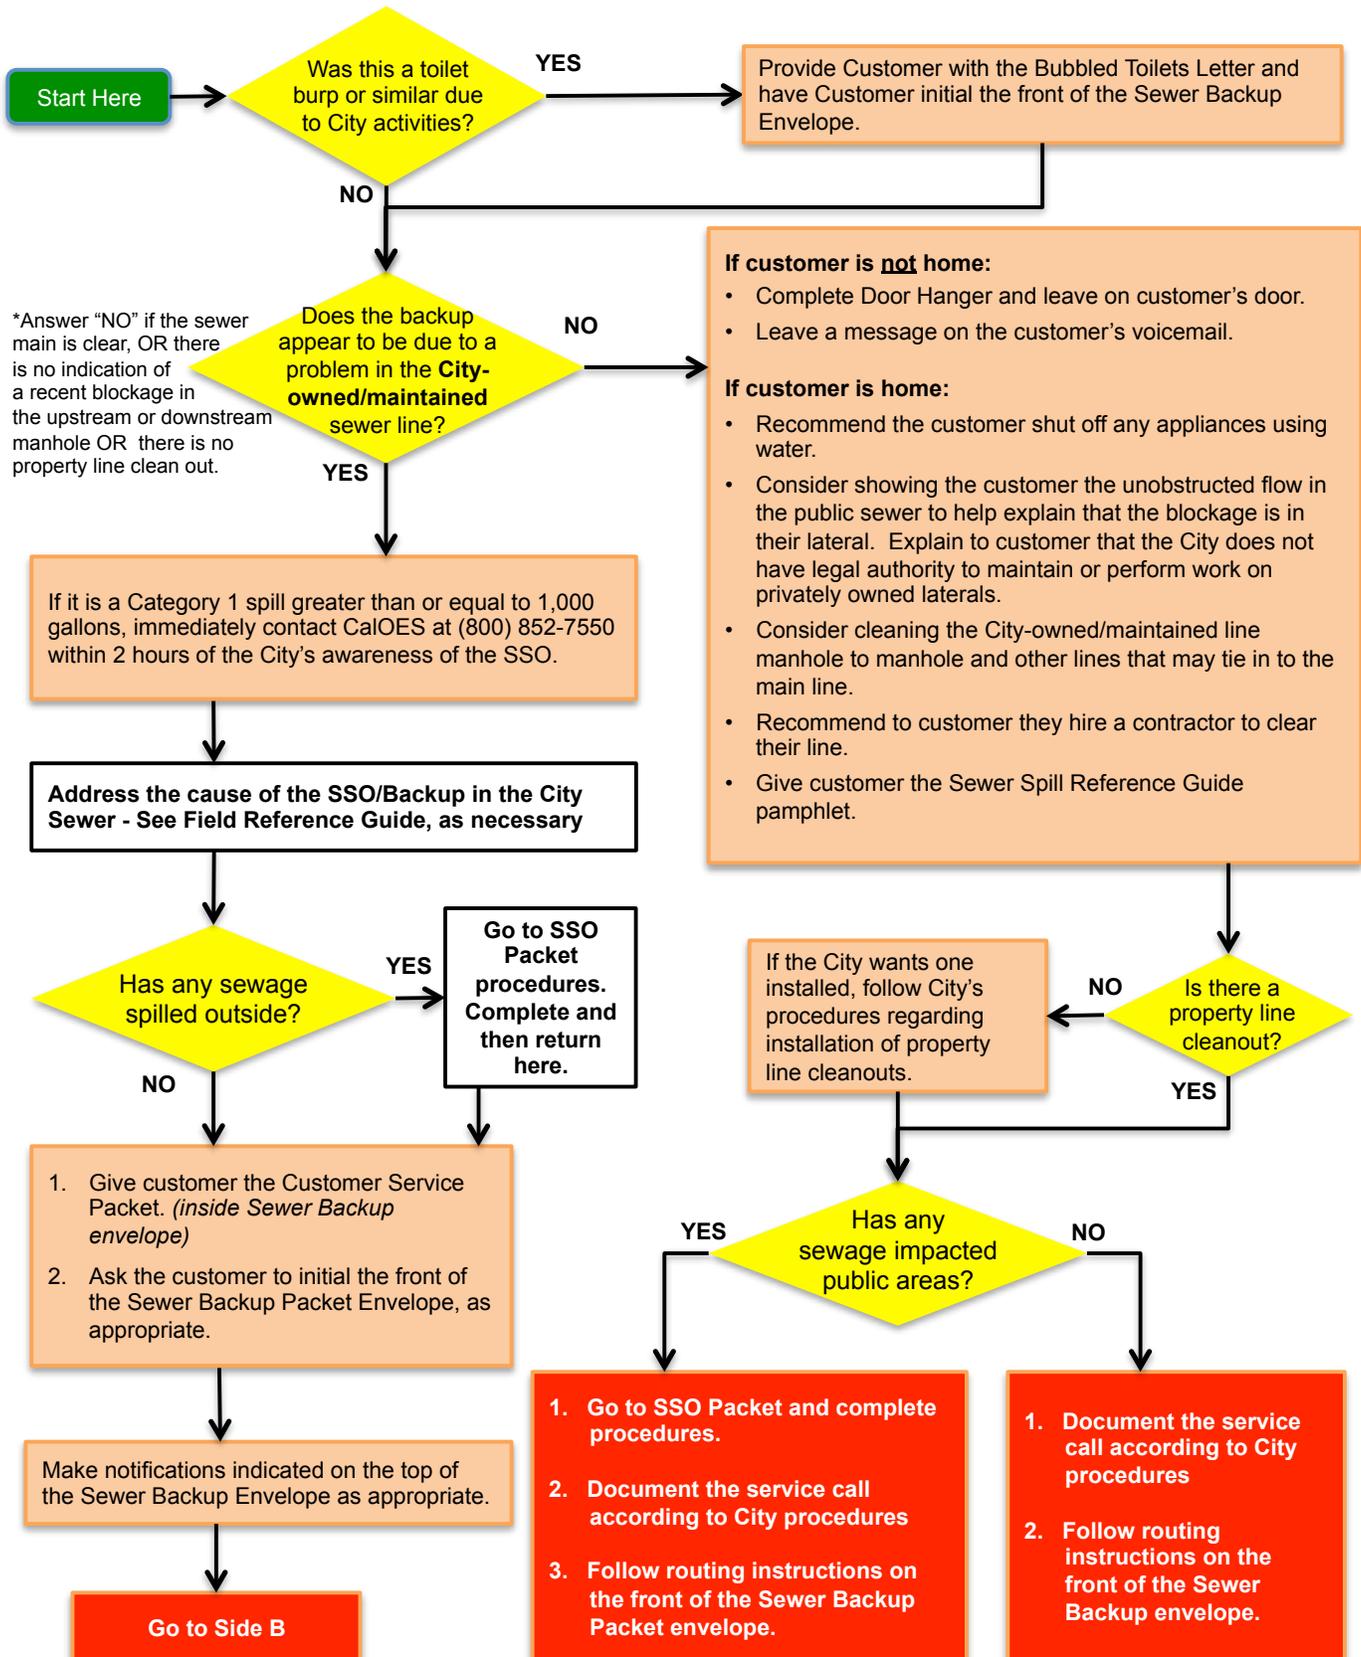

Sanitary Sewer Backup Response Packet
Backup Response Flowchart

Continue Here From Side A

1. Remove the First Responder Form from the Sewer Backup Packet envelope and complete. Immediately contact Michael Groff, MPA Liability Claims Manager, at (925) 943-1100 ext. 11 and provide the information from the completed First Responder Form including the following:

- Indicate whether the livability assessment indicates that temporary relocation is advised. If so, complete the Lodging Authorization form.
- Indicate whether the the Customer wants cleaning services. If not, complete the Declination of Sewage Cleaning Services form.

If instructed to do so, or if Michael Groff is not available, contact a restoration/remediation contractor (see envelope for contact information) and/or arrange for temporary lodging.

2. Ask Customer to take photographs of affected and non-affected areas, if allowed by customer. Try to get pictures showing where the damaged areas stopped.

Complete the following forms (in the Sewer Backup Envelope):

- Sanitary Sewer Overflow Report
- Start Time Determination Form (Remember, the spill was probably already occurring before it was reported.)
- Volume Estimation (Use one or more worksheets and/or methods listed in the Field Guide.)

Clean/disinfect any overflow outside of the building. **DO NOT** allow any disinfectants to escape to storm drains.

Photograph the backwater prevention device or cleanout.

YES Can you locate a backwater prevention device (BPD) or cleanout on the affected building?

NO

Complete Lateral CCTV Report (inside the Sewer Backup Packet envelope)

YES Is there any reason to have the lateral televised?

NO

1. Document the service call according to City procedures.
2. Complete the remaining instructions in the Collections Crew box on the front of the Sewer Backup Packet envelope.
3. Follow routing instructions as indicated on the front of the Sewer Backup Packet envelope.

MEDIA AND PUBLIC RELATIONS GUIDELINES:

Exercise caution in contacts with the public or media when you respond to a spill. Any information you provide or statements you make may become pertinent in the event of possible court action, it is important to **AVOID THE FOLLOWING:**

- Giving out the wrong information,
- Providing incorrect facts about a company or other agency
- Speculating about the situation you are responding to
- Making accusations against customers, businesses or other agencies

Be courteous and attempt to provide accurate information to questions within the limits above. In some cases, it may be appropriate to say that we do not have any information, or to delay answering a question and then to say when an answer might be available.

In most cases, refer media requests to the media coordinator indicated on the front of the Sewer Overflow Packet envelope.

**Sanitary Sewer Backup Response Packet
Bubbled Toilets Letter**

Dear City of Brentwood Customer,

Thank you for informing us that your toilet bubbled while our crews were working in proximity of your property. We apologize for the inconvenience and hope that this letter will answer some of your questions about bubbling toilets.

1. Is this a health risk?

The water that came out of your toilet is potable water from the toilet bowl. Unless your toilet was in use when this occurred, this water is no different than that encountered while cleaning your toilet.

2. What is the City doing in the street?

In order to insure reliable sewer service, the City inspects, cleans, and repairs its sewer system on a continuous basis.

3. How does sewer cleaning cause my toilet to bubble?

Typical industry cleaning equipment uses high-pressure water to clean sewers. The first step is to use the high-pressure water jets to propel the hose and cleaning nozzle upstream as far as 800 feet. During this process, air within the main pipe is displaced and sometimes goes up the private lateral pipe and releases through the toilet. This can also happen during the cleaning phase, when high-pressure water is pulled downstream to the cleaning truck.

4. What causes the air to come from my toilet?

Over the years, City crews have found that the bubbling of toilets have many causes, some of which are:

- Obstructed vent pipes;
- Vent pipes that are positioned too far from the toilet;
- Lateral pipes that may be in use as the crew is cleaning (e.g. draining washing machine, draining bathtub, etc.);
- Lateral pipes that may have obstructions that are causing them to hold water (e.g. roots, grease, etc.).

5. What does City staff do, once informed of a bubbling toilet?

Once notified of a bubbling toilet, the crew leader explains to the customer what has happened, and checks to see if there is a clean-out in the customer's yard that could be opened in the future during cleaning.

6. What can I do to prevent my toilet from bubbling?

When a sewer begins to drain slowly, it may be a sign that it needs to be cleaned or repaired. Trees and shrubs may have root structures that are entering the lateral pipe. The homeowner needs to make sure to have a clean-out for accessing the line. Unless there is a cleanout on the property line, it is the homeowner's responsibility to keep the sewer lateral pipe in good working condition. **The City also recommends the homeowner install a back-flow prevention device to prevent bubbling or sewer back-ups into the home.**

It is always a good idea to keep the toilet lid down when not in use, and not install carpets in the bathroom unless they can be easily removed and cleaned. For more information, please call the Wastewater Operations Manager at (925) 516-6060.

Sincerely,

City of Brentwood Public Works

Sanitary Sewer Backup Response Packet
Carta de Inodoros Burbujeados

Estimado Cliente de la Ciudad de Brentwood:

Gracias por habernos informado que su lavabo burbujeó mientras que nuestros empleados estaban trabajando en proximidad a su propiedad. Le pedimos perdón por la inconveniencia y esperamos que esta carta le contestará algunas de sus preguntas acerca de inodoros burbujeantes.

1. ¿Es riesgo de salud esto?

El agua que salió de su inodoro es agua potable de la taza del inodoro. Menos que su inodoro estaba en uso cuando esto ocurrió, esa agua no es diferente de aquella encontrada mientras que limpia su inodoro.

2. ¿Qué está haciendo la Ciudad en la calle?

Para asegurar servicio de alcantarilla confiable, la Ciudad inspecciona, limpia, and repara su Sistema de alcantarillado en una forma continua.

3. ¿Cómo causa la limpieza de la alcantarilla que burbujee mi inodoro?

El equipamiento industrial de limpieza típico usa agua de alta presión para limpiar alcantarillas. La primer medida es de usar chorros de agua de alta presión para propulsar a la manguera y a la boquilla de limpieza contracorriente tan lejos como ochocientos (800) pies. Durante este proceso, el aire dentro la tubería principal es desplazada y a veces camina para arriba de la tubería lateral privada y se libera por el inodoro. Esto también puede ocurrir durante la fase de limpieza, cuando agua de alta presión es jalada corriente abajo al camión de limpieza.

4. ¿Qué causa al aire que venga de mi inodoro?

A lo largo de los años, los empleados de la Ciudad han encontrado que el burbujeo de inodoros tiene muchas causas, algunas de cuales son:

- Tubería de ventilación obstruida;
- Tubería de ventilación que está posicionada muy lejos del inodoro;
- Tubería lateral que pueda estar en uso mientras que los empleados estén limpiando (por ej., vaciando la máquina de lavar, vaciando el baño, etcétera);
- Tubería lateral que podrá tener obstrucciones que están causándola a contener agua (por ej., raíces, grasa, etcétera).

5. ¿Qué hace el personal de la Ciudad, una vez informados de un inodoro burbujeante?

Una vez notificado de un inodoro burbujeante, el líder de nuestros empleados le explica al cliente lo que ha ocurrido, y hace un chequeo para ver si hay una limpieza general en el patio del cliente que se pudiera abrir en el futuro durante la limpieza.

6. ¿Qué puede hacer para impedir a mi inodoro de burbujeando?

Cuando una alcantarilla empieza a desaguar lentamente, puede que sea un indicio que se necesita limpiar o reparar. Puede que los árboles y arbustos tengan estructuras de raíces que estén entrando a la tubería lateral. El dueño/la dueña de casa necesita asegurar de tener una limpieza general para acceder la línea. Es la responsabilidad del dueño/la dueña de mantener la tubería de alcantarilla lateral en buena condición operativa.

Siempre es buena idea de mantener la tapa del inodoro bajada cuando no esté el inodoro en uso, y no instalar alfombra en el cuarto de baño menos que esa se pueda quitar y limpiar. Para obtener más información, por favor llame al Gerente de Operaciones de Aguas Residuales al (925) 516-6060.

Atentamente,
La Ciudad de Brentwood

**Sanitary Sewer Backup Response Packet
First Responder Form**

**B-3
Side A**

Fill out this form as completely as possible.
Ask customer if you may enter the home. If so, take photos of damaged and undamaged areas.


PERSON COMPLETING THIS FORM:		PHONE:
		DATE:
		TIME:
TIME STAFF ARRIVED ON-SITE:		
DID CUSTOMER CALL CLEANING CONTRACTOR? <input type="checkbox"/> Yes <input type="checkbox"/> No If YES, name of contractor:		
RESIDENT:	PROPERTY MANAGERS: OWNER/TENANT:	
STREET ADDRESS:	STREET ADDRESS:	
CITY, STATE AND ZIP:	CITY, STATE AND ZIP:	
PHONE:	PHONE:	
IS NEAREST UPSTREAM MANHOLE VISIBLY HIGHER THAN THE DRAIN THAT OVERFLOWED? <input type="checkbox"/> Yes <input type="checkbox"/> No		
# OF PEOPLE LIVING AT RESIDENCE:		
Approximate Age of Home:	# of Bathrooms:	# of Rooms Affected:
Approximate Amount of Spill (gallons):	Approximate Time Sewage Has Been Sitting (hrs/days):	
Numbers of Pictures Taken	Digital or Film?	
Does property have a Property Line Cleanout?	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> Unknown	
Does the Customer have a Backwater Prevention Device (BPD)?	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> Unknown	
If yes, was the BPD operational at the time of the overflow?	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> Unknown	
Have there ever been any previous spills at this location?	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> Unknown	
Has the resident had any plumbing work done recently? <i>If YES, please describe:</i>	<input type="checkbox"/> YES <input type="checkbox"/> NO	

GO TO SIDE B

**Sanitary Sewer Backup Response Packet
First Responder Form**

**B-3
Side B**

LIVABILITY ASESMENT

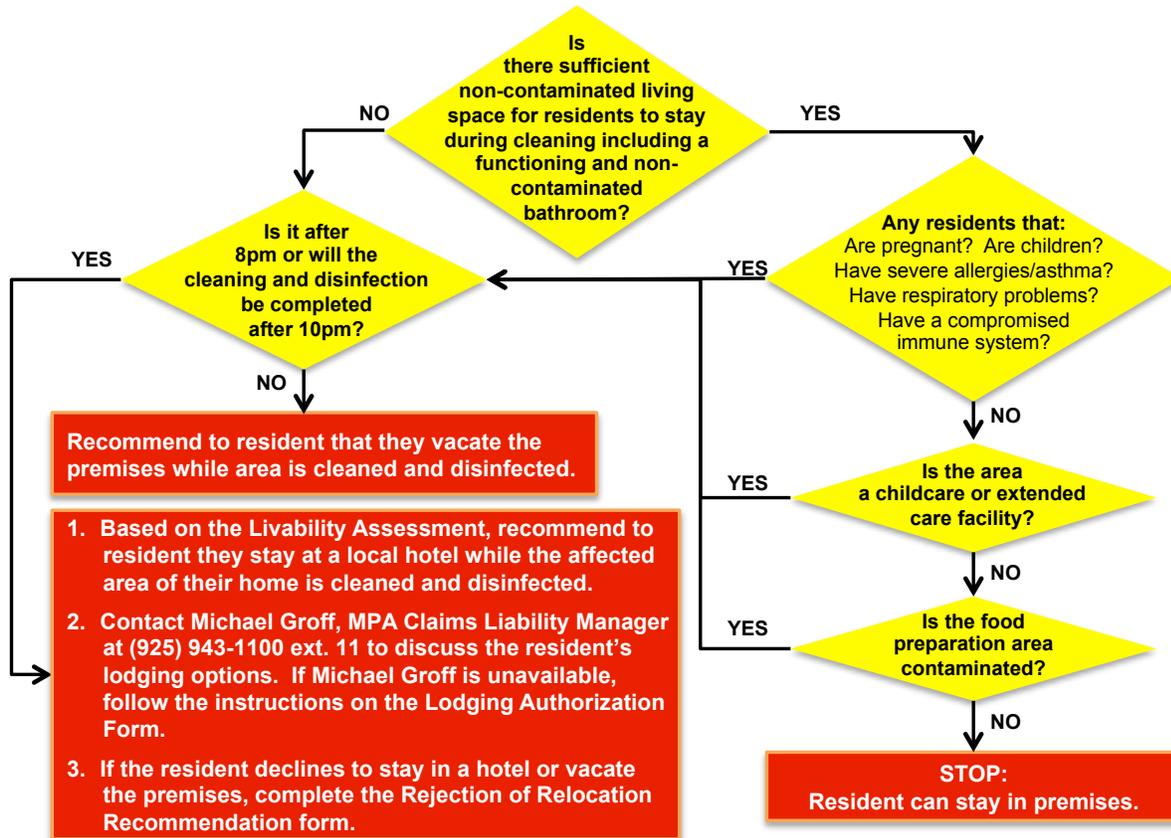

SANITARY SEWER LINE BLOCKAGE LOCATION

PLEASE CHECK THE BOXES THAT DESCRIBE YOUR OBSERVATIONS:

- | | |
|---------------------------------------|---------------------------------------|
| Customer Cleanout Was: | Public Cleanout was: |
| <input type="checkbox"/> Non-Existent | <input type="checkbox"/> Non-Existent |
| <input type="checkbox"/> Full | <input type="checkbox"/> Full |
| <input type="checkbox"/> Empty | <input type="checkbox"/> Empty |

On the diagram below, indicate the location of the sewer line and where the problem occurred.

Affected House

Upstream House

Recommended Follow-Up Action(s):

Did sewage go under buildings? Yes No Unsure

Place completed form in Sewer Backup Envelope and follow routing instructions

**Sanitary Sewer Backup Response Packet
Declination of Sewage Cleaning Services**

Customer Information

NAME:	ADDRESS:	TELEPHONE:
-------	----------	------------

ON (date)	AT (time)	Approximately (quantity)	GALLONS OF: <input type="checkbox"/> Sewage <input type="checkbox"/> Grey Water <input type="checkbox"/> Toilet Bowl Water <input type="checkbox"/> Odor <input type="checkbox"/> Other (describe):
---------------------	---------------------	------------------------------------	--

Overflowed from (or odor emanating from) <input type="checkbox"/> Toilet <input type="checkbox"/> Shower/Tub <input type="checkbox"/> Washer <input type="checkbox"/> Other (describe):	The overflow affected the following areas (check one): <input type="checkbox"/> Bathroom <input type="checkbox"/> Bedroom <input type="checkbox"/> Hallway <input type="checkbox"/> Garage <input type="checkbox"/> Kitchen <input type="checkbox"/> Crawlspace <input type="checkbox"/> Other (specify):
--	--

The overflow affected the following flooring: <input type="checkbox"/> Tile <input type="checkbox"/> Wood Flooring <input type="checkbox"/> Linoleum <input type="checkbox"/> Carpet <input type="checkbox"/> Other (specify):	and/or additional materials: <input type="checkbox"/> Area Rugs <input type="checkbox"/> Towels <input type="checkbox"/> Clothing <input type="checkbox"/> Other (specify):
--	--

Were photos taken?: Yes No If yes, where are photos stored?

This Form Completed By: (Write legibly)	Name: _____	Date: _____
	Title: _____	Time: _____

CUSTOMER, please read the following and sign below:
 I/We acknowledge that City of Brentwood (City) has offered to provide professional cleaning and decontamination services to remediate the sewage backup and/or overflow described above and that we declined the offer. We further understand and acknowledge that because we have declined, any necessary remediation activities will be conducted without City assistance, and that the City will not accept responsibility for work performed by persons other than those engaged by the City. The City will also not accept responsibility for any charges related to this incident that are not usual and customary. Please refer to the Customer Service Packet for whom to contact if you have any questions.

Customer Signature*:	Date:
The information above was explained to the customer by the following employee:	Name:
	Title:
	Signature:
	Date:

**Note to responders: if customer declines to sign this form, then have a co-worker sign here as a witness:*
 Name: _____ Signature: _____ Date: _____

Recommendations to customer to clean up the spill:

- Keep pets and children out of the affected area
- Turn off heating/air conditioning systems
- Wear rubber boots, rubber gloves, and goggles during cleanup of the affected area.
- Remove and discard items that cannot be washed and disinfected (such as: mattresses, rugs, cosmetics, baby toys, etc.)
- Remove and discard drywall and insulation that has been contaminated with sewage or flood waters.
- Thoroughly clean all hard surfaces (such as flooring, concrete, molding, wood and metal furniture, countertops, appliances, sinks and other plumbing fixtures) with hot water and laundry or dish detergent.
- Help the drying process with fans, air conditioning units, and dehumidifiers.
- After completing cleanup, wash your hands with soap and water. Use water that has been boiled for 1 minute (allow water to cool before washing your hands.) OR use water that has been disinfected (solution of 1/8 teaspoon of household bleach per 1 gallon of water). Let it stand for 30 min. If water is cloudy, use ¼ teaspoon of household bleach per 1 gallon of water.
- Wash all clothes worn during the cleanup in hot water and detergent (wash separately from uncontaminated clothes).
- Wash clothes contaminated with flood or sewage water in hot water and detergent. Use a laundromat for washing large quantities of clothes and linens until your onsite wastewater system has been professionally inspected and serviced.
- Seek immediate attention if you become injured or ill.

**Sanitary Sewer Backup Response Packet
Lodging Authorization Form**

INSTRUCTIONS TO EMPLOYEE:

1. Contact Michael Groff, MPA Liability Claims Manager at (925) 943-1100 ext. 11 to discuss the resident's lodging options. If Michael Groff is unavailable, contact the Wastewater Operations Manager to arrange for one night's lodging for the Resident.
2. Review this form with the customer and instruct them to read the Instructions to Resident section below.
3. Instruct the customer that this emergency authorization is for **LODGING ONLY – NO FOOD, MINIBAR, MOVIE, PHONE or Other Charges**.
4. Explain to customer that if circumstances require additional nights' lodging and other incidentals, the City's Claims Manager will address them.
5. Have the customer sign the Acknowledgement section of this form.
6. Complete this Authorization Form and sign.
7. Give the bottom copy of this form to the customer.

INSTRUCTIONS TO RESIDENT: The City of Brentwood recommends that you temporarily relocate to a local hotel for your safety and convenience while your residence is being cleaned. Please note that this emergency authorization is granted under the following conditions:

1. This authorization provides for one (1) nights' lodging at the hotel selected below.
2. The authorization is good for **room and tax ONLY**.
3. Additional nights, other allowances, and special circumstances may be discussed by contacting the City's Claims Manager at (925) 943-1100 ext. 11.

CUSTOMER ACKNOWLEDGEMENT:

I/we have read and understood the terms and conditions governing this offer of temporary relocation and agree to abide by them as described above.

Customer Name (please print): _____

Customer Address: _____

Phone # where customer may be reached: _____

Customer Signature: _____ Date: _____

Check here to decline this offer of temporary relocation. Customer Signature: _____

Good for one (1) night's stay on (date): _____ Number of affected residents: _____

City of Brentwood Representative's Name: _____ Phone Number: _____

<p>Holiday Inn Express 8820 Brentwood Blvd Brentwood, CA 94513 Phone: (925) 634-6400</p>	<p>La Quinta Inn 7700 Southfront Road Livermore, CA 94550 Phone: (925) 373-9600</p>	<p>Hampton Inn 7605 Brentwood Blvd. Brentwood, CA 94513 Phone: (925) 513-1299</p>
---	--	--

Sanitary Sewer Backup Response Packet
Sanitary Sewer Overflow Report

INSTRUCTIONS: Complete all items EXCEPT those that are shaded gray

SSO Category (check one):

- Category 1: Discharge of untreated or partially treated wastewater of any volume resulting from a sanitary sewer system failure or flow condition that either (1) Reaches surface water and/or drainage channel tributary to a surface water; OR (2) Reached a Municipal Separate Storm Sewer System (MS4) and was not fully captured and returned to the sanitary sewer system or otherwise captured and disposed of properly.
- Category 2: Discharge of untreated or partially treated wastewater greater than or equal to 1,000 gallons resulting from a sanitary sewer system failure or flow condition that either (1) Does not reach surface water, a drainage channel, or an MS4, OR (2) The entire SSO discharged to the storm drain system was fully recovered and disposed of properly.
- Category 3: All other discharges of untreated or partially treated wastewater resulting from a sanitary sewer system failure or flow condition
- Spill from Private Lateral (specify): Single Family Home Multi-Family Home High Density Residential (5+ units)
 Food Service Establishment (FSE) Mixed Use Property Industrial Property Commercial Property
 Public quasi-public institution (hospital, schools, fire department, etc.)

IMMEDIATE NOTIFICATION: If this is a Category 1 SSO ≥1,000 gallons, contact CalOES within 2 hours at (800) 852-7550.

A. SSO LOCATION		
SSO Location Name:		
Latitude Coordinates:	Longitude Coordinates:	
Street Name and Number:		
Nearest Cross Street:	City:	Zip Code:
SSO Location Description:		

B. SSO OCCURRING TIME (complete Start Time Determination Form and then complete information below)	
Estimated SSO start date:	Estimated SSO start time:
Date SSO reported to sewer crew:	Time SSO reported to sewer crew:
Date sewer crew arrived:	Time sewer crew arrived:
Who was interviewed to help determine start time?	
Estimated SSO end date:	Estimated SSO end time:

C. SSO DESCRIPTION (Complete Volume Estimation Worksheets and/or refer to Field Guide as needed for estimations.)	
SSO Appearance Point (check one or more): <input type="checkbox"/> Combined Sewer D.I. (Combined CS Only) <input type="checkbox"/> Force Main <input type="checkbox"/> Gravity Mainline <input type="checkbox"/> Lateral Cleanout (Private) <input type="checkbox"/> Lateral Cleanout (Public) <input type="checkbox"/> Inside Building or Structure <input type="checkbox"/> Manhole <input type="checkbox"/> Pump Station <input type="checkbox"/> Lower Lateral (Private) <input type="checkbox"/> Lower Lateral (Public) <input type="checkbox"/> Upper Lateral (Private) <input type="checkbox"/> Upper Lateral (Public) <input type="checkbox"/> Other Sewer System Structure (specify):	
Were there multiple appearance points? <input type="checkbox"/> No <input type="checkbox"/> Yes, number of appearance points:	
Did the SSO reach a drainage channel and/or surface water? <input type="checkbox"/> Yes (Category 1) <input type="checkbox"/> No	
If the SSO reached a storm sewer, was it fully captured and returned to the Sanitary Sewer? <input type="checkbox"/> Yes <input type="checkbox"/> No (Category 1)	
Was this spill from a private lateral? <input type="checkbox"/> Yes <input type="checkbox"/> No If YES, name of responsible party:	
Final Spill Destination:	<input type="checkbox"/> Surface waters other than ocean <input type="checkbox"/> Drainage channel <input type="checkbox"/> Building/structure <input type="checkbox"/> Separate Storm drain <input type="checkbox"/> Paved surface <input type="checkbox"/> Unpaved surface <input type="checkbox"/> Street/curb/gutter <input type="checkbox"/> Other:
Total Estimated SSO volume (in gallons – 1,000gal or more = Category 1): gallons	
Est. volume that reached a separate storm drain that flows to a surface water body:	gal Recovered: gal
Est. volume that reached a drainage channel that flows to a surface water body:	gal Recovered: gal
Est. volume discharged directly to a surface water body:	gal Recovered: gal
Est. volume discharged to land:	gal Recovered: gal
Calc. Methods: <input type="checkbox"/> Eyeball <input type="checkbox"/> Photo Comparison <input type="checkbox"/> Upstream Lat. Connections <input type="checkbox"/> Area/Volume (include sketch/photo with dimensions) <input type="checkbox"/> Other (describe):	

* If multiple appearance points, use the GPS coordinates for the location of the SSO appearance point closest to the failure point/blockage.

Sanitary Sewer Backup Response Packet
Sanitary Sewer Overflow Report

D. CAUSE OF SSO

Where did failure occur? (Check all that apply): Air Relief or Blow-Off Valve Force Main Gravity Mainline
 Lower Lateral (public) Lower Lateral (private) Manhole Pump Station (specify): Controls Mechanical Power
 Upper Lateral (public) Upper Lateral (private) Other:

SSO cause (check all that apply): Construction Diversion Failure CS Maintenance Damage by others
 Debris (specify): from Construction from Lateral General Rags Flow Exceeded Capacity
 FROG (Fats, roots, oil, grease) Inappropriate Discharge Natural Disaster Operator Error Root Intrusion
 Pipe Structural Problem/Failure Pipe Structural Problem/Failure (Installation) Rainfall Exceeded Design
 Pump Station Failure (specify): Controls Mechanical Power Vandalism
 Surcharged Pipe Non - Dispersible Wipes Other (specify):

Diameter (in inches) of pipe at point of blockage/spill cause (if applicable):

Sewer pipe material at point of blockage/spill cause (if applicable):

Estimated age of sewer asset at the point of blockage or failure (if applicable):

Description of terrain surrounding point of blockage/spill cause: Flat Mixed Steep

E. SSO RESPONSE

SSO response activities (check all that apply): Cleaned-Up Mitigated Effects of Spill Contained All or Portion of Spill
 Restored Flow Returned All Spill to Sanitary Sewer System Returned Portion of Spill to Sanitary Sewer System
 Property Owner Notified Other Enforcement Agency Notified (specify) Other (specify):

SSO response completed (date & time):

Visual inspection result of impacted waters (if applicable):

Any fish killed? Yes No Any ongoing investigation? Yes No

Were health warnings posted? Yes No If yes, provide health warning/beach closure posting/details:

Were samples of impacted waters collected? Yes No

If YES, select the analyses: DO Ammonia Bacteria pH Temperature Other:

Recommended corrective actions: (check all that apply and provide detail)

- Add sewer to preventive maintenance program
- Adjust schedule/method of preventive maintenance
- Enforcement action against FROG source
- Inspect Sewer Using CCTV to Determine Cause
- Plan rehabilitation or replacement of sewer
- Repair Facilities or Replace Defect
- Other (specify)

What major equipment was used in the response?

List all agency personnel involved in the response including name, title and their role in the response:

F. NOTES

G. NOTIFICATION DETAILS

CalOES contacted date and time (if applicable):

CalOES Control Number (if applicable):

Spoke to:

This form prepared by: NAME: TITLE: DATE:

This form reviewed by: NAME: TITLE: DATE:

Place completed form in Sewer Backup Envelope and follow routing instructions.

**Sanitary Sewer Backup Response Packet
Start Time Determination Form**

SSO Start Date: _____ Location: _____

Accurate start time determination is an essential part of SSO volume estimation. Depending on the flow rate, being even one minute off can have a huge impact on the volume estimation. Be as precise as possible. Do not round to quarter hour increments. Start time must be based on all available information (interviews with neighbors, emergency responders, etc.)

What time was the City notified of the SSO? _____ AM PM

Who notified the City? _____

Did they indicate what time they noticed the SSO? YES NO If yes, what time? _____ AM PM

Who at the City received the notification? _____

What time did the crew arrive at the site of the SSO? _____ AM PM

Who was interviewed regarding the start time of the SSO? Include their name, contact information, and the statement they provided:

Name	Contact Information	Statement
_____	_____	_____
_____	_____	_____
_____	_____	_____
_____	_____	_____

Describe in detail how you determined the start time for this particular SSO:

SSO Start Date: _____ SSO Start Time: _____ AM PM

SSO End Date: _____ SSO End Time: _____ AM PM

SSO Duration: _____ **minutes**

This form completed by:

Name: _____ Signature: _____

Job Title: _____ Date: _____

**Sanitary Sewer Backup Response Packet
Volume Estimation: Eyeball Estimation Method**

Use this method only for small SSOs of less than 200 gallons.

SSO Date: _____ Location: _____

- STEP 1: Position yourself so that you have a vantage point where you can see the entire SSO.
- STEP 2: Imagine one or more buckets or barrels of water tipped over. Depending on the size of the SSO, select a bucket or barrel size as a frame of reference. It may be necessary to use more than one bucket/barrel size.
- STEP 3: Estimate how many of each size bucket or barrel it would take to make an equivalent spill. Enter those numbers in Column A of the row in the table below that corresponds to the bucket/barrel sizes you are using as a frame of reference.
- STEP 4: Multiply the number in Column A by the multiplier in Column B. Enter the result in Column C.

	A	B	C
Size of bucket(s) or barrel(s)	How many of this size?	Multiplier	Estimated SSO Volume (gallons)
1 gallon water jug		x 1 gallons	
5 gallon bucket		x 5 gallons	
32 gallon trash can		x 32 gallons	
55 gallon drum		x 55 gallons	
Other: _____ gallons		x _____ gallons	
Estimated Total SSO Volume:			

STEP 5: Is rainfall a factor in the SSO? Yes No
 If yes, what volume of the observed spill volume do you estimate is rainfall? _____ gallons
 If yes, describe how you determined the amount of rainfall in the observed spill?

STEP 6: Calculate the estimated SSO volume by subtracting the rainfall from the SSO volume:
 _____ gallons – _____ gallons = _____ gallons
 Estimated SSO Volume Rainfall **Total Estimated SSO Volume**

Do you believe that this method has estimated the entire SSO? Yes No
 If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:
 Name: _____ Signature: _____
 Job Title: _____ Date: _____

Sanitary Sewer Backup Response Packet
Volume Estimation: Duration and Flow Rate Comparison Method

SSO Date: _____ Location: _____

STEP 1: Compare the SSO to reference images on Side 2 to estimate flow rate of the current overflow. Describe which reference photo(s) were used and any additional factors that influenced applying the reference photo data to the actual SSO:

Flow Rate Based on Photo Comparison: _____gallons per minute (gpm)

STEP 2: Complete the **Start Time Determination Form** to provide a detailed description of how start time was determined. Copy the SSO Duration from the Start Time Determination Form here:

SSO Duration: _____minutes

STEP 3: Multiply the flow rate by the SSO duration to calculate the estimated SSO volume.

$$\frac{\text{_____ gpm}}{\text{Flow Rate}} \times \frac{\text{_____ minutes}}{\text{SSO Duration}} = \frac{\text{_____ gallons}}{\text{Estimated SSO Volume}}$$

STEP 4: Did the SSO occur during a period of consistent flow in this portion of the system? Yes No
If no, explain how, based on this portion of the collection system and its users, you believe it may have impacted the estimated SSO volume:

By what percentage are you adjusting the estimation? increase decrease _____%

Translate the percentage into gallons: _____gallons

STEP 5: Calculate the adjusted SSO volume estimate:

$$\frac{\text{_____ gallons}}{\text{Estimated SSO Volume}} + \text{OR} - \frac{\text{_____ gallons}}{\text{Adjustment}} = \frac{\text{_____ gallons}}{\text{Estimated SSO volume}}$$

Do you believe that this method has estimated the entire SSO? Yes No
If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:

Name: _____ Signature: _____
Job Title: _____ Date: _____



Sanitary Sewer Backup Response Packet
Volume Estimation: Duration and Flow Rate Comparison Method

IMPORTANT NOTE:

These photographs are provided as examples only and will change with many factors.

SSCSC Manhole Overflow Gauge

CWEA Southern Section Collections Systems Committee
Overflow Simulation courtesy of Eastern Municipal Water District

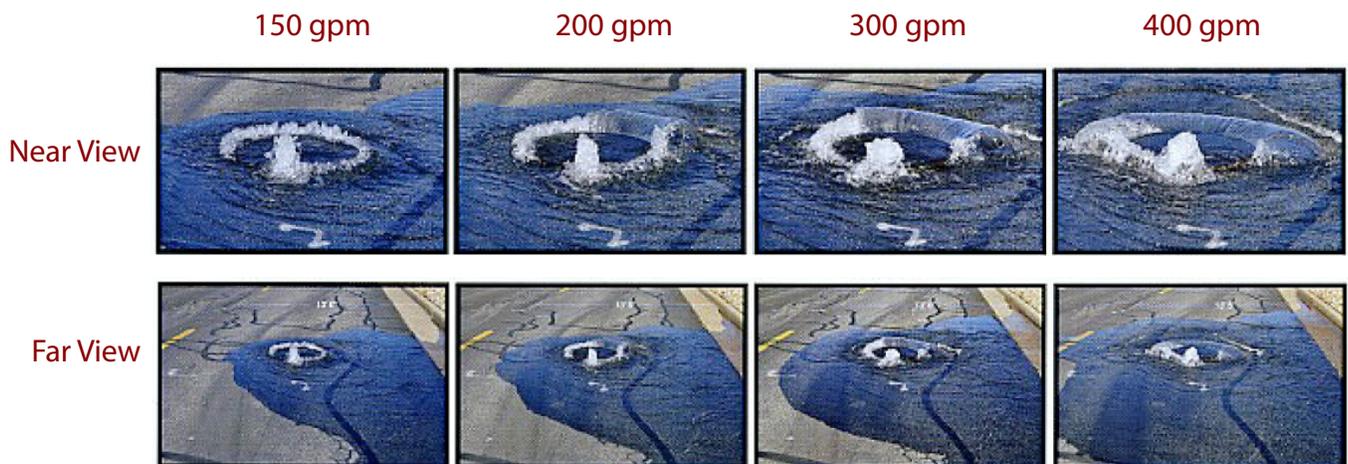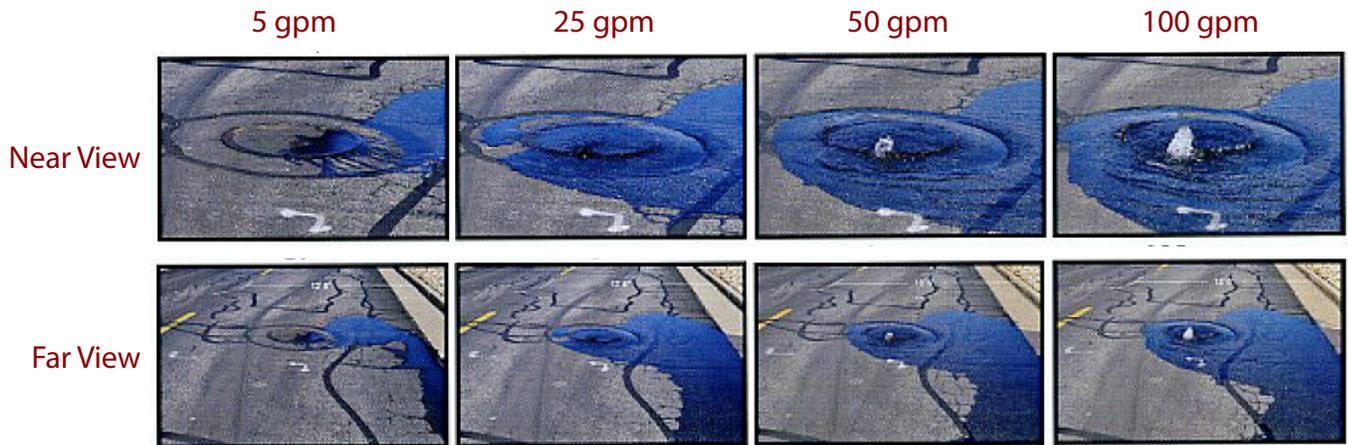

**Sanitary Sewer Backup Response Packet
Volume Estimation: Upstream Lateral Connections Method**

SSO Date: _____ Location: _____

STEP 1: Determine the number of Equivalent Dwelling Units (EDUs) for this SSO: _____ EDUs
NOTE: A single-family residential home = 1 EDU. For commercial buildings, refer to agency documentation.

STEP 2: This volume estimation method utilizes daily usage data based on flow rate studies of several jurisdictions in California. Column A shows how an average daily of usage of 180 gallons per day is distributed during each 6-hour period. Adjust the table as necessary to accurately represent the actual data.

Complete Column E by entering the number of minutes the SSO was active during each 6-hour time period. Multiply column D times Column E to calculate the gallons spilled during each time period. Add the numbers in Column F together for the Total Estimated SSO Volume per EDU.

Time Period	Flow Rate Per EDU				SSO	
	A	B	C	D	E	F
	Gallons per Period	Hours per period	$A \div B =$ Gallons per Hour	$C \div 60 =$ Gallons per Minute	Minutes SSO was active during period	$D \times E =$ Gallons spilled per period
6am-noon	72	6	12	0.20		
noon-6pm	36	6	6	0.10		
6pm-midnight	54	6	9	0.15		
midnight-6am	18	6	3	0.05		
Total Estimated SSO Volume per EDU:						

STEP 3: Multiply the Estimated SSO Volume per EDU from Step 2 by the number of EDUs from Step 1.

$$\frac{\text{gallons}}{\text{Volume per EDU}} \times \frac{\text{\# of EDUs}}{\text{\# of EDUs}} = \frac{\text{gallons}}{\text{Estimated SSO Volume}}$$

STEP 4: Adjust SSO volume as necessary considering other factors, such as activity that would cause a fluctuating flow rate (doing laundry, taking showers, etc.). Explain rationale below and indicate adjusted SSO estimate (attach a separate page if necessary):

Estimated SSO Volume: _____ gallons

Do you believe that this method has estimated the entire SSO? Yes No

If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:

Name: _____ Signature: _____
 Job Title: _____ Date: _____

**Sanitary Sewer Backup Response Packet
Lateral CCTV Report**

PLEASE COMPLETE AS THOROUGHLY AS POSSIBLE

PERSON COMPLETING THIS FORM:		DATE:
		PHONE:
CAMERA TYPE:	LOCATION OF CAMERA ENTRY:	
AFFECTED PROPERTY STREET ADDRESS:	LOCATION OF CAMERA STOP:	
CITY, STATE AND ZIP:	DESCRIBE AREA TV'd:	
PHONE	UPSTREAM MANHOLE #:	
PLEASE CHECK ALL THAT WERE DISCOVERED – <i>Describe Extent & Location Using Camera Entry Point As Reference:</i>		TIME OF OVERFLOW:
<input type="checkbox"/> Broken Lateral – Describe: Depth:		TIME BLOCKAGE RELIEVED:
<input type="checkbox"/> Roots – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		TIME LATERAL TV'd:
<input type="checkbox"/> Grease – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		DEPTH OF LATERAL:
<input type="checkbox"/> Sag – Describe: Depth:		RECOMMENDED FOLLOW UP WORK ACTIONS:
<input type="checkbox"/> BPD – Describe: Location:		
<input type="checkbox"/> Cleanout – Describe: Location:		
<input type="checkbox"/> Joint/Junction – Describe: Depth:		
<input type="checkbox"/> Grade – Describe:		
<input type="checkbox"/> Grit – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		
<input type="checkbox"/> Other – Describe:		
Mark for USA location? <input type="checkbox"/> Yes <input type="checkbox"/> No	Lateral Locations Marked in Green Paint? <input type="checkbox"/> Yes <input type="checkbox"/> No	
SIGNATURE OF EMPLOYEE PERFORMING TV WORK:		DATE

If applicable, place completed form in Sewer Backup Packet and follow routing instructions.

**Sanitary Sewer Backup Response Packet
Claims Submittal Checklist**

Wastewater Operations Manager

1. Complete the following information:

Title: _____

Name: _____

Phone: _____

Today's Date: _____

2. Copy the items listed below and retain for internal archiving purposes.
3. Place the originals back in the Backup Response Envelope and forward envelope with original forms to the City Clerk:

- Form B-3: First Responder Form
- Form B-4: Declination of Cleaning Services
- Form B-5: Lodging Authorization Form
- Form B-6: Sanitary Sewer Overflow Report
- Form B-7: Start Time Determination Form
- Form B-8: Volume Estimation Form(s)
- Form B-9: Lateral CCTV Report
- Form B-10: Claims Submittal Checklist (*this form*)
- All photos taken (*hardcopy or electronic*)
- Any other information you feel is important in this claim

4. Go to Regulatory Notifications Packet and make all appropriate notifications.
5. Complete Form B-11: Collection System Failure Analysis

City Clerk

1. Verify claims packet is complete.
2. Forward to: Michael Groff, Liability Claims Manager
Municipal Pooling Authority (MPA)
1911 San Miguel Drive Ste 200
Walnut Creek CA 94596
- Telephone: (925) 943-1100 ext. 11
Fax: (925) 946-4183

3. Communicate with MPA to adjust and administer the claim to closure.

Sanitary Sewer Backup Response Packet
Collection System Failure Analysis

To be completed by the Wastewater Operations Manager

Work Order #		Prepared By	
SSO/Backup Information			
Event Date/Time		Address	
Volume Spilled		Volume Recovered	
Cause			
Summary of Historical SSOs/Backups/Service Calls/Other Problems			
Date	Cause	Date Last Cleaned	Crew
Records Reviewed By:		Record Review Date:	
Summary of CCTV Information			
CCTV Inspection Date		Tape Name/Number	
CCTV Tape Reviewed By		CCTV Review Date	
Observations/Recommendations:			

Go to Side B

Sanitary Sewer Backup Response Packet
Collection System Failure Analysis

Recommendations					
✓	Type	Specific Actions	Who is Responsible?	Completion Deadline	Who Will Verify Completion?
	No Changes or Repairs Required	n/a	n/a	n/a	n/a
	Repair(s)				
	Construction				
	Capital Improvement(s)				
	Change(s) to Maintenance Procedures				
	Change(s) to Overflow Response Procedures				
	Training				
	Misc.				
Comments/Notes:					
Review Date:					

City of Brentwood CA
Overflow Emergency Response Plan

Customer Service Packet

Contents:

<u>Form</u>	<u>Form Number</u>
Customer Information Letter.....	CS-1
Claim Form.....	-2
Sewer Spill Reference Guide	pamphlet

Instructions:

1. Review the Customer Information letter to determine actions that need to be taken immediately.
2. See the Customer Information letter for information about filing a claim.
3. Review the Sewer Spill Reference Guide pamphlet.

If you have any questions contact:

Regarding Sewer Issues: Wastewater Operations Manager (925) 516-6070
Regarding Submitting a Claim for Damages: City Clerk (925) 516-5440

This packet provided by: _____ Phone: _____

Paquete informativo del servicio al cliente

Contenido:

<u>Formulario</u>	<u>Número de formulario</u>
Carta Informativa Para el Cliente.....	CS-1
Formulario de Reclamación.....	-2
Guía de Referencia Sobre Desbordes Cloacales.....	folleto

Instrucciones:

1. Analice la carta informativa para el cliente a fin de determinar las medidas que se deben tomar de manera inmediata.
2. Consulte la carta informativa para el cliente a fin de obtener información sobre cómo presentar un reclamo.
3. Analice el folleto de la Guía de Referencia Sobre Desbordes Cloacales.

En caso de preguntas, comuníquese con:

Para temas cloacales: Gerente de Operaciones de Aguas Residuales (925) 516-6070
Para presentar un reclamo por daños: Secretaria Municipal (925) 516-5440

Sanitary Sewer Backup Response Packet
Customer Information Regarding Sewer Backup Claims

CS-1

Dear Resident:

We recognize that sewer back flow incidents can be stressful and require immediate response when all facts concerning how an incident occurred are unknown. Rest assured that we do all we can to prevent this type of event from occurring. Nevertheless, occasionally tree roots or other debris in the sewer lines cause a backup into homes immediately upstream of the blockage. At this time the City is investigating the cause of this incident.

If the City is found to be responsible for the incident, we are committed to cleaning and restoring your property, and to protecting the health of those affected during the remediation process.

The cleaning contractor provided by the City has been selected because of their adherence to established protocols that are designed to assure all parties thorough, cost-effective and expeditious cleaning services. You also have the right to select your own cleaning contractor, but the City does not guarantee payment of fees/expenses incurred and reserves the right to dispute fees/expenses deemed not usual and customary.

If you wish to discuss this matter, please contact the City Wastewater Operations Manager at (925) 516-6070. If you wish to submit a claim for damages, please complete the claim form in this packet. Completed Claim Forms are to be submitted to the City Clerk at 150 City Parkway, Brentwood, California 94513. Claims against the City must comply with the California Government Code Sec. 910-913.2. The City Clerk has the responsibility for processing any claims for damages that are submitted and can be reached at (925) 516-5440.

What you need to do now:

The City has prepared this brief set of instructions to help you minimize the impact of the loss by responding promptly to the situation.

- Do not attempt to clean the area yourself; let the cleaning and restoration company handle this.
- Keep people and pets away from the affected area(s).
- Turn off all appliances that use water.
- Turn off heating/air conditioning systems.
- Do not remove items from the area – the cleaning and restoration company will handle this.
- If you had recent plumbing work, contact your plumber or contractor and inform them of this incident.
- If you intend to file a claim, do so as soon as practical in order to have your claim considered. To obtain a claim form contact the City Clerk at (925) 516-5440.
 - **Please Note:** The general provisions for the filing of claims against public entities are contained in Part 3 (*commencing at Section 900*) of Division 3.6 of the Government code. Certain claims are not governed by these provisions, including tax and assessment matters, liens, employee compensations, workers' compensation, unemployment compensation, welfare, securities, and others.
 - The form and contents of a claim are specified by Section 910, et seq. A claim relating to a cause of action for death or for injury to person or to personal property or growing crops shall be presented not later than six months after accrual of the cause of action; other claims shall be presented within one year (*Section 911.2*).
 - Claims are to be presented by delivery or mailing to the City Clerk at 150 City Parkway, Brentwood, California 94513 (*Section 915*).
 - It is suggested that the claimant refer to claims law and be fully advised with respect to the exceptions and further provisions contained therein.

Noticia Legal Importante: Para su proteccion lea usted con cuidado debe de obtener una translacion que sea puntual y de confianza o consulte con su abogado.

Paquete de Respuesta a Desbordamiento de Alcantarilla Sanitaria
Información de Cliente Acerca de Demandas de Desbordamiento de Alcantarilla

Estimado vecino:

Reconocemos que los incidentes provocados por el reflujo de aguas cloacales pueden ser estresantes y exigen una respuesta inmediata cuando se desconocen los hechos relacionados con la causa del incidente. Tenga la seguridad de que hacemos todo lo posible para evitar que sucedan este tipo de incidentes. Sin embargo, las raíces de los árboles u otros desechos que se encuentran en las cañerías principales del sistema cloacal provocan, de vez en cuando, un desborde en el interior de las viviendas justo arriba de la obstrucción. En este momento, la Ciudad está investigando la causa de este incidente.

Si se determina que la Ciudad es responsable del incidente, nos comprometemos a limpiar y restaurar su propiedad, así como a proteger la salud de aquellas personas que hayan sido afectadas durante el proceso de reparación.

El contratista de limpieza proveída de parte de la Ciudad ha sido escogido debido a su adherencia de establecer protocolos que son diseñados para asegurar a todos los partes con servicios de limpieza completos, económicos, y expeditivos. Usted también tiene el derecho to escoger su propio contratista de limpieza, pero la Ciudad no garantiza pago de tarifas/gastos incurridos y reserva el derecho de disputar las tarifas/gastos considerados no ser usuales o de costumbre.

Si desea conversar sobre este tema, comuníquese con el Gerente de Operaciones de Aguas Residuales, llamando al (925) 516-6070. Si desea presentar un reclamo por daños, completar el formulario de reclamación en este paquete. Los formularios de reclamo que estén completos deben presentarse a la Secretaria Municipal en 150 City Parkway, Brentwood, California 94513. Los reclamos presentados contra la Ciudad deben cumplir con las disposiciones de los artículos 910-913.2 del Código del Gobierno de California (*California Government Code Sec. 910-913.2*). la Secretaria Municipal asume la responsabilidad de procesar todos los reclamos iniciados por daños que se presenten, éstos pueden consultarse llamando al (925) 516-5440.

Lo que necesita saber en este momento:

La Ciudad redactó esta breve serie de instrucciones para ayudarlo a minimizar el impacto de la pérdida respondiendo de manera inmediata ante la situación.

- No intente limpiar la zona usted mismo; permita que la empresa de limpieza y restauración se encargue de esto.
- Mantenga a las personas y a las mascotas alejadas de la(s) zona(s) afectada(s).
- Apague todos los aparatos que utilicen agua.
- Apague los sistemas de calefacción y/o aire acondicionado.
- No quite los elementos que se encuentran en la zona; la empresa de limpieza y restauración se encargará de esto.
- Si recientemente se realizaron obras de plomería, comuníquese con su plomero o servicio de plomería e infórmele sobre este incidente.
- Si tiene pensado presentar un reclamo, hágalo lo antes posible para que éste sea tenido en cuenta. Para obtener un formulario de reclamo, comuníquese con la Secretaria Municipal llamando al (925) 516-5440.
 - **Observación:** Las disposiciones generales que rigen la presentación de reclamos contra organismos públicos están incluidas en la Parte 3 (*que comienza en el Artículo 900*) del Capítulo 3.6 del Código del Gobierno (*Division 3.6 of the Government code*). Existen determinados reclamos que no se rigen por estas disposiciones, incluyendo los asuntos relacionados con los impuestos y las tasaciones, los gravámenes, la remuneración para los empleados, las indemnizaciones de los trabajadores, el subsidio de desempleo, la asistencia social, los títulos y demás.
 - La forma y el contenido del reclamo se especifican en el Artículo 910 y siguientes. Un reclamo que esté relacionado con la causa de acción por muerte o lesión de una persona o de los bienes personales o de la cosecha en crecimiento deberá presentarse antes de que se cumplan los seis meses posteriores a dicha causa de acción; los demás reclamos deberán presentarse dentro del período de un año (*Artículo 911.2*).
 - Los reclamos deberán presentarse ante la Secretaria Municipal, Brentwood (*Artículo 915*), en persona o por correo.
 - Se sugiere que el reclamante haga referencia a la legislación sobre reclamos y que usted esté completamente asesorado sobre las excepciones y demás disposiciones incluidas en dicha legislación.

CLAIM PRESENTED TO THE CITY OF BRENTWOOD

Please read the instructions on the back before completing.

FORM 4.1

1. Claimant's Name: <i>(Please Print)</i> _____ Claimant's Address: _____ City, State, Zip: _____ Day Phone: () _____ Eve: () _____	Reserved for Filing Stamp City Claim No.:
2. When did the damage or injury occur? Month: _____ Day: _____ Year: _____ Time: _____ a.m. or p.m. Police Report No.:	
3. At which location did the damage or injury occur? _____ _____	
4. a. What happened and why is the City responsible? _____ _____ _____ b. Name and position of responsible City Employee(s), if known: _____ _____	
5. What damage or injury occurred? _____ _____ _____	
6. Claim amount (only if less than \$10,000): _____ If the amount exceeds \$10,000, please check the court for appropriate jurisdiction: ____ Municipal Court (claims up to \$25,000) ____ Superior Court (claims over \$25,000)	
7. How did you arrive at the amount claimed? Please attach documentation. _____ _____ _____	
8. I declare under penalty of perjury under the laws of the State of California that the following information is true and correct, and that this declaration was executed on _____, 20__, at _____ CA. _____ <i>Signature of Claimant or Representative</i>	
9. Official Notices and Correspondence <i>If represented by an insurance company or an attorney, please provide the information requested below:</i> Name and Capacity: <i>(please print)</i> _____ Address: _____ City, State, Zip: _____ Daytime Phone: _____ Evening: _____	

PRESENTING A CLAIM TO THE CITY OF BRENTWOOD

- ⇒ PLEASE TYPE OR PRINT CLEARLY ALL OF THE INFORMATION REQUESTED ON THE CLAIM FORM.
- ⇒ YOU MUST COMPLETE EACH SECTION OR YOUR CLAIM MAY BE RETURNED TO YOU AS INSUFFICIENT.
- ⇒ THE FOLLOWING PROVIDES SPECIFIC INSTRUCTIONS FOR COMPLETING EACH SECTION OF THE CLAIM FORM.

1. **NAME AND MAILING ADDRESS OF CLAIMANT** – State the full name and mailing address of the person(s) claiming damage or injury. Please include a daytime and evening telephone number.
2. **WHEN DID THE DAMAGE OR INJURY OCCUR?** – State the exact month, date, year, and approximate time (if known) of the incident which caused the alleged damage/injury.

Under State law, claims relating to causes of action for personal injury, wrongful death, property damage, and crop damage must be presented to the City of Brentwood no later than six months after the incident date. Please note that evidence of “**presentation**” includes a clear postmark date on an envelope or a certification of personal service, or service by mail.

When filing a claim beyond the six-month period, you must explain the reason the claim was not filed within the six-month period. This explanation is called “**application for leave to present a late claim**”. In considering your claim, the City will first decide whether the late claim application should be granted or denied. (See Government Code Section 911.4 for the legally acceptable reasons a claim may be filed late.) Only if your late claim application is granted will the City then consider the merits of your claim.

Claims relating to any cause of action other than personal injury, wrongful death, property damage, and crop damage must be presented no later than one year after the incident date. (See Government Code Section 911.2).

3. **AT WHICH LOCATION DID THE DAMAGE OR INJURY OCCUR?** – Please include street address, city, county, intersection, etc. If possible, also include the Police Report number.
4. **WHAT HAPPENED AND WHY IS THE CITY RESPONSIBLE?** – Please explain the circumstances that led to the alleged damage or injury. State all facts which support your claim with the City and why you believe the City is responsible for the alleged damage or injury. If known, identify the name of the City Department(s) and/or City employee(s) that allegedly caused the damage or injury.
5. **WHAT DAMAGE OR INJURY OCCURRED?** – Provide in full a detailed description of the damage/injury that allegedly resulted from the incident. (What specific damage or injury do you claim resulted from the alleged actions?)
6. **CLAIM AMOUNT:** - State the specific total dollar amount you are claiming as result of the alleged damage/injury. If damage/injury is continuing or is anticipated in the future, indicate with a “+” following the dollar figure if \$10,000 or under. If the total dollar amount is unspecified or exceeds \$10,000, designate the appropriate court jurisdiction for the claim.
7. **HOW DID YOU ARRIVE AT THE AMOUNT CLAIMED?** – Provide a breakdown of how the total amount that you are claiming was computed. You may declare expenses incurred and/or future anticipated expenses. If you have supporting documentation (i.e., bills, payment receipts, cost estimates) please attach copies of them to your claim.
8. **SIGNATURE:** - The claim must be signed by the claimant or by the attorney/representative of the claimant. The City will not accept the claim without a proper signature. Government Code Section 910.2 provides: “The claim shall be signed by the claimant or by some person on his/her behalf.”
9. **OFFICIAL NOTICES AND CORRESPONDENCE** - Provide the name and mailing address of the person to whom all official notices and other correspondence from the City should be sent, only if other than claimant. Please provide telephone numbers for the representative, if applicable.

⇒ SUBMIT COMPLETED AND RELATED DOCUMENTATION TO: City Clerk of the City of Brentwood, 150 City Park Way, Brentwood, CA 94513. Personal service of claims can be accomplished during regular City business hours 8:00 am to 5:00 pm, Monday through Friday (excluding City holidays).

⇒ If you wish to receive a stamped copy of your claim, return the form to the City Clerk with a cover letter along with a stamped, self addressed envelope informing the City of your request.


⇒ You will receive a letter from the Risk Management Office indicating your claim has been received and is being investigated. You will receive an explanation of the investigation results within 45 days in most instances.

If, after reading these instructions, you have questions or need additional information regarding the filing of a claim with the City of Brentwood; please contact the City Clerk at (925) 516-5440.

THANK YOU!

How a Sewer System Works


A property owner's sewer pipes are called **service laterals** and are connected to larger local main and regional trunk lines. Service laterals run from the connection at the home to the connection with the public sewer. These laterals are the responsibility of the property owner and must be maintained by the property owner.

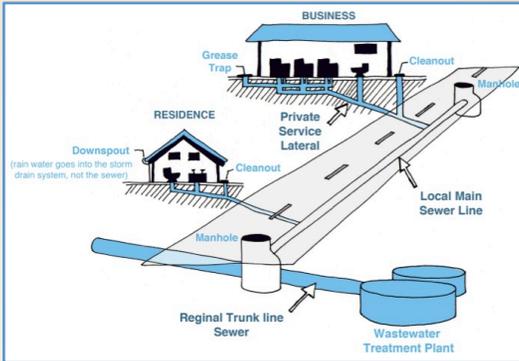

Is my home required to have a backflow prevention device?

Section 710.1 of the Uniform Plumbing Code (U.P.C.) states: "Drainage piping serving fixtures which have flood level rims located below the elevation of the next upstream manhole cover or private sewer serving such drainage piping **shall** be protected from backflow of sewage by installing an approved type of backwater valve." The intent of Section 710.1 is to protect the building interior from mainline sewer overflows or surcharges.

Additionally, U.P.C. 710.6 states: "Backwater valves **shall** be located where they will be accessible for inspection and repair at all times and, unless continuously exposed, shall be enclosed in a masonry pit fitted with an adequately sized removable cover."

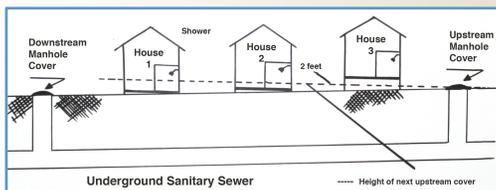

If you have a sewage spill from your private sewer line that impacts storm drains, waterways or public property, contact:

City of Brentwood
(925) 516-6060

Contra Costa Health Services
(925) 692-2500

California Health and Safety Code, Sections 5410-5416 requires:

- No person shall discharge raw or treated sewage or other waste in a manner that results in contamination, pollution, or a nuisance.
- Any person who causes or permits a sewage discharge to any state waters:
 - Must immediately notify the local health agency of the discharge.
 - Shall reimburse the local health agency for services that protect the public's health and safety.
 - Who fails to provide the required notice to the local health agency is guilty of a misdemeanor and shall be punished by a fine (between \$500-\$1,000) and/or imprisonment for less than one year.

Central Valley Regional Water Quality Control Board
(916) 464-3291
Requires the prevention, mitigation, response to, and reporting of sewage spills.

California Governor's Office of Emergency Services (CalOES)
(800) 852-7550

California Water Code, Article 4, Chapter 4, Sections 13268-13271 & California Code of Regulations, Title 23, Division 3, Chapter 9.2, Article 2, Sections 2250-2260 require:

- Any person who causes or permits sewage in excess of 1,000 gallons to be discharged to state waters shall immediately notify the Office of Emergency Services.
- Any person who fails to provide the notice required by this section is guilty of a misdemeanor and shall be punished by a fine (less than \$20,000) and/or imprisonment for not more than one year.

Sewer Spill Reference Guide

Your Responsibilities as a Private Property Owner

Provided to you by:

City of Brentwood

2251 Elkins Way
Brentwood, CA 94513

(925) 516-6060

Copyright © 2004-2014
DKF Solutions Group
All rights reserved.

How do sewage spills happen?

Sewage spills occur when the wastewater in underground pipes overflows through a manhole, cleanout, or broken pipe. Most spills are relatively small and can be stopped and cleaned up quickly, but left unattended they can cause health hazards, damage to homes and businesses, and threaten the environment, local waterways, and beaches.

CAUTION!

When trying to locate a sewer problem, never open manholes or other public sewer structures. Only our crews are allowed to open & inspect these structures.

Common causes of sewage spills

- Grease build-up
- Tree roots
- Broken/cracked pipes
- Missing or broken cleanout caps
- Undersized sewers
- Groundwater/rainwater entering the sewer system through pipe defects and illegal connections

Prevent most sewage backups with a Backflow Prevention Device

This type of device can help prevent sewage backups into homes and businesses. If you don't already have a Backflow Prevention Device, contact a professional plumber or contractor to install one as soon as possible.

Protect the environment!

If you let sewage from your property discharge to a gutter or storm drain, you may be subject to penalties and/or out-of-pocket costs for clean-up and enforcement efforts. A property owner may be charged for costs incurred by agencies responding to spills from private properties.

What to look for:

Sewage spills can be a very noticeable gushing of water from a manhole or a slow water leak that may take time to be noticed. Don't dismiss unaccounted-for wet areas. Look for:

- Drain backups inside the building.
- Wet ground and/or water leaking around manhole lids onto your street.
- Leaking water from cleanouts or outside drains
- Unusual odorous wet areas: sidewalks, external walls, ground/landscape around a building.

The following are indicators of a possible obstruction in your sewer line:

- Water comes up in floor drains, showers or toilets.
- Toilets, showers or floor drains below ground level drain very slowly.

What to do if there is a spill:

Immediately notify the City of Brentwood. Our crews locate the blockage and determine if it is in the public sewer; if it is the crew removes the blockage and arranges for cleanup. If the backup is in your private internal plumbing or in the private service laterals, you are required to immediately:

- Control and minimize the spill by shutting off or not using the water
- Keep sewage out of the storm drain system using sandbags, dirt and/or plastic sheeting
- Call a plumbing professional to clear blockages and make repairs as needed. Look in the yellow pages under "Plumbing Drain & Sewer Cleaning" or "Sewer Contractors."
- Always notify your sewer/public works department or public sewer district of sewage spills.

Spill cleanup inside the home:

For large clean ups, a professional cleaning firm should be contacted to clean up impacted areas, You can locate local firms by looking in the Yellow Pages under "Water Damage" or "Fire Damage." If you hire a contractor, it is recommended to get estimates from more than one company. Sometimes, homeowner's insurance will pay for the necessary cleaning due to sewer backups. Not all policies have this coverage, so check with your agent.

If you decide to clean up a small spill inside your home, protect yourself from contamination by observing the following safety measures. Those persons whose resistance to infection is compromised should not attempt this type of clean up.

Other Tips:

- Keep children and pets out of the affected area until cleanup has been completed.
- Turn off heating/air conditioning systems
- Wear rubber boots, rubber gloves, and goggles during cleanup of the affected area.
- Discard items that cannot be washed and disinfected (such as: mattresses, rugs, cosmetics, baby toys, etc.)
- Remove and discard drywall and insulation that has been contaminated with sewage or flood waters.

- Thoroughly clean all hard surfaces (such as flooring, concrete, molding, wood and metal furniture, countertops, appliances, sinks and other plumbing fixtures) with hot water and laundry or dish detergent.
- Help the drying process with fans, air conditioning units, and dehumidifiers.
- After completing cleanup, wash your hands with soap and water. Use water that has been boiled for 1 minute (allow the water to cool before washing your hands) OR use water that has been disinfected (solution of 1/8 teaspoon of household bleach per 1 gallon of water). Let it stand for 30 min. If water is cloudy, use ¼ teaspoon of household bleach per 1 gallon of water.
- Wash clothes worn during cleanup in hot water and detergent (wash apart from uncontaminated clothes).
- Wash clothes contaminated with sewage in hot water and detergent. Consider using a Laundromat until your onsite wastewater system has been professionally inspected and serviced.
- Seek immediate attention if you become injured or ill.

Spill cleanup outside the home:

- Keep children and pets out of the affected area until cleanup has been completed.
- Wear rubber boots, rubber gloves, and goggles during cleanup of affected area.
- Clean up sewage solids (fecal material) and place in properly functioning toilet or double bag and place in garbage container.
- On hard surfaces areas such as asphalt or concrete, it is safe to use a 2% bleach solutions, or ½ cup of bleach to 5 gallons of water, but don't allow it to reach a storm drain as the bleach can harm the environment.
- After cleanup, wash hands with soap and water. Use water that has been boiled for 1 minute (allow to cool before washing your hands) OR use water that has been disinfected (solution of 1/8 teaspoon of household bleach per 1 gallon of water). Let it stand for 30 min. If water is cloudy, use ¼ teaspoon of household bleach per 1 gallon of water.
- Wash clothes worn during cleanup in hot water and detergent (wash apart from uncontaminated clothes).
- Wash clothes contaminated with sewage in hot water and detergent. Consider using a Laundromat until your onsite wastewater system has been professionally inspected and serviced.
- Seek immediate attention if you become injured/ill.

City of Brentwood

On (date) _____, at (location) _____,

we responded to a reported blockage of the sanitary sewer service to your property.

We discovered a blockage in:

- The sanitary sewer main and cleared the line
- The City-maintained portion of your sanitary sewer lateral and cleared the line.
- Your portion of the sanitary sewer lateral, which is your responsibility to maintain. We also found the City’s portion of the lateral and the main to be flowing normally.

If you require assistance to clear your portion of the lateral you can look in the Yellow Pages of your telephone book under “Sewer Contractors” or “Plumbing Drains & Sewer Cleaning”. If you plan to hire a contractor we recommend getting estimates from more than one company.

City of Brentwood representative notes: _____

City of Brentwood Representative: _____

For questions or comments, please call

**City of Brentwood
(925) 516-6060**

City of Brentwood

En (fecha) _____, en (localización) _____

respondimos a una obstrucción divulgada del servicio de alcantarillado sanitario de su propiedad.

Descubrimos un bloqueo en:

- El alcantarillado sanitario principal y despejó la línea
- Porción mantenidos por la ciudad de su lateral de alcantarillado sanitario y despejó la línea.
- Lateral su porción del alcantarillado sanitario, que es su responsabilidad de mantener. También encontramos parte de la ciudad de los laterales y el principal a ser fluir normalmente.

Si necesita asistencia para despejar su porción del lateral puede buscar en Internet o en la guía telefónica bajo "Alcantarillado contratistas" o "Fontanería drenajes & alcantarillado limpieza". Si usted planea contratar a un contratista le recomendamos obtener estimaciones de más de una empresa.

Notas representativos de la ciudad de Brentwood: _____

Representante de la ciudad de Brentwood: _____

**Para preguntas o comentarios,
por favor llame a**

**Ciudad de Brentwood
(925) 516-6060**

Appendix C

SANITARY SEWER OVERFLOW RESPONSE PACKET

**Sanitary Sewer Overflow Response Packet
Table of Contents**

<u>Form</u>	<u>Form Number</u>
Instructions and Chain of Custody	envelope label
Responding to a Sanitary Sewer Overflow	C-1
Sewer Overflow Report	-2
Start Time Determination	-3
Volume Estimation Forms	-4a, -4b, -4c
Lateral CCTV Report.....	-5
Collection System Failure Analysis Report	-6
Public Posting	
Door Hanger	
Sewer Spill Reference Guide Pamphlet	

For pre-assembled packets contact DKF Solutions Group at (707) 373-9709 or kpatzer@dkfsolutions.com

In the event of a Sanitary Sewer Overflow READ THIS FIRST



- If this is a Category 1 SSO greater than or equal to 1,000 gallons, IMMEDIATELY , contact CalOES at (800) 852-7550 within 2 hours of the City's awareness of the SSO
- Check here if you believe that fats, roots, oils and/grease (FROG) caused or contributed to the SSO.
- For any media requests: Contact the Public Information Officer, Captain Tom Hansen, at (925) 634-6911.

Instructions

Don't forget photos!



Collections Crew:

- Follow the instructions on the Sewer Overflow Response Flowchart (C-1).
- Refer to the Field Guide as necessary.
- Place completed forms, camera (if applicable), and any additional notes/documentation in this envelope.
- Complete the Chain of Custody record (right) and forward this packet to Wastewater Operations Manager or designee.

Print Name: _____

Initial: _____

Date: _____

Time: _____

Wastewater Operations Manager or Designee:

- Review the enclosed forms.
- Complete the Regulatory Notifications Packet.
- Complete the Chain of Custody Record (right) and file this completed Sewer Overflow Packet in accordance with City policy.
- Debrief using the Collection System Failure Analysis Form.

Print Name: _____


Initial: _____

Date: _____

Time: _____

City of Brentwood Overflow Emergency Response Plan: Sanitary Sewer Overflow Packet

Sanitary Sewer Overflow Response Packet
Overflow Response Flowchart

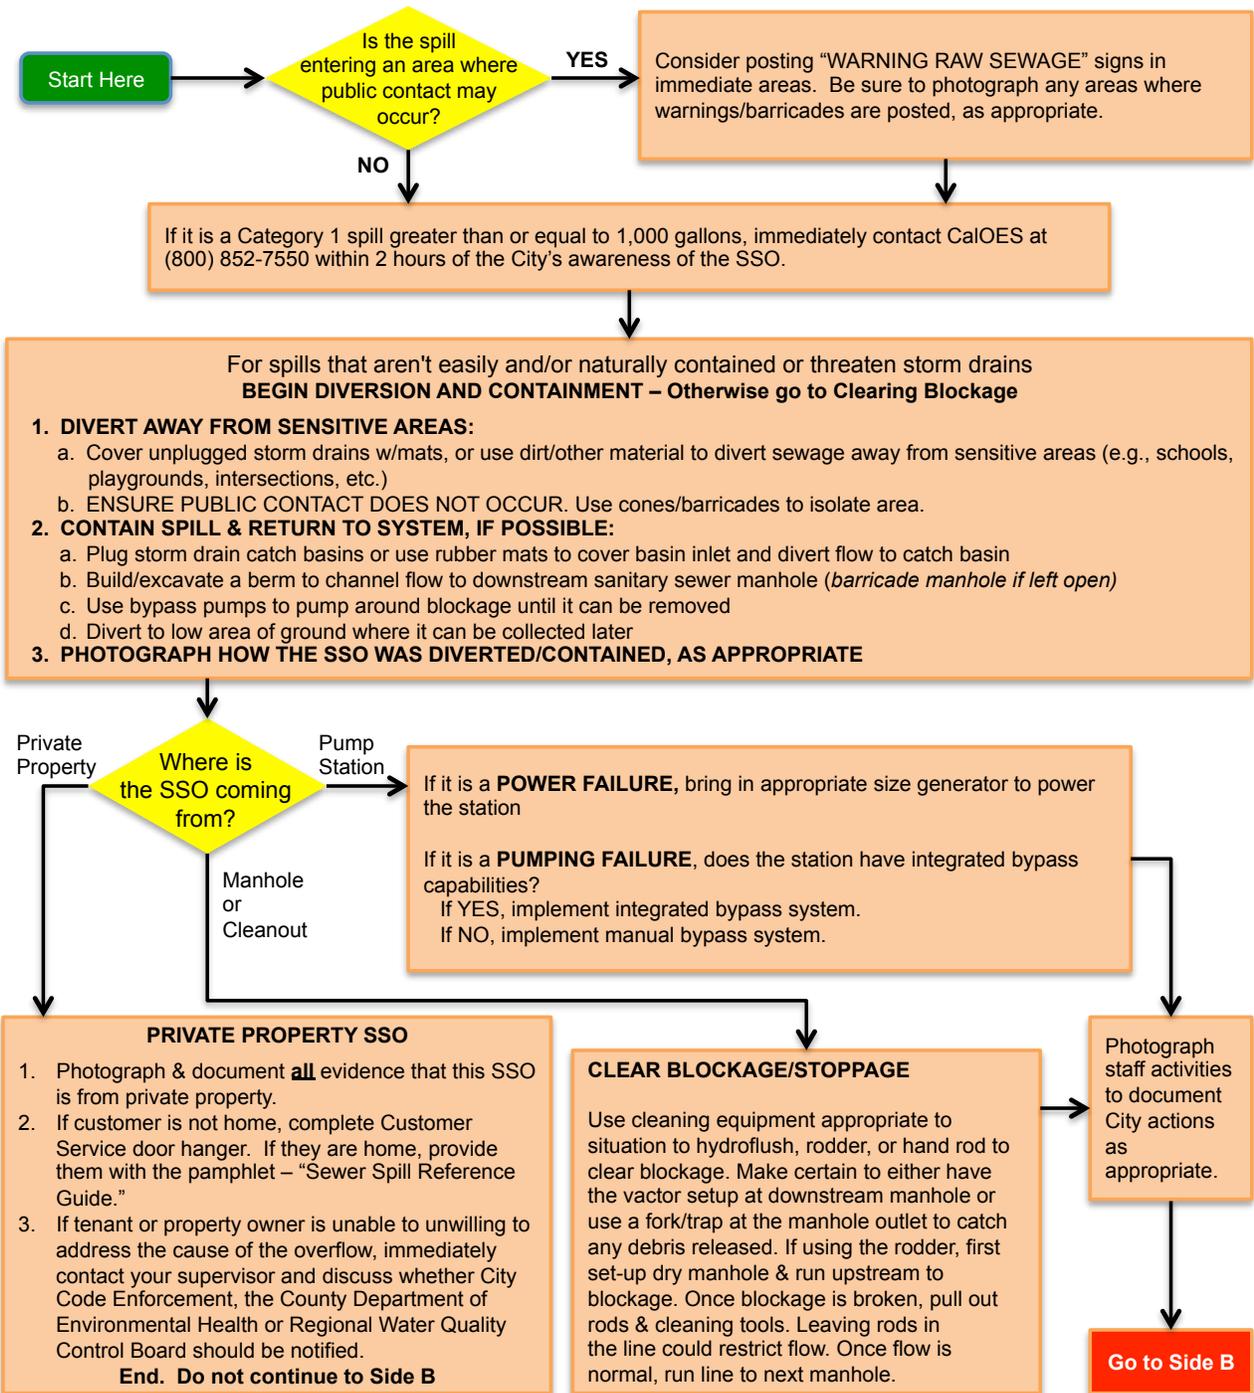


MEDIA AND PUBLIC RELATIONS GUIDELINES:

Exercise caution in contacts with the public or media when you respond to a spill. Any information you provide or statements you make may become pertinent in the event of possible court action, it is important to **AVOID THE FOLLOWING:**

- Giving out the wrong information,
- Providing incorrect facts about a company or other agency
- Speculating about the situation you are responding to
- Making accusations against customers, businesses or other agencies

Be courteous and attempt to provide accurate information to questions within the limits above. In some cases, it may be appropriate to say that we do not have any information, or to delay answering a question and then to say when an answer might be available. In most cases, refer media requests to the media coordinator indicated on the front of the Overflow Packet envelope.

Sanitary Sewer Overflow Response Packet
Overflow Response Flowchart

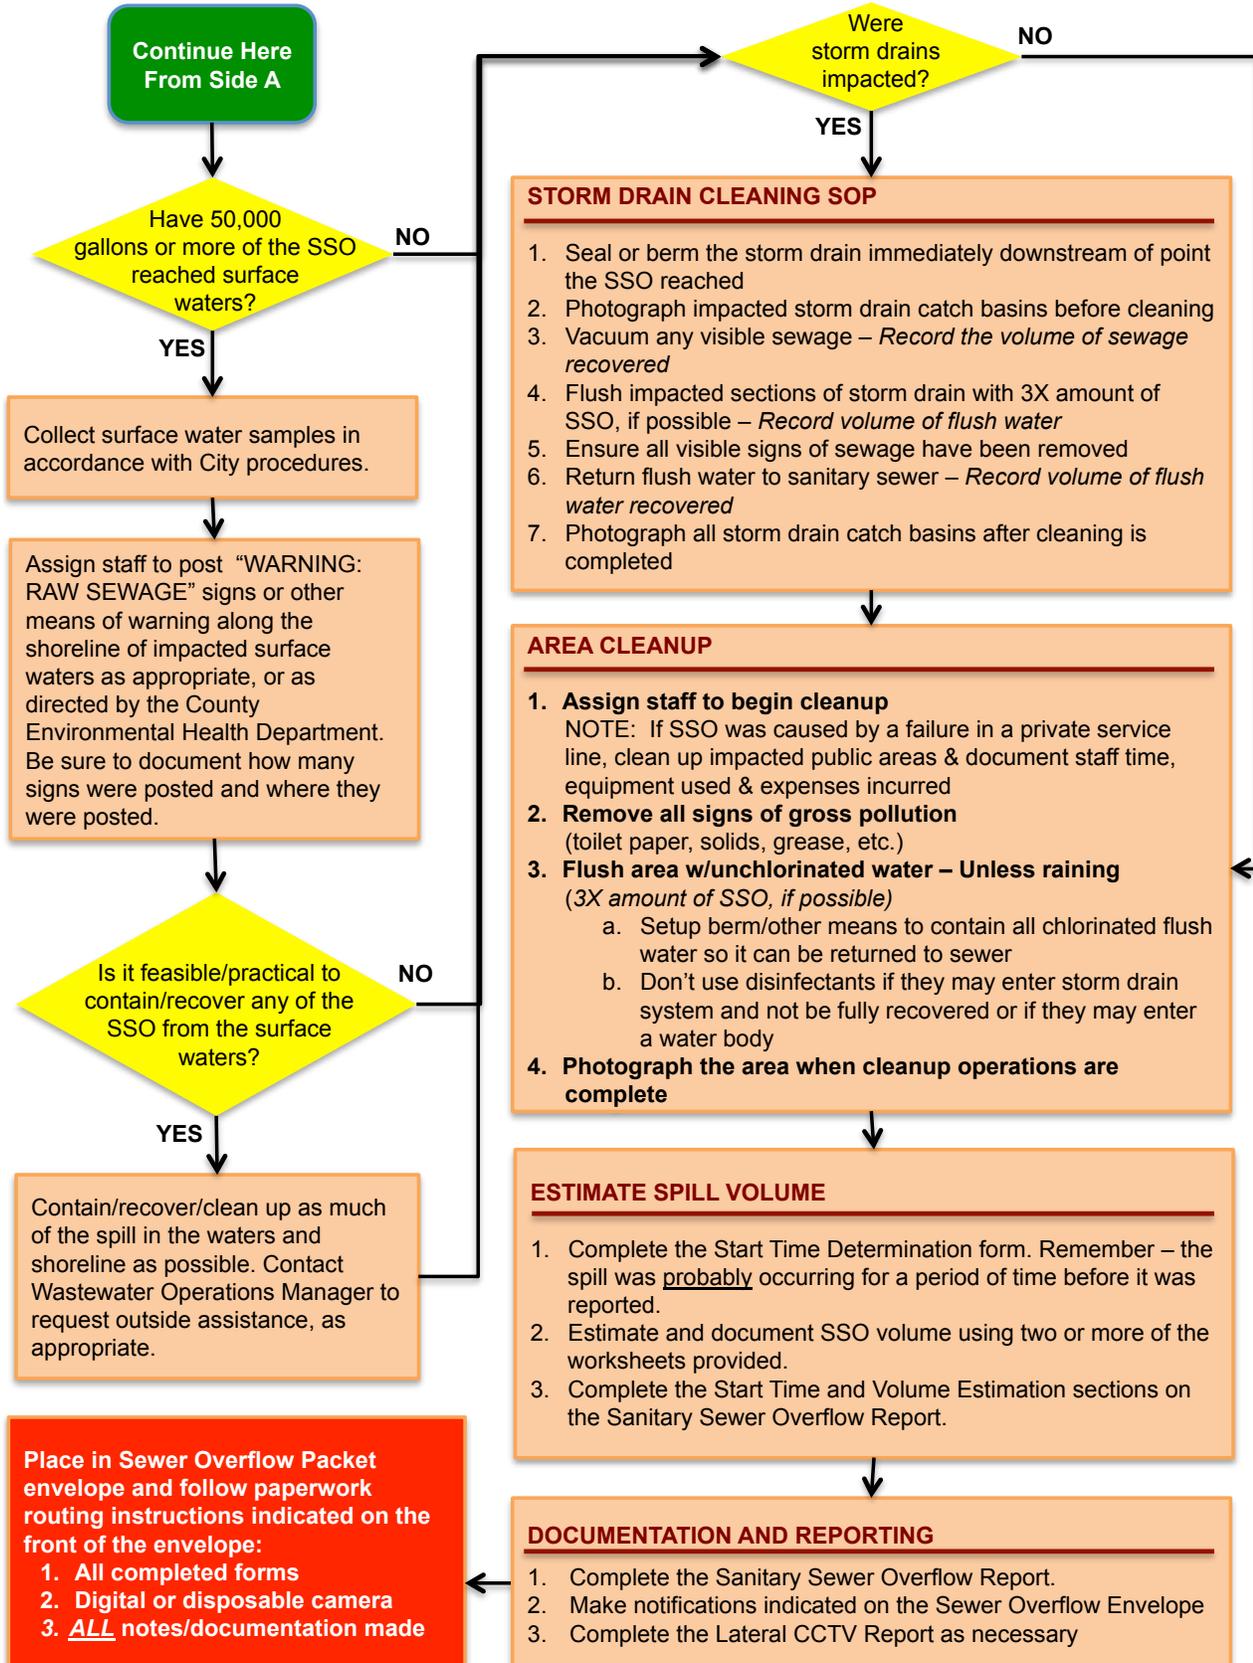

Sanitary Sewer Overflow Response Packet
Sanitary Sewer Overflow Report

INSTRUCTIONS: Complete all items EXCEPT those that are shaded gray

SSO Category (*check one*):

- Category 1: Discharge of untreated or partially treated wastewater of any volume resulting from a sanitary sewer system failure or flow condition that either (1) Reaches surface water and/or drainage channel tributary to a surface water; OR (2) Reached a Municipal Separate Storm Sewer System (MS4) and was not fully captured and returned to the sanitary sewer system or otherwise captured and disposed of properly.
- Category 2: Discharge of untreated or partially treated wastewater greater than or equal to 1,000 gallons resulting from a sanitary sewer system failure or flow condition that either (1) Does not reach surface water, a drainage channel, or an MS4, OR (2) The entire SSO discharged to the storm drain system was fully recovered and disposed of properly.
- Category 3: All other discharges of untreated or partially treated wastewater resulting from a sanitary sewer system failure or flow condition
- Spill from Private Lateral (specify): Single Family Home Multi-Family Home High Density Residential (5+ units)
 Food Service Establishment (FSE) Mixed Use Property Industrial Property Commercial Property
 Public quasi-public institution (hospital, schools, fire department, etc.)

IMMEDIATE NOTIFICATION: If this is a Category 1 SSO ≥1,000 gallons, contact CalOES within 2 hours at (800) 852-7550.

A. SSO LOCATION		
SSO Location Name:		
Latitude Coordinates:	Longitude Coordinates:	
Street Name and Number:		
Nearest Cross Street:	City:	Zip Code:
SSO Location Description:		

B. SSO OCCURRING TIME (complete Start Time Determination Form and then complete information below)	
Estimated SSO start date:	Estimated SSO start time:
Date SSO reported to sewer crew:	Time SSO reported to sewer crew:
Date sewer crew arrived:	Time sewer crew arrived:
Who was interviewed to help determine start time?	
Estimated SSO end date:	Estimated SSO end time:

C. SSO DESCRIPTION (Complete Volume Estimation Worksheets and/or refer to Field Guide as needed for estimations.)	
SSO Appearance Point (check one or more): <input type="checkbox"/> Combined Sewer D.I. (Combined CS Only) <input type="checkbox"/> Force Main <input type="checkbox"/> Gravity Mainline <input type="checkbox"/> Lateral Cleanout (Private) <input type="checkbox"/> Lateral Cleanout (Public) <input type="checkbox"/> Inside Building or Structure <input type="checkbox"/> Manhole <input type="checkbox"/> Pump Station <input type="checkbox"/> Lower Lateral (Private) <input type="checkbox"/> Lower Lateral (Public) <input type="checkbox"/> Upper Lateral (Private) <input type="checkbox"/> Upper Lateral (Public) <input type="checkbox"/> Other Sewer System Structure (specify):	
Were there multiple appearance points? <input type="checkbox"/> No <input type="checkbox"/> Yes, number of appearance points:	
Did the SSO reach a drainage channel and/or surface water? <input type="checkbox"/> Yes (<i>Category 1</i>) <input type="checkbox"/> No	
If the SSO reached a storm sewer, was it fully captured and returned to the Sanitary Sewer? <input type="checkbox"/> Yes <input type="checkbox"/> No (<i>Category 1</i>)	
Was this spill from a private lateral? <input type="checkbox"/> Yes <input type="checkbox"/> No If YES, name of responsible party:	
Final Spill Destination:	<input type="checkbox"/> Surface waters other than ocean <input type="checkbox"/> Drainage channel <input type="checkbox"/> Building/structure <input type="checkbox"/> Separate Storm drain <input type="checkbox"/> Paved surface <input type="checkbox"/> Unpaved surface <input type="checkbox"/> Street/curb/gutter <input type="checkbox"/> Other:
Total Estimated SSO volume (<i>in gallons – 1,000gal or more = Category 1</i>): gallons	
Est. volume that reached a separate storm drain that flows to a surface water body:	gal Recovered: gal
Est. volume that reached a drainage channel that flows to a surface water body:	gal Recovered: gal
Est. volume discharged directly to a surface water body:	gal Recovered: gal
Est. volume discharged to land:	gal Recovered: gal
Calc. Methods: <input type="checkbox"/> Eyeball <input type="checkbox"/> Photo Comparison <input type="checkbox"/> Upstream Lat. Connections <input type="checkbox"/> Area/Volume (include sketch/photo with dimensions) <input type="checkbox"/> Other (describe):	

* If multiple appearance points, use the GPS coordinates for the location of the SSO appearance point closest to the failure point/blockage.

Sanitary Sewer Overflow Response Packet
Sanitary Sewer Overflow Report

D. CAUSE OF SSO

Where did failure occur? (Check all that apply): Force Main Gravity Mainline
 Lower Lateral (public) Lower Lateral (private) Manhole Pump Station (specify): Controls Mechanical Power
 Upper Lateral (private) Other:

SSO cause (check all that apply): Construction Diversion Failure CS Maintenance Damage by others
 Debris (specify): From Construction From Lateral General Rags Flow Exceeded Capacity
 FROG (Fats, roots, oil, grease) Inappropriate Discharge Natural Disaster Operator Error Root Intrusion
 Pipe Structural Problem/Failure Pipe Structural Problem/Failure (Installation) Rainfall Exceeded Design
 Pump Station Failure (specify): Controls Mechanical Power Vandalism
 Surcharged Pipe Non - Dispersible Wipes Other (specify):

Diameter (in inches) of pipe at point of blockage/spill cause (if applicable):

Sewer pipe material at point of blockage/spill cause (if applicable):

Estimated age of sewer asset at the point of blockage or failure (if applicable):

Description of terrain surrounding point of blockage/spill cause: Flat Mixed Steep

E. SSO RESPONSE

SSO response activities (check all that apply): Cleaned-Up Mitigated Effects of Spill Contained All or Portion of Spill
 Restored Flow Returned All Spill to Sanitary Sewer System Returned Portion of Spill to Sanitary Sewer System
 Property Owner Notified Other Enforcement Agency Notified (specify) Other (specify):

SSO response completed (date & time):

Visual inspection result of impacted waters (if applicable):

Any fish killed? Yes No Any ongoing investigation? Yes No

Were health warnings posted? Yes No If yes, provide health warning/beach closure posting/details:

Were samples of impacted waters collected? Yes No

If YES, select the analyses: DO Ammonia Bacteria pH Temperature Other:

Recommended corrective actions: (check all that apply and provide detail)

- Add sewer to preventive maintenance program
- Adjust schedule/method of preventive maintenance
- Enforcement action against FROG source
- Inspect Sewer Using CCTV to Determine Cause
- Plan rehabilitation or replacement of sewer
- Repair Facilities or Replace Defect
- Other (specify)

What major equipment was used in the response?

List all agency personnel involved in the response including name, title and their role in the response:

F. NOTES

G. NOTIFICATION DETAILS

CalOES contacted date and time (if applicable):

CalOES Control Number (if applicable):

Spoke to:

This form prepared by: NAME: TITLE: DATE:

This form reviewed by: NAME: TITLE: DATE:

Place completed form in Sewer Overflow Envelope and follow routing instructions.

**Sanitary Sewer Overflow Response Packet
Start Time Determination Form**

SSO Start Date: _____ Location: _____

Accurate start time determination is an essential part of SSO volume estimation. Depending on the flow rate, being even one minute off can have a huge impact on the volume estimation. Be as precise as possible. Do not round to quarter hour increments. Start time must be based on all available information (interviews with neighbors, emergency responders, etc.)

What time was the City notified of the SSO? _____ AM PM

Who notified the City? _____

Did they indicate what time they noticed the SSO? YES NO If yes, what time? _____ AM PM

Who at the City received the notification? _____

What time did the crew arrive at the site of the SSO? _____ AM PM

Who was interviewed regarding the start time of the SSO? Include their name, contact information, and the statement they provided:

Name	Contact Information	Statement
_____	_____	_____
_____	_____	_____
_____	_____	_____

Describe in detail how you determined the start time for this particular SSO:

SSO Start Date: _____ SSO Start Time: _____ AM PM

SSO End Date: _____ SSO End Time: _____ AM PM

SSO Duration: _____ **minutes**

This form completed by:

Name: _____ Signature: _____

Job Title: _____ Date: _____

**Sanitary Sewer Overflow Response Packet
Volume Estimation: Eyeball Estimation Method**

Use this method only for small SSOs of less than 200 gallons.

SSO Date: _____ Location: _____

STEP 1: Position yourself so that you have a vantage point where you can see the entire SSO.

STEP 2: Imagine one or more buckets or barrels of water tipped over. Depending on the size of the SSO, select a bucket or barrel size as a frame of reference. It may be necessary to use more than one bucket/barrel size.

STEP 3: Estimate how many of each size bucket or barrel it would take to make an equivalent spill. Enter those numbers in Column A of the row in the table below that corresponds to the bucket/barrel sizes you are using as a frame of reference.

STEP 4: Multiply the number in Column A by the multiplier in Column B. Enter the result in Column C.

	A	B	C
Size of bucket(s) or barrel(s)	How many of this size?	Multiplier	Estimated SSO Volume (gallons)
1 gallon water jug		x 1 gallons	
5 gallon bucket		x 5 gallons	
32 gallon trash can		x 32 gallons	
55 gallon drum		x 55 gallons	
Other: _____ gallons		x _____ gallons	
Estimated Total SSO Volume:			

STEP 5: Is rainfall a factor in the SSO? Yes No

If yes, what volume of the observed spill volume do you estimate is rainfall? _____ gallons

If yes, describe how you determined the amount of rainfall in the observed spill?

STEP 6: Calculate the estimated SSO volume by subtracting the rainfall from the SSO volume:

_____ gallons – _____ gallons = _____ gallons
 Estimated SSO Volume Rainfall **Total Estimated SSO Volume**

Do you believe that this method has estimated the entire SSO? Yes No

If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:

Name: _____ Signature: _____
 Job Title: _____ Date: _____

Sanitary Sewer Overflow Response Packet
Volume Estimation: Duration and Flow Rate Comparison Method

SSO Date: _____ Location: _____

STEP 1: Compare the SSO to reference images on Side 2 to estimate flow rate of the current overflow. Describe which reference photo(s) were used and any additional factors that influenced applying the reference photo data to the actual SSO:

Flow Rate Based on Photo Comparison: _____ gallons per minute (gpm)

STEP 2: Complete the **Start Time Determination Form** to provide a detailed description of how start time was determined. Copy the SSO Duration from the Start Time Determination Form here:

SSO Duration: _____ minutes

STEP 3: Multiply the flow rate by the SSO duration to calculate the estimated SSO volume.

$$\frac{\text{_____ gpm}}{\text{Flow Rate}} \times \frac{\text{_____ minutes}}{\text{SSO Duration}} = \frac{\text{_____ gallons}}{\text{Estimated SSO Volume}}$$

STEP 4: Did the SSO occur during a period of consistent flow in this portion of the system? Yes No
If no, explain how, based on this portion of the collection system and its users, you believe it may have impacted the estimated SSO volume:

By what percentage are you adjusting the estimation? increase decrease _____ %

Translate the percentage into gallons: _____ gallons

STEP 5: Calculate the adjusted SSO volume estimate:

$$\frac{\text{_____ gallons}}{\text{Estimated SSO Volume}} + \text{or} - \frac{\text{_____ gallons}}{\text{Adjustment}} = \frac{\text{_____ gallons}}{\text{Estimated SSO volume}}$$

Do you believe that this method has estimated the entire SSO? Yes No
If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:

Name: _____ Signature: _____
Job Title: _____ Date: _____



Sanitary Sewer Overflow Response Packet
Volume Estimation: Duration and Flow Rate Comparison Method

IMPORTANT NOTE:

These photographs are provided as examples only and will change with many factors.

SSCSC Manhole Overflow Gauge

CWEA Southern Section Collections Systems Committee
Overflow Simulation courtesy of Eastern Municipal Water District

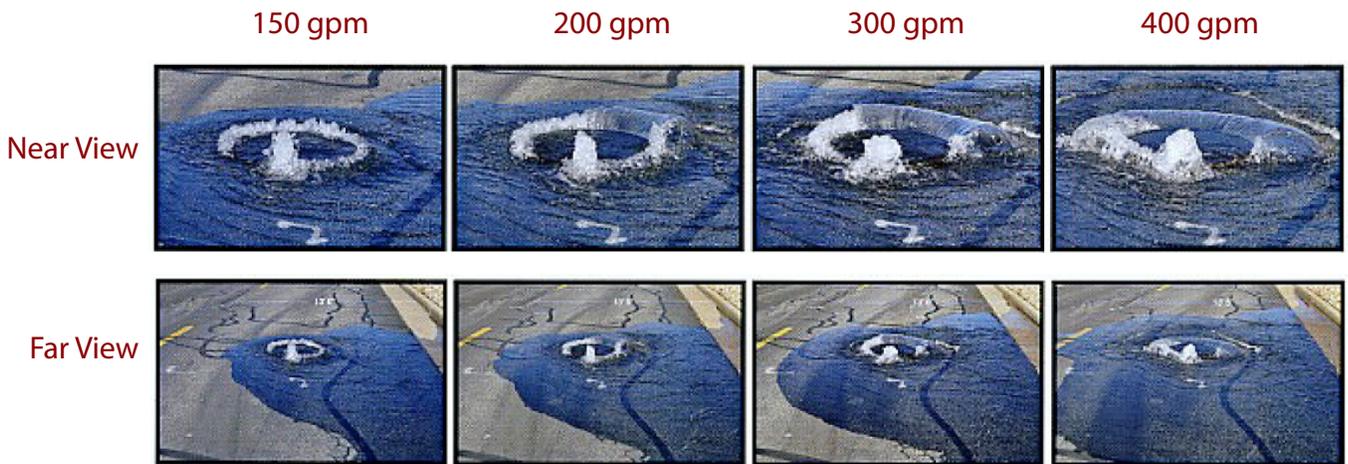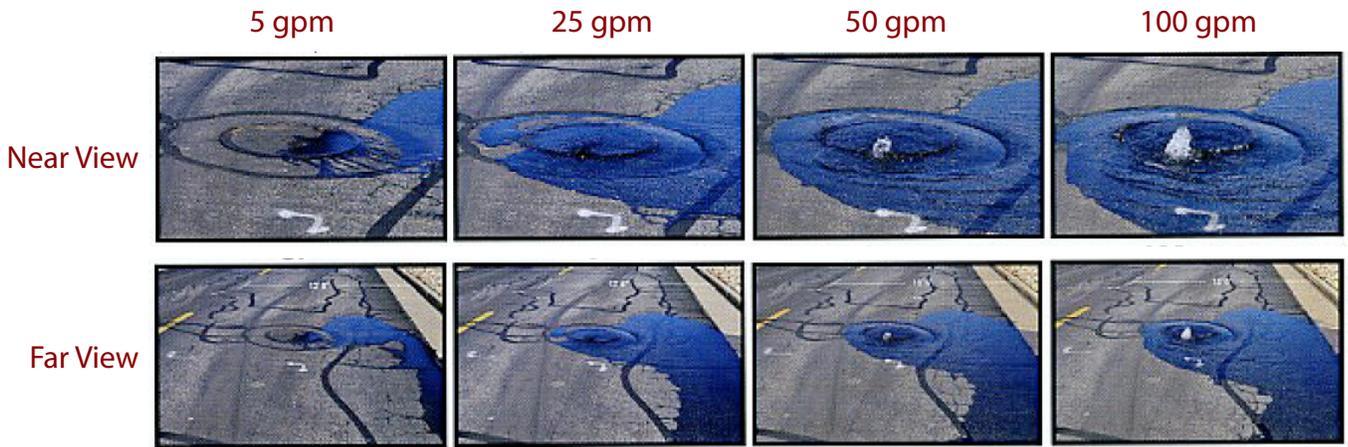

**Sanitary Sewer Overflow Response Packet
Volume Estimation: Upstream Lateral Connections Method**

SSO Date: _____ Location: _____

STEP 1: Determine the number of Equivalent Dwelling Units (EDUs) for this SSO: _____ EDUs
NOTE: A single-family residential home = 1 EDU. For commercial buildings, refer to agency documentation.

STEP 2: This volume estimation method utilizes daily usage data based on flow rate studies of several jurisdictions in California. Column A shows how an average daily of usage of 180 gallons per day is distributed during each 6-hour period. Adjust the table as necessary to accurately represent the actual data.

Complete Column E by entering the number of minutes the SSO was active during each 6-hour time period. Multiply column D times Column E to calculate the gallons spilled during each time period. Add the numbers in Column F together for the Total Estimated SSO Volume per EDU.

Time Period	Flow Rate Per EDU				SSO	
	A	B	C	D	E	F
	Gallons per Period	Hours per period	A ÷ B = Gallons per Hour	C ÷ 60 = Gallons per Minute	Minutes SSO was active during period	D × E = Gallons spilled per period
6am-noon	72	6	12	0.20		
noon-6pm	36	6	6	0.10		
6pm-midnight	54	6	9	0.15		
midnight-6am	18	6	3	0.05		
Total Estimated SSO Volume per EDU:						

STEP 3: Multiply the Estimated SSO Volume per EDU from Step 2 by the number of EDUs from Step 1.

$$\frac{\text{gallons}}{\text{Volume per EDU}} \times \frac{\text{\# of EDUs}}{\text{\# of EDUs}} = \frac{\text{gallons}}{\text{Estimated SSO Volume}}$$

STEP 4: Adjust SSO volume as necessary considering other factors, such as activity that would cause a fluctuating flow rate (doing laundry, taking showers, etc.). Explain rationale below and indicate adjusted SSO estimate (attach a separate page if necessary):

Estimated SSO Volume: _____ gallons

Do you believe that this method has estimated the entire SSO? Yes No

If no, you MUST use additional methods to estimate the entire SSO. If yes, it is advisable to use additional methods to support the estimation. Explain why you believe this method has/has not estimated the entire SSO:

This worksheet completed by:

Name: _____ Signature: _____
Job Title: _____ Date: _____

**Sanitary Sewer Overflow Response Packet
Lateral CCTV Report**

PLEASE COMPLETE AS THOROUGHLY AS POSSIBLE

PERSON COMPLETING THIS FORM:		DATE:
		PHONE:
CAMERA TYPE:	LOCATION OF CAMERA ENTRY:	
AFFECTED PROPERTY STREET ADDRESS:	LOCATION OF CAMERA STOP:	
CITY, STATE AND ZIP:	DESCRIBE AREA TV'd:	
PHONE	UPSTREAM MANHOLE #:	
PLEASE CHECK ALL THAT WERE DISCOVERED – <i>Describe Extent & Location Using Camera Entry Point As Reference:</i>		TIME OF OVERFLOW:
<input type="checkbox"/> Broken Lateral – Describe: Depth:		TIME BLOCKAGE RELIEVED:
<input type="checkbox"/> Roots – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		TIME LATERAL TV'd:
<input type="checkbox"/> Grease – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		DEPTH OF LATERAL:
<input type="checkbox"/> Sag – Describe: Depth:		RECOMMENDED FOLLOW UP WORK ACTIONS:
<input type="checkbox"/> BPD – Describe: Location:		
<input type="checkbox"/> Cleanout – Describe: Location:		
<input type="checkbox"/> Joint/Junction – Describe: Depth:		
<input type="checkbox"/> Grade – Describe:		
<input type="checkbox"/> Grit – Severity: <input type="checkbox"/> Light <input type="checkbox"/> Moderate <input type="checkbox"/> Heavy		
<input type="checkbox"/> Other – Describe:		
Mark for USA location? <input type="checkbox"/> Yes <input type="checkbox"/> No	Lateral Locations Marked in Green Paint? <input type="checkbox"/> Yes <input type="checkbox"/> No	
SIGNATURE OF EMPLOYEE PERFORMING TV WORK:		DATE

If applicable, place completed form in Sewer Backup Packet and follow routing instructions.

**Sanitary Sewer Overflow Response Packet
Collection System Failure Analysis**

To be completed by Wastewater Operations Manager or Designee

Incident Report #		Prepared By	
SSO/Backup Information			
Event Date/Time		Address	
Volume Spilled		Volume Recovered	
Cause			
Summary of Historical SSOs/Backups/Service Calls/Other Problems			
Date	Cause	Date Last Cleaned	Crew
Records Reviewed By:		Record Review Date:	
Summary of CCTV Information			
CCTV Inspection Date		Tape Name/Number	
CCTV Tape Reviewed By		CCTV Review Date	
Observations/Recommendations:			

Go to Side B

Sanitary Sewer Overflow Response Packet
Collection System Failure Analysis

Recommendations					
✓	Type	Specific Actions	Who is Responsible?	Completion Deadline	Who Will Verify Completion?
	No Changes or Repairs Required	n/a	n/a	n/a	n/a
	Repair(s)				
	Construction				
	Capital Improvement(s)				
	Change(s) to Maintenance Procedures				
	Change(s) to Overflow Response Procedures				
	Training				
	Misc.				
Comments/Notes:					
Review Date:					

Overflow Emergency Response Plan
Public Posting

DANGER

RAW SEWAGE • AVOID CONTACT



PELIGRO

AGUA CONTAMINADA • EVITE TODO CONTACTO

For more information

Para mas informacion

City of Brentwood

(925) 516-6060

City of Brentwood

On (date) _____, at (location)

_____,
we responded to a reported blockage of the
sanitary sewer service to your property.

We discovered a blockage in:

- The sanitary sewer main and cleared the line
- The City-maintained portion of your sanitary sewer lateral and cleared the line.
- Your portion of the sanitary sewer lateral, which is your responsibility to maintain. We also found the City’s portion of the lateral and the main to be flowing normally.

If you require assistance to clear your portion of the lateral you can look in the Yellow Pages of your telephone book under “Sewer Contractors” or “Plumbing Drains & Sewer Cleaning”. If you plan to hire a contractor we recommend getting estimates from more than one company.

City of Brentwood representative notes: _____

City of Brentwood Representative: _____

For questions or comments, please call

**City of Brentwood
(925) 516-6060**

City of Brentwood

En (fecha) _____, en (localización)

respondimos a una obstrucción divulgada del
servicio de alcantarillado sanitario de su propiedad.

Descubrimos un bloqueo en:

- El alcantarillado sanitario principal y despejé la línea
- Porción mantenidos por la ciudad de su lateral de alcantarillado sanitario y despejé la línea.
- Lateral su porción del alcantarillado sanitario, que es su responsabilidad de mantener. También encontramos parte de la ciudad de los laterales y el principal a ser fluir normalmente.

Si necesita asistencia para despejar su porción del lateral puede buscar en Internet o en la guía telefónica bajo "Alcantarillado contratistas" o "Fontanería drenajes & alcantarillado limpieza". Si usted planea contratar a un contratista le recomendamos obtener estimaciones de más de una empresa.

Notas representativos de la ciudad:


Representante de la ciudad: _____

**Para preguntas o comentarios,
por favor llame a**

**Ciudad de Brentwood
(925) 516-6060**

How a Sewer System Works

A property owner's sewer pipes are called **service laterals** and are connected to larger local main and regional trunk lines. Service laterals run from the connection at the home to the connection with the public sewer. These laterals are the responsibility of the property owner and must be maintained by the property owner.

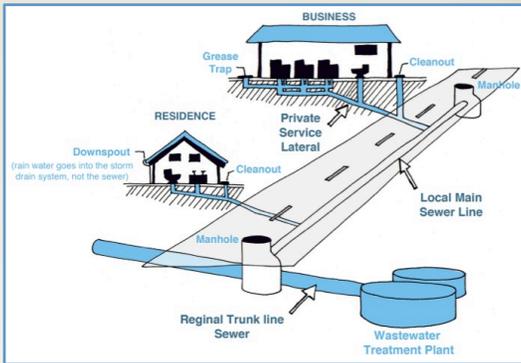


Is my home required to have a backflow prevention device?

Section 710.1 of the Uniform Plumbing Code (U.P.C.) states: "Drainage piping serving fixtures which have flood level rims located below the elevation of the next upstream manhole cover or private sewer serving such drainage piping **shall** be protected from backflow of sewage by installing an approved type of backwater valve."

The intent of Section 710.1 is to protect the building interior from mainline sewer overflows or surcharges.

Additionally, U.P.C. 710.6 states: "Backwater valves **shall** be located where they will be accessible for inspection and repair at all times and, unless continuously exposed, shall be enclosed in a masonry pit fitted with an adequately sized removable cover."

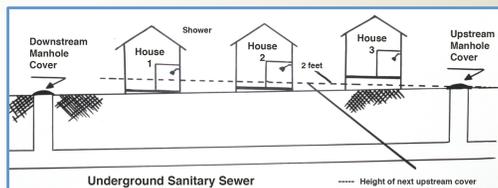

If you have a sewage spill from your private sewer line that impacts storm drains, waterways or public property, contact:

City of Brentwood
(925) 516-6060

Contra Costa Health Services
(925) 692-2500

California Health and Safety Code, Sections 5410-5416 requires:

- No person shall discharge raw or treated sewage or other waste in a manner that results in contamination, pollution, or a nuisance.
- Any person who causes or permits a sewage discharge to any state waters:
 - Must immediately notify the local health agency of the discharge.
 - Shall reimburse the local health agency for services that protect the public's health and safety.
 - Who fails to provide the required notice to the local health agency is guilty of a misdemeanor and shall be punished by a fine (between \$500-\$1,000) and/or imprisonment for less than one year.

Central Valley Regional Water Quality Control Board
(916) 464-3291

Requires the prevention, mitigation, response to, and reporting of sewage spills.

California Governor's Office of Emergency Services (CalOES)
(800) 852-7550

California Water Code, Article 4, Chapter 4, Sections 13268-13271 & California Code of Regulations, Title 23, Division 3, Chapter 9.2, Article 2, Sections 2250-2260 require:

- Any person who causes or permits sewage in excess of 1,000 gallons to be discharged to state waters shall immediately notify the Office of Emergency Services.
- Any person who fails to provide the notice required by this section is guilty of a misdemeanor and shall be punished by a fine (less than \$20,000) and/or imprisonment for not more than one year.

Sewer Spill Reference Guide

Your Responsibilities as a Private Property Owner

Provided to you by:

City of Brentwood

**2251 Elkins Way
Brentwood, CA 94513**

(925) 516-6060

Copyright © 2004-2014
DKF Solutions Group
All rights reserved.

How do sewage spills happen?

Sewage spills occur when the wastewater in underground pipes overflows through a manhole, cleanout, or broken pipe. Most spills are relatively small and can be stopped and cleaned up quickly, but left unattended they can cause health hazards, damage to homes and businesses, and threaten the environment, local waterways, and beaches.

CAUTION!

When trying to locate a sewer problem, never open manholes or other public sewer structures. Only our crews are allowed to open & inspect these structures.

Common causes of sewage spills

- Grease build-up
- Tree roots
- Broken/cracked pipes
- Missing or broken cleanout caps
- Undersized sewers
- Groundwater/rainwater entering the sewer system through pipe defects and illegal connections

Prevent most sewage backups with a Backflow Prevention Device

This type of device can help prevent sewage backups into homes and businesses. If you don't already have a Backflow Prevention Device, contact a professional plumber or contractor to install one as soon as possible.

Protect the environment!

If you let sewage from your property discharge to a gutter or storm drain, you may be subject to penalties and/or out-of-pocket costs for clean-up and enforcement efforts. A property owner may be charged for costs incurred by agencies responding to spills from private properties.

What to look for:

Sewage spills can be a very noticeable gushing of water from a manhole or a slow water leak that may take time to be noticed. Don't dismiss unaccounted-for wet areas. Look for:

- Drain backups inside the building.
- Wet ground and/or water leaking around manhole lids onto your street.
- Leaking water from cleanouts or outside drains
- Unusual odorous wet areas: sidewalks, external walls, ground/landscape around a building.

The following are indicators of a possible obstruction in your sewer line:

- Water comes up in floor drains, showers or toilets.
- Toilets, showers or floor drains below ground level drain very slowly.

What to do if there is a spill:

Immediately notify the City of Brentwood. Our crews locate the blockage and determine if it is in the public sewer; if it is the crew removes the blockage and arranges for cleanup. If the backup is in your private internal plumbing or in the private service laterals, you are required to immediately:

- Control and minimize the spill by shutting off or not using the water
- Keep sewage out of the storm drain system using sandbags, dirt and/or plastic sheeting
- Call a plumbing professional to clear blockages and make repairs as needed. Look in the yellow pages under "Plumbing Drain & Sewer Cleaning" or "Sewer Contractors."
- Always notify your sewer/public works department or public sewer district of sewage spills.

Spill cleanup inside the home:

For large clean ups, a professional cleaning firm should be contacted to clean up impacted areas. You can locate local firms by looking in the Yellow Pages under "Water Damage" or "Fire Damage." If you hire a contractor, it is recommended to get estimates from more than one company. Sometimes, homeowner's insurance will pay for the necessary cleaning due to sewer backups. Not all policies have this coverage, so check with your agent.

If you decide to clean up a small spill inside your home, protect yourself from contamination by observing the following safety measures. Those persons whose resistance to infection is compromised should not attempt this type of clean up.

Other Tips:

- Keep children and pets out of the affected area until cleanup has been completed.
- Turn off heating/air conditioning systems
- Wear rubber boots, rubber gloves, and goggles during cleanup of the affected area.
- Discard items that cannot be washed and disinfected (such as: mattresses, rugs, cosmetics, baby toys, etc.)
- Remove and discard drywall and insulation that has been contaminated with sewage or flood waters.

- Thoroughly clean all hard surfaces (such as flooring, concrete, molding, wood and metal furniture, countertops, appliances, sinks and other plumbing fixtures) with hot water and laundry or dish detergent.
- Help the drying process with fans, air conditioning units, and dehumidifiers.
- After completing cleanup, wash your hands with soap and water. Use water that has been boiled for 1 minute (allow the water to cool before washing your hands) OR use water that has been disinfected (solution of 1/8 teaspoon of household bleach per 1 gallon of water). Let it stand for 30 min. If water is cloudy, use ¼ teaspoon of household bleach per 1 gallon of water.
- Wash clothes worn during cleanup in hot water and detergent (wash apart from uncontaminated clothes).
- Wash clothes contaminated with sewage in hot water and detergent. Consider using a Laundromat until your onsite wastewater system has been professionally inspected and serviced.
- Seek immediate attention if you become injured or ill.

Spill cleanup outside the home:


- Keep children and pets out of the affected area until cleanup has been completed.
- Wear rubber boots, rubber gloves, and goggles during cleanup of affected area.
- Clean up sewage solids (fecal material) and place in properly functioning toilet or double bag and place in garbage container.
- On hard surfaces areas such as asphalt or concrete, it is safe to use a 2% bleach solutions, or ½ cup of bleach to 5 gallons of water, but don't allow it to reach a storm drain as the bleach can harm the environment.
- After cleanup, wash hands with soap and water. Use water that has been boiled for 1 minute (allow to cool before washing your hands) OR use water that has been disinfected (solution of 1/8 teaspoon of household bleach per 1 gallon of water). Let it stand for 30 min. If water is cloudy, use ¼ teaspoon of household bleach per 1 gallon of water.
- Wash clothes worn during cleanup in hot water and detergent (wash apart from uncontaminated clothes).
- Wash clothes contaminated with sewage in hot water and detergent. Consider using a Laundromat until your onsite wastewater system has been professionally inspected and serviced.
- Seek immediate attention if you become injured/ill.

Appendix D
FIELD SAMPLING KIT

**Field Sampling Kit
Table of Contents**


<u>Form</u>	<u>Form Number</u>
Procedures for Sampling Receiving Waters and Posting Warnings after a Sewage Spill	D-1
Sample Collection Chain of Custody Record	-2

**Field Sampling Kit
Procedures for Sampling Receiving Waters and Posting Warnings after a Sewage Spill**

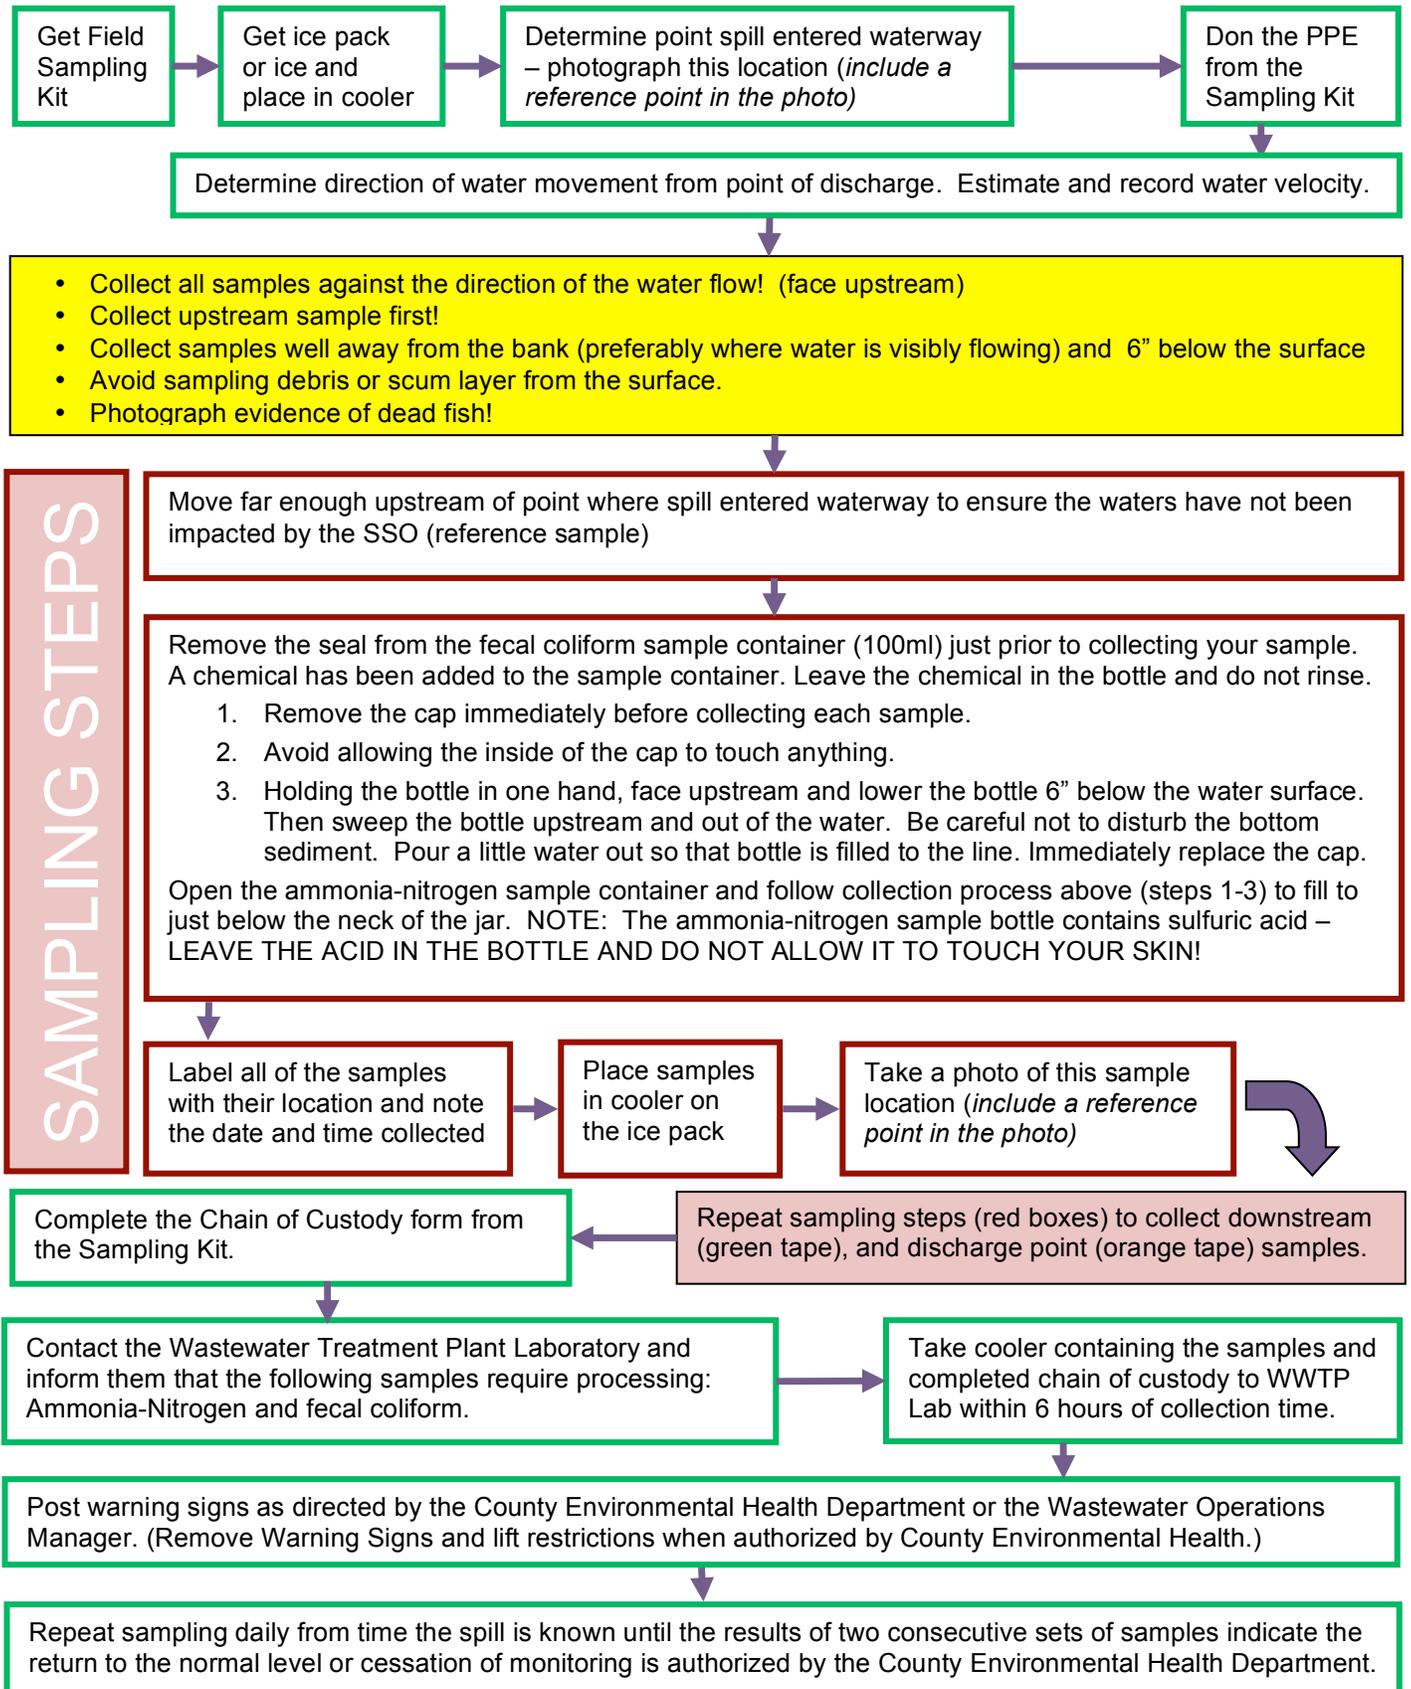

**Field Sampling Kit
Procedures for Sampling Receiving Waters after a Sewage Spill**

This example is provided for illustrative purposes *only!* Base each sampling event on the geography, drainage and interference factors (i.e. *birds, animals, runoff, etc.*) of the area impacted. Consult the Wastewater Operations Manager or Wastewater Treatment Plant Laboratory as needed.

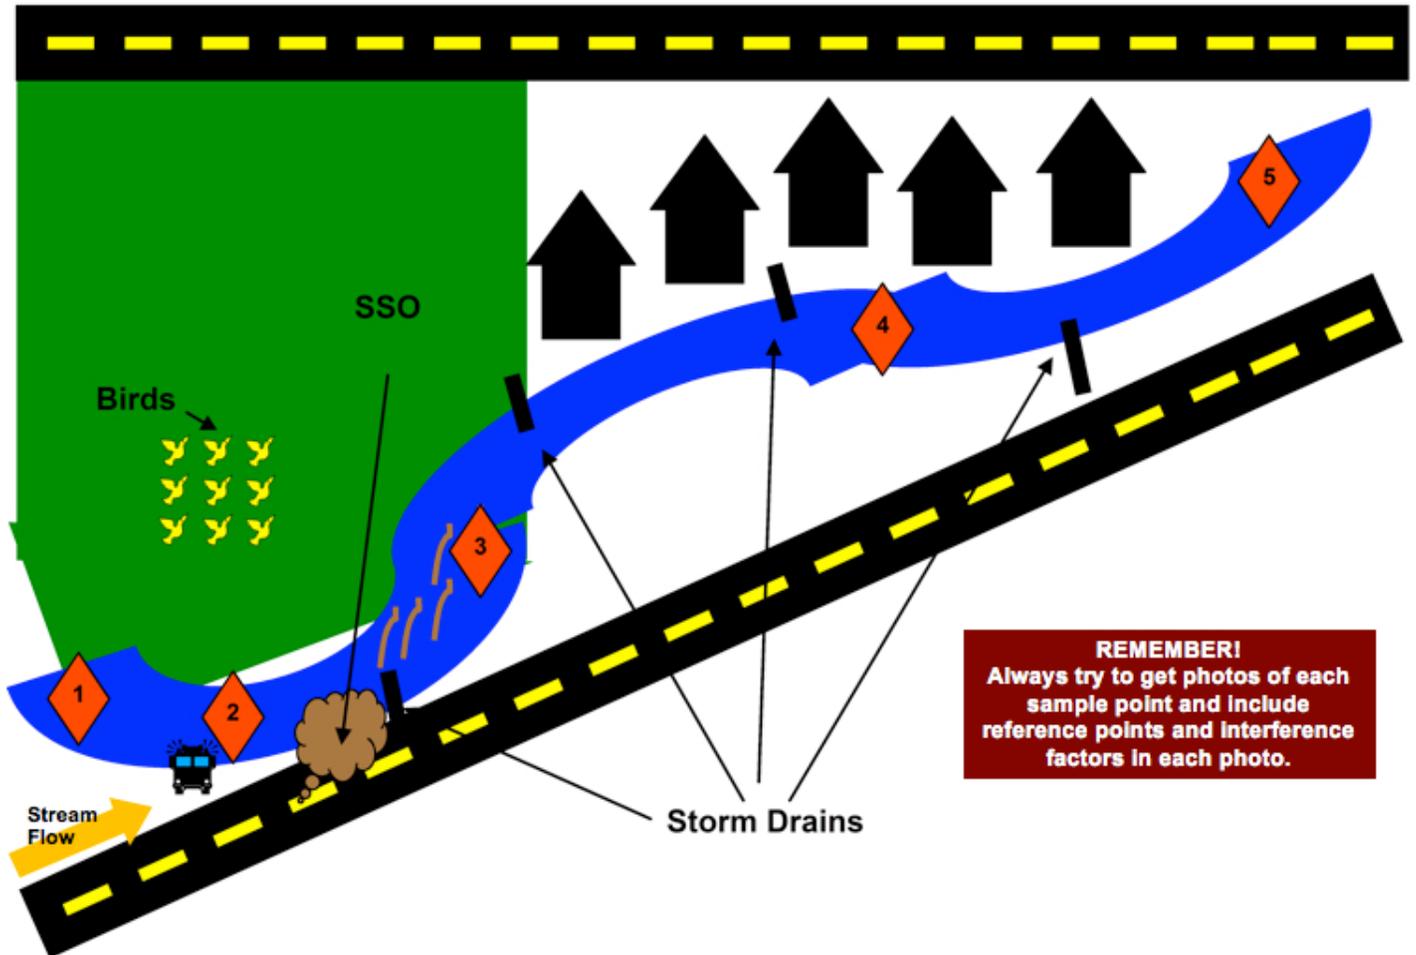

- 1 Sample Location 1: Baseline Sample, no observable interference from birds, animals, runoff, etc
- 2 Sample Location 2: Baseline Sample, observable interference from birds, animals, runoff, etc
NOTE: Only collect this sample if you observe any possible interfering factors upstream from the spill location
- 3 Sample Location 3: Immediately downstream of SSO entry point
- 4 Sample Location 4: Further downstream of SSO entry point – note any possible interfering factors
- 5 Sample Location 5: Further downstream of SSO entry point – note any possible interfering factors

**Field Sampling Kit
Sample Collection Chain of Custody Record**

Customer Name		<input type="checkbox"/>	Hazardous Waste	PO#	
Customer Address		<input type="checkbox"/>	Unknown Material	WO#	
Customer Telephone		Mail Code		CONTRACT LAB INFORMATION	
Program Name				Turnaround Requirement	
Lab Program Coordinator		Phone #		Ship to:	<input type="checkbox"/> Normal (21 days)
Sampled By				Ship Date:	<input type="checkbox"/> Rush: _____
				Courier:	<input type="checkbox"/> Other: _____

LIMS# (Issued by Lab)	SAMPLE COLLECTION INFORMATION							# Containers	Matrix*	Analysis Requested					QA/QC Requirements	
	Date	Time	Type		Sample Location	Field pH	Field Temp			Ammonia	Enterococcus				<input checked="" type="checkbox"/>	Lab Standard
			Composite	Grab											<input type="checkbox"/>	Special (see attached)
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Upstream			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Remarks/Notes	
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Entry Point			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Downstream			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		

*Matrix: P = Potable Water, W = Wastewater, A = Ambient Water, G = Groundwater, S = Soil, B = Biosolids, I = Industrial, O = Other (specify in remarks)

Relinquished	Date	Time

Relinquished to	Date	Time

Transport/Shipping Information		
<input type="checkbox"/> USPS	<input type="checkbox"/> UPS	<input type="checkbox"/> FedEx
Tracing #:		
<input type="checkbox"/> Other:		


Sample Receiving Documentation

Container intact? <input type="checkbox"/> Yes <input type="checkbox"/> No	Correct container? <input type="checkbox"/> Yes <input type="checkbox"/> No	Field preserved? <input type="checkbox"/> Yes <input type="checkbox"/> No	Custody tape intact? <input type="checkbox"/> Yes <input type="checkbox"/> No
Cooled? <input type="checkbox"/> Yes <input type="checkbox"/> No	Temp. Blank? <input type="checkbox"/> Yes <input type="checkbox"/> No (°C)	Comments:	
Sample distribution: <input type="checkbox"/> Lab bench <input type="checkbox"/> Ice chest <input type="checkbox"/> Walk-in cooler shelf #		Disposal Date:	Disposed by: (inits.)
C-O-C Distribution	Date: By:	<input type="checkbox"/> Lab Admin File <input type="checkbox"/> Prog/proj Mgr. <input type="checkbox"/> Lab Prog. Coord.	<input type="checkbox"/> Delivery courier <input type="checkbox"/> Pick-up courier

Appendix E
CONTRACTOR ORIENTATION

CONTRACTOR ORIENTATION

The following procedures are to be followed in the event that you cause or witness a Sanitary Sewer Overflow.

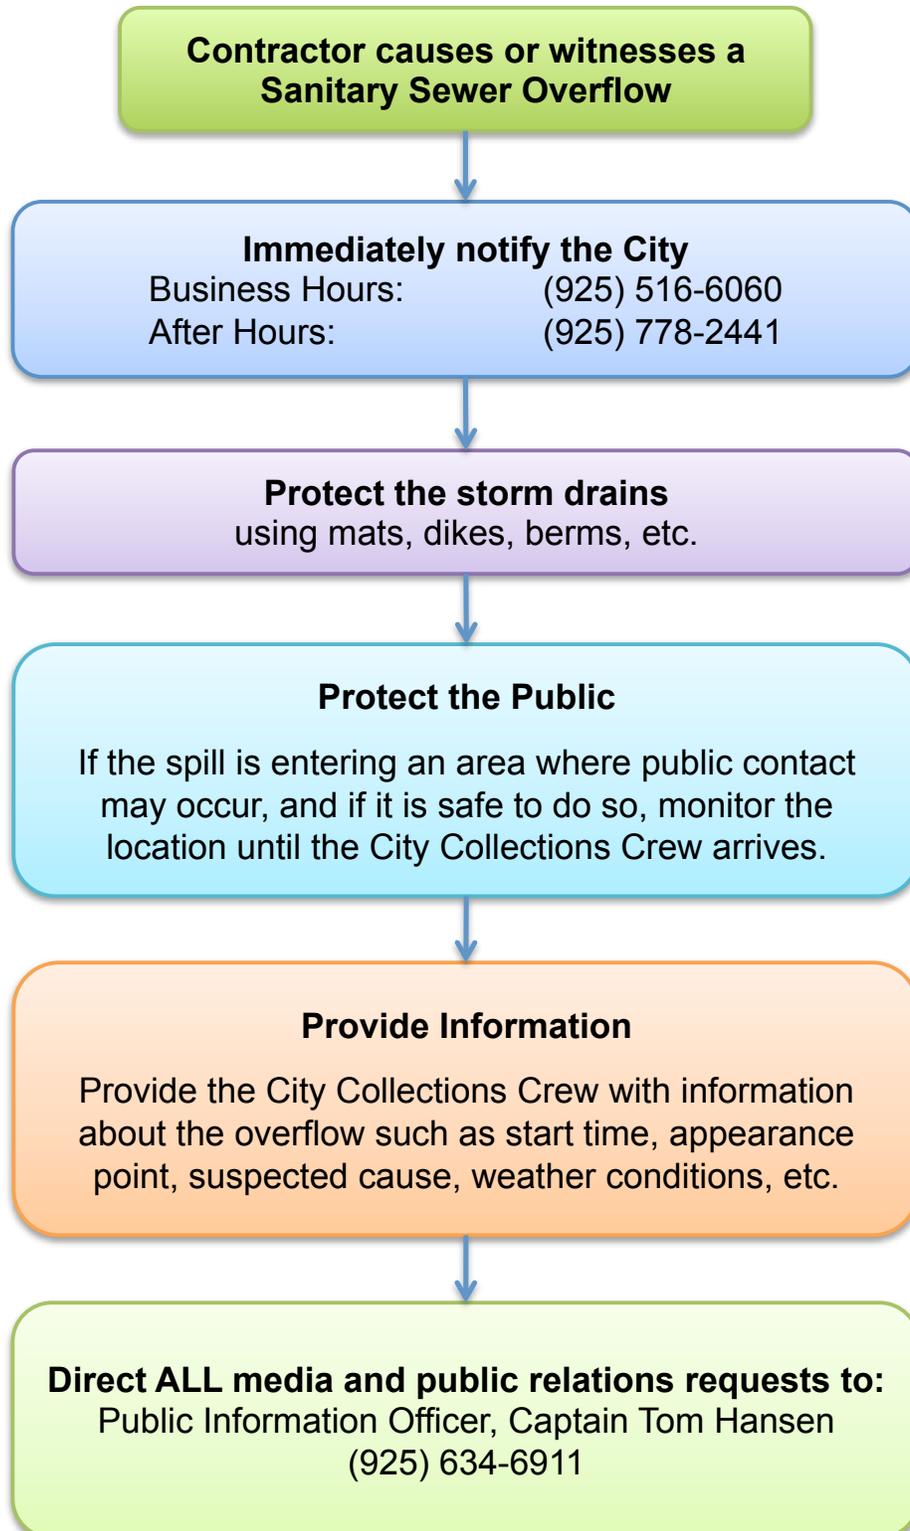

Sanitary Sewer Overflows

How to avoid them and what to do if you don't

What? A sanitary sewer overflow (SSO) is a discharge of untreated human and industrial waste before it reaches the wastewater treatment facility.

Where? SSOs usually occur through manholes, plumbing fixtures and service cleanouts.

Why? SSOs are usually caused by grease, debris, root balls, or personal hygiene products blocking the sewer lines, or by unusually high flow volume.

How to prevent SSOs:

...when clearing plugged sewer laterals:

- Remove root balls, grease blockages and any other debris from the sewer
- If you can't prevent root balls, grease or debris from entering the sewer main, call us at (925) 516-6060, so we can work with you to remove the blockage and prevent blockages further downstream
- Use plenty of water to flush lines.

...when constructing or repairing sewer laterals:

- Contact the Permit Center at (925) 516-5420 for a permits, lateral specifications and main lines inspections.
- Check your work area. Make sure there is no debris left in the sewer line before you backfill.
- Avoid offset joints, which may make sewer lines vulnerable to root intrusion and grease or debris accumulation. Properly bed your joints and don't hammer tap.

If you cause or witness an SSO, immediately contact:

City of Brentwood

(925) 516-6060

City of Brentwood

2251 Elkins Way
Brentwood, California 94513

www.brentwoodca.gov/gov/pw/sewer

Appendix F
SEWER SERVICE REQUEST FORM

Sewer Service Request Form

CITY NOTIFIED BY	Name: Check here if notification was anonymous <input type="checkbox"/>	DATE:
	Telephone:	TIME:
	Address:	
	If notification was received other than by telephone, describe method of communication:	
CALL RECEIVED BY	Name:	CHECK ONE: <input type="checkbox"/> Complaint <input type="checkbox"/> Emergency <input type="checkbox"/> Other:
	Job Title:	
ADDRESS OF POTENTIAL PROBLEM:		LOCATION OF POTENTIAL PROBLEM: <input type="checkbox"/> Street <input type="checkbox"/> Easement <input type="checkbox"/> Backyard <input type="checkbox"/> Other:
WHEN DID THE CALLER NOTICE THE PROBLEM? (date and time)		
DID THE CALLER INDICATE THAT THE SSO MAY HAVE REACHED WATERS OF THE STATE? <input type="checkbox"/> YES – Describe: <input type="checkbox"/> NO		
WHAT HAS THE CALLER OBSERVED? (e.g., odor, duration, location on property, known impacts, indication if surface water impacted, appearance at cleanout or manhole):		
IS THE INCIDENT IN THE CITY'S SERVICE AREA? <input type="checkbox"/> YES <input type="checkbox"/> NO – indicate responsible agency:		WAS A CREW DISPATCHED? <input type="checkbox"/> YES - indicate date and time: <input type="checkbox"/> NO

FORM COMPLETED BY	NOTES
NAME: JOB TITLE:	
NAME: JOB TITLE:	

6.4 Claim against the City

Anyone wishing to file a claim against the City as a result of a sewer backup or overflow can do so by submitting an insurance claim form to the City Clerks' office. The insurance claim form can be found on the City's website by following the link below:

<http://www.brentwoodca.gov/civicax/filebank/blobdload.aspx?BlobID=23045>

Element 7: FATS, OILS, AND GREASE (FOG) CONTROL PROGRAM

This section of the SSMP discusses the City of Brentwood's FOG control measures, including identification of problem areas, focused cleaning, and source control. This section fulfills the FOG Control requirements for the SWRCB (Element 7) SSMP requirements.

7.1 Regulatory Requirements for FOG Control Element

SWRCB Requirement: *The City shall evaluate its service area to determine whether a FOG control program is needed. If the City determines a FOG program is not needed, the City must provide justification for why it is not needed. If FOG is found to be a problem, the City must prepare and implement a FOG source control program to reduce the amount of these substances discharged to the sanitary sewer system. The FOG source control program shall include the following as appropriate:*

- A. An implementation plan and schedule for a public education outreach program promoting proper disposal of FOG;*
- B. A plan and schedule for the disposal of FOG generated within the sanitary sewer system service area. This may include a list of acceptable disposal facilities and/or additional facilities needed to adequately dispose of FOG generated within a sanitary sewer system service area;*
- C. The legal authority to prohibit discharges to the system and identify measures to prevent SSOs and blockages caused by FOG;*
- D. Requirements to install grease removal devices (such as traps or interceptors) design standards for the grease removal devices, maintenance requirements, BMP requirements, record keeping and reporting requirements;*
- E. Authority to inspect grease producing facilities, enforcement authorities, and whether the City has sufficient staff to inspect and enforce the FOG ordinance*
- F. An identification of sewer system sections subject to FOG blockages and establish a cleaning maintenance schedule for each section; and*
- G. Development and implementation of source control measures, for all sources of FOG discharged to the sewer system, for each sewer system section identified in (f) above.*

7.2 Element 7 Appendix

Supporting information for Element 7 is included in Appendix D. This Appendix includes the following documents:

1. List of food facilities in the City of Brentwood;
2. "Preventing Sewer Backups" public outreach information pamphlet; and
3. Residential FOG public outreach brochure.

7.3 Summary of FOG Elements Identified by the State

State Element	City of Brentwood
An implementation plan and schedule for a public education outreach program promoting proper disposal of FOG.	The City periodically reminds residents of the proper way to dispose of grease by distributing a flyer with detailed information. A routine inspection program is anticipated to be sufficient for restaurants once staffing is complete.
A plan and schedule for the disposal of FOG generated within the sanitary sewer system service area. This may include a list of acceptable disposal facilities and/or additional facilities needed to adequately dispose of FOG generated within a sanitary sewer system service area.	Currently it is the business owner's responsibility to dispose of the fats, oils, and grease and keep a manifest showing who is removing the grease, and where it is being taken.
The legal authority to prohibit discharges to the system and identify measures to prevent SSOs and blockages caused by FOG.	City of Brentwood Municipal Code includes adequate legal authority to prohibit discharges and to identify measures to prevent SSOs and blockages from FOG.
Requirements to install grease removal devices (such as traps or interceptors) design standards for the grease removal devices, maintenance requirements, BMP requirements, record keeping and reporting requirements.	City of Brentwood has a section of the Municipal Code, Ch.13.04 which meets this requirement. The Municipal code also incorporates by reference the Uniform Plumbing Code.
Authority to inspect grease producing facilities, enforcement authorities, and whether the City has sufficient staff to inspect and enforce the FOG ordinance.	The City is aware of the need to add staff to accommodate this requirement. The City's FOG ordinances are in place and adequate at this time. The FOG program will continue to be updated as needed.
An identification of sewer system sections subject to FOG blockages and establish a cleaning maintenance schedule for each section.	Over the past several years, the City of Brentwood has identified the sections of sewer in the City which are subject to FOG and has an on-going maintenance schedule, as well as frequent checks of the manholes in these areas. If any new areas with FOG concerns become apparent, they will be checked more frequently and possible added to the hotspot list.
Development and implementation of source control measures, for all sources of FOG discharged to the sewer system, for each sewer system section identified in the above section.	Known sources of FOG are required to install grease control devices. This coupled with monitoring and cleaning is currently sufficient.

7.4 FOG Control Discussion

The City has determined a FOG control program is necessary per SSMP requirements. **Approximately 120 food service facilities** are located within City limits and discharge to the City's sewer system. City staff has noted the tendency for grease buildup in specific sewer lines. This section discusses measures the City takes to control FOG.

The City's FOG control program consists of hot spot cleaning and maintenance as well as source control. The following subsections discuss identification and cleaning of grease-prone areas, legal authority to prohibit grease discharge or require a grease removal device, facility inspection, and public outreach.

7.5 Identification and Sewer Cleaning

The core means of FOG control utilized by the City is identification of trouble areas (hot-spots) or sewer lines which are prone to grease accumulation, and targeted cleaning of these areas on a regular basis.

- A. Identification of Grease Problem Areas – The City identifies potential grease problem areas by tracking locations and causes of blockages and SSOs. Also, debris type and severity are noted by maintenance crews during routine hot spot cleaning. Areas with several restaurants or grease-producing facilities are also considered likely potential grease problem areas.
- B. Hot Spot Cleaning – Approximately 7,500 feet of sewers are included in the hot spot cleaning program specifically for FOG control. Cleaning is generally done quarterly, but actual frequency depends on the history of stoppages or overflows on a line, recent inspection of lines during daily rounds, as well as areas expected to be prone to grease buildup. The City's downtown area is older and has a larger number of restaurants; so some lines in this area are cleaned more frequently than others.

When cleaning and inspecting FOG related hotspots, the Collection System workers note the date and time, manhole I.D. number, problems in line, and amount and type of debris found. This information is kept in a binder, and summarized in Maintenance Connection.

- C. Blockage Investigation – The City CCTV inspects each sewer following a blockage. If the source of the grease in a lateral or main can be identified, the City contacts that restaurant or source of the grease and takes appropriate action to eliminate the problems.

FOG that is removed from the collection system is disposed of at the WWTP by dewatering, drying, and disposing of the dried FOG via solid waste disposal.

7.6 Legal Authority

Legal measures available to the City to control sources of FOG are included in the Municipal Code, Chapter 13.04 Article 4: Grease, Oil, and Sand Interceptor Program. The City also

incorporates the Uniform Plumbing Code into the Municipal Code by reference. The Municipal Code can be accessed in its entirety via the link below:

Chapter 13.04 SEWER SYSTEM – RULES AND REGULATIONS, of the [City's Municipal Code](#)

7.7 Facility Inspections

If grease accumulation becomes too much of a burden to handle with the current practice of frequent hot-spot checks, the City will ultimately reallocate existing staff and hire additional staff to begin a facility inspection program. The City is aware of areas where a significant amount of grease is being introduced into the system. When the budget allows for a dedicated facility inspector, the inspector will be updated on the problem areas and will work with businesses to manage the problem areas with help from the collections crew. The FOG cleaning log will then be used to inspect lines as needed to verify for the inspector that restaurants are complying with regulations.

The City's obligation is to develop a relationship between the restaurants and the inspector. They must work together to accomplish a common goal of eliminating grease which is introduced to the sewer system at their location. The City will make sure the restaurants have all the information needed (Municipal Codes, etc.) to reach the common goal. A current list of food service facilities within the City is included in Appendix D.

7.8 Public Outreach

The City conducts an annual Public Works Open House where the public has the opportunity to see what the City does for the community. During this open house, staff takes the opportunity to educate the individuals attending by showing them firsthand the cleaning equipment, CCTV truck, how to avoid sewer backups at home and restaurants, as well as some educational stories which help familiarize them on what not to put in the sewer system.

The City's website <http://www.brentwoodca.gov> is another source for the public to use. The City has distributed brochures to all restaurants to help educate them on the impacts of FOG related problems and best management practices. This is all in an effort to improve Public Outreach.

7.9 FOG Enforcement Actions

There have been no FOG related enforcement actions since the SSMP was adopted in 2006.

Element 8: CAPACITY MANAGEMENT

This section of the SSMP discusses the City's capacity management measures, including the 2010 update of the Collection System Master Plan, and recommended capacity improvement projects. This section fulfills the Capacity Management SSMP requirements for the RWQCB (Element 8).

The Wastewater Collection System Master Plan was updated in 2010 to make sure growth throughout the City does not overwhelm the sewer system. Currently, the collection system is effective. There are two CIP projects identified in the current 5-year CIP schedule. These two projects include the Apple Hill Drive Sewer Diversion project, and the Marsh Creek Sewer Constriction Upgrade.

8.1 Regulatory Requirements for Capacity Management

SWRCB Requirement: *The wastewater collection system agency prepares and implements a capital improvement plan providing hydraulic capacity of key sewer system elements under peak flow conditions. This plan includes:*

- a. *Evaluation: The agency identifies actions needed to evaluate those portions of the sewer system experiencing or contributing to an SSO discharge caused by hydraulic deficiency. The evaluation provides estimates of peak flows, estimates of the capacity of key system components, hydraulic deficiencies, and the major sources which contribute to the peak flows associated with overflow events.*
- b. *Design Criteria: The agency identifies and establishes appropriate design criteria.*
- c. *Capacity Enhancement Measures: The agency identifies the steps needed to establish a short- and long-term capital improvement plan (CIP) to address identified hydraulic deficiencies including prioritization, alternatives analysis, and schedules. The CIP may include increases in pipe size, I/I reduction programs, increases and redundancy in pumping capacity, and storage facilities. The CIP includes an implementation schedule and identifies sources of funding.*
- d. *Schedule: The agency develops a schedule of completion dates for all portions of the CIP developed in (a) through (c) above. This schedule is reviewed and updated at least every five years.*

8.2 Capacity Evaluation Discussion

A Wastewater Collection System Master Plan was prepared for the City in 2001 following adoption of the 2001 City of Brentwood General Plan Update of the General Plan adopted in 1993. The Wastewater Collection System Master Plan was updated in 2006 to evaluate the areas of development and forecast wastewater system flow conditions with build-out occurring in the year 2021, and again in 2010.

The capacity assessment completed in 2006 was reviewed by City staff, and updated further to be integrated into the City's Sewer System Base Maps, with identification of the capacity and flow rates in each of the City's Interceptor and Trunk Sewers. The capacity

assessment completed as part of the City's Sewer Master Plan Update was based on hydraulic modeling of the collection system with future design flows. The 2010 update identified nine CIP projects which are necessary to upgrade or expand the sewer collection system. The following sub-sections provide a brief summary of the modeled system, flow estimates, and evaluation criteria used for the City's sewer system capacity evaluation.

The City has not experienced any sanitary sewer overflows caused by hydraulic deficiencies in the sewer system. Likewise, modeling of the sewer system conducted during preparation of the 2010 Collection System Analysis Update showed no overflow due to hydraulic deficiencies.

8.2.1 Hydraulic Model

Hydraulic modeling of the wastewater collection system was performed for the 2006 Update using the H₂OMap Sewer computer software. The hydraulic model update of the wastewater system was based on the 2006 hydraulic model, and analyzed the wastewater system conditions through the use of City maps, available as-built drawings and aerial imagery.

A City staff review of the 2006 update capacity assessment found discrepancies with respect to flows and tributary areas significant enough to warrant revising the model and re-analyzing the improvement recommendations for completion of the master plan. The unit flow and peaking factors the 2006 Plan used for dry weather factors were very high compared to actual flows measured at the Treatment Plant, indicating lower dry weather factors are more appropriate for city-wide planning. Significant discrepancies between the Update report description of the design flows and actual model configuration found the need for more accurate flow loadings supported by geographic and existing system information.

A new hydraulic model was created in 2009 to correct trunk and interceptor sewer pipeline system discrepancies, eliminate small pipe diameter pipes from the network, correct odd changes in pipe diameters, and correct adverse pipe slopes. The 2010 Update developed system improvements based on the City's Design Criteria for designing new pipes and improvements for new developments instead of analyzing the system for operation under normal conditions of pipes flowing full, or analyzing for minor surcharges in the system.

Flow generation factors and peaking factors for Peak Dry Weather and Peak Wet Weather flows were developed based on recorded flows at the Wastewater Treatment Plant, and the water usage information generated for the Water System Master Plan prepared for the City in 2010.

8.2.2 Flow Estimates

Future flows were estimated based on the City's General Plan 2001-2021. Flows were estimated based on a combination of land use and land use flow factors adjusted based on comparisons to flow monitoring and water use data developed for the 2010 Water System Master Plan.

8.2.3 Capacity Evaluation Criteria

The capacity evaluation criteria used in the Master Plan are summarized below.

Flow Criteria. System capacity was evaluated under future peak wet weather flows. Wet weather flow monitoring from pumping records at the Wastewater Treatment Plant provide information needed to develop the factors for Peak Dry Weather Flow, and Peak Wet weather Flow plus inflow and infiltration.

Gravity Pipe Criteria. A pipe was considered to be deficient in capacity if the hydraulic model predicted it would surcharge during peak wet weather flow conditions with a flow greater than the capacity of the pipe. Pipes surcharged due to backwater were not considered to be deficient in capacity.

8.2.4 Capacity Evaluation Results

Further analysis of capacity limitations as future development occurs will include options for installing parallel sewer mains, installing connections to relief sewers, and main replacement with larger diameter pipe. These improvements will be evaluated with each new development proposal.

Gravity Pipe Capacity Limitations Reaches of gravity pipe were identified as needing additional monitoring and evaluation along Balfour Road, San Jose Avenue and Lone Tree Way. No surcharging of the system under current conditions has been identified.

Pump Station Evaluations The Sellers Avenue Lift Station on the east side of the City was recently upgraded with new pumps and controls with sufficient capacity to serve its tributary area including future growth. A second lift station at the end of Pacific Grove Court serves a limited area in a small neighborhood of approximately 24 lots in a new subdivision.

8.3 Recommended Capacity Projects

This section discusses criteria used to size replacement pipes and summarizes the recommended capacity improvement projects.

8.3.1 Design Criteria

The design criteria for the City's sanitary sewer system are described in the "Engineering Procedures Manual for Public and Private Development Projects." The minimum size for any public sewer is eight (8) inches. Sewer mains up to twelve (12) inches in diameter are designed to carry the design flow at fifty percent (50%) of the pipe capacity. Pipes larger than twelve (12) inches in diameter are designed to carry the design flow at seventy five percent (75%) of their capacity. Design capacities for trunk (and interceptor) sewers larger than twelve (12) inches in diameter require approval by the City Engineer.

8.3.2 Recommended Capacity Improvements

Recommended improvements will be developed from the Collection System Master Plan Update prepared by City staff with the assistance of an outside consultant to run the sewer system model software program. Deficiencies at ultimate build out development of the City will be identified for construction as new areas of service are added to the collection system.

8.4 Capital Improvement Program Schedule

The Capital Improvement Program (CIP) schedule is identified annually in the City's 5-year Capital Improvement Program Budget. Projects are added to this schedule as needed.

8.5 Financial and Economic Analysis

Funding for the CIP is provided in the City's 5-year CIP Budget, and includes development fees, and enterprise funds from user fees collected for operation of the City's wastewater system. Projects identified for funding in the 5-year CIP are identified in the "Wastewater Improvements" section of the Program. Capital improvements for the wastewater collection system are financed on a pay-as-you-go basis.

Element 9: MONITORING, MEASUREMENT, & PROGRAM MODIFICATION

This section of the SSMP discusses parameters the City tracks to monitor the success of the SSMP and how the City plans to keep the SSMP current. This section fulfills the SWRCB (Element 9) SSMP requirement.

9.1 Regulatory Requirements for Monitoring, Measurement, & Program Modifications

SWRCB Requirement: *The City shall:*

- *Maintain relevant information which can be used to establish and prioritize appropriate SSMP activities;*
- *Monitor the implementation and, where appropriate, measure the effectiveness of each element of the SSMP;*
- *Assess the success of the preventative maintenance program;*
- *Update program elements, as appropriate, based on monitoring or performance evaluations; and*
- *Identify and illustrate SSO trends, including: frequency, location, and volume.*

9.2 Monitoring and Measurement Discussion

The City tracks several performance measures through tracking logs, including, cause and location of stoppages; cause, location, and volume of SSOs; response time; number of and reason for customer complaints; length of pipe cleaned annually and type of debris found. The City plans to continue tracking all performance measures currently being tracked.

9.3 SSMP Modifications

The SSMP should be updated periodically to maintain current information, and programs need to be enhanced or modified if they are determined to be less than effective. The City will review the successes and needed improvements of the SSMP as part of the SSMP biennial audit, described in Element 10.

City staff will update critical information, such as contact numbers and the SSO response chain of communication, as needed. A comprehensive SSMP update will occur every 5 years, as required by the SWRCB.

Element 10: SSMP AUDIT

This section of the SSMP discusses the City's SSMP auditing program. This section fulfills the SWRCB (Element 10) SSMP Audit requirements.

10.1 Regulatory Requirements for SSMP Audits

SWRCB Requirement: *The City shall conduct periodic internal audits appropriate to the size of the system and the number of SSOs. At a minimum, these audits must occur every two years and a report must be prepared and kept on file. This audit shall focus on evaluating the effectiveness of the SSMP and the City's compliance with the SSMP requirements, including identification of any deficiencies in the SSMP and steps to correct them.*

10.2 Element 10 Appendix

The most recent completed SSMP Audit is located in Appendix E.

10.3 SSMP Audit Discussion

The City will complete audits of the SSMP every other year, by March 15. The audit will focus on evaluating the effectiveness of the SSMP and compliance with the SSMP requirements.

Element 11: COMMUNICATION PROGRAM

This section of the SSMP discusses the City's communications with the public. This section fulfills the Communication Program requirement for the SWRCB (Element 11).

11.1 Regulatory Requirements for Communication Program

SWRCB Requirement: *The City shall communicate on a regular basis with the public on the development, implementation, and performance of its SSMP. The communication system shall provide the public the opportunity to provide input to the City as the program is developed and implemented.*


11.2 Communication Program Discussion

The City maintains a website, <http://www.brentwoodca.gov>, to help inform the public about City activities. Included on the website is a link to the SSMP.

The City's website is an effective communication channel for providing information to the public. The main page of the website provides important announcements, agendas and past meeting information from City Council meetings, as well as information regarding FOG, lateral maintenance, and a link to the Association of Bay Area Governments ("ABAG") Sewer Smart Program, <http://www.sewersmart.org>, to help the public understand how to properly use their sewer connection.


APPENDIX A

Lateral Maintenance Responsibility

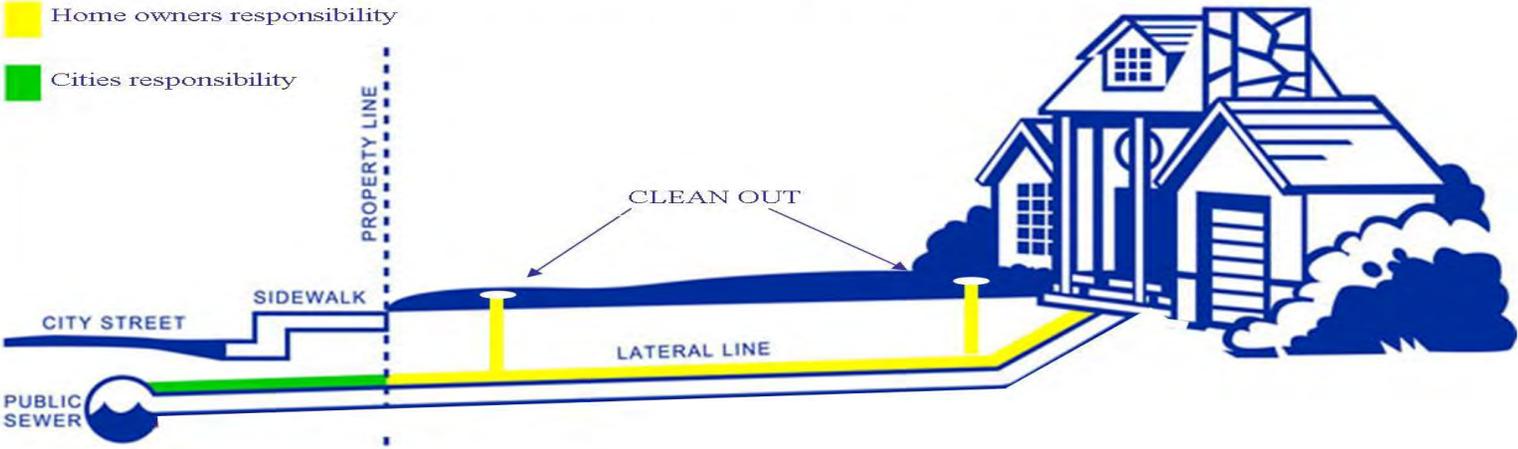

Lateral Description

APPENDIX B

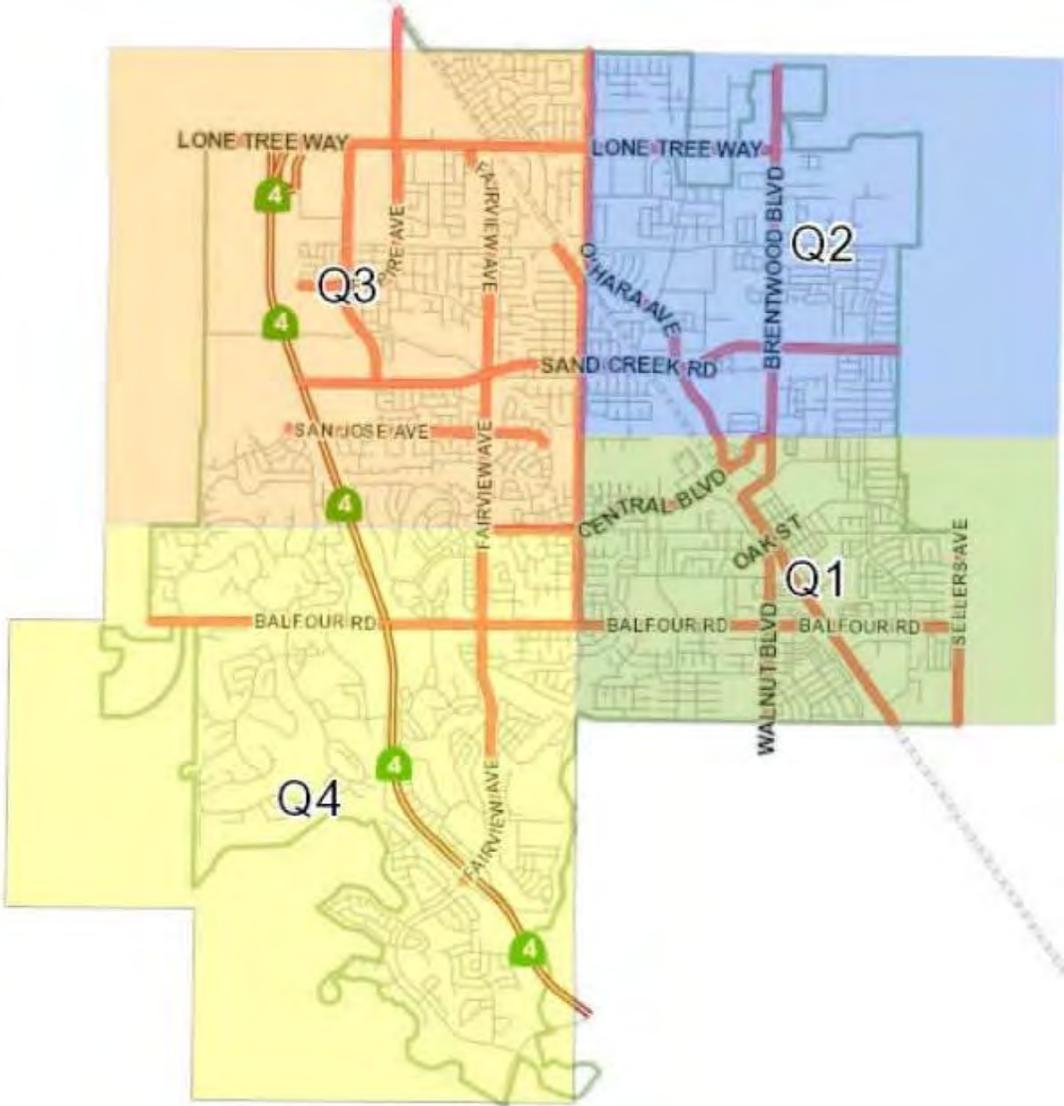

Spare Parts Inventory List

Size	Pump Parts	Bower Lock	In Stock
6"	Z Pipes	✓	2
6"	90 degree	✓	2
6"	Screens	✓	3
6"	Straight Pipe	✓	3
6"	Green Flex Pipe 1 needs male end	✓	3
6"	Black Flex Pipe	✓	1
6"	Black Flat Hose	✓	3

Size	Pump Parts	Bower Lock	In Stock
6"	Orange Flex Pipe	✓	2
6"	Yellow Flat Hose	✓	6

*Need 2 - 4" Screens w/ Bower Lock

Size	Pump Parts	Cam Lock	In Stock
6"	Green Flex Pipe	✓	3
6"	Green Flat Hose	✓	3
6"	Yellow Flat Hose	✓	1
6"	Black Flat Hose	✓	3

* Need Gaskets - 10

Size	Pump Parts	Black Lock	In Stock
8"	Black Flex Pipe	✓	10

PVC Fittings	4" with Gasket
22° Bell and Spiket	12
45° Bell and Bell	1
22° Bell and Bell	3
4" Y's	2

ABS Fittings	4" Slip
Cleanout	1
22°	10

ABS Fittings	3" Slip
4"-3" Reducer	1
T	
45°	

Rubber Colder Couplers	
4" Clay to Plastic	7
4" Plastic to Plastic	6
6" Clay to Plastic	2

PVC Fitting	6" with Gasket
45° Bell and Spiket	1
8" to 6" Reducer	1
12" to 4" Sadel	2
8" Y	1
12" Cuplers	4
8" Cuplers	4
4" SDR PVC Pipe 20 ft.	2

Plugs	Pipe Size
Flow Through Plug	15"
1	18"-24"
1	10"-16"
2	6"-10"


Misc Parts & Equipment	#
Generator	1
Power Snake 100ft	1
20 ft poles	2
3/4 x 20ft leader hose	2
1" x 20ft leader hose	4
3" Tiger Tail	2
4" Tiger Tail	5
Flat hose 4" x 50ft	6
Flex Suction Hoses 4" x 20ft	2
3" x 4" reducer	1
6" Hard Pipe	9
8" O rings for vac tubs	20
2.5" x 20ft Filler Hose - Flat	1
6" x 20ft Drain Hose - Flat	1
Spill kits	1
Multiple High Pressure Cleaning Heads	10
Air Pump	1

Trucks & Pumps	Vehicle #
AquaTech w/ 35ft 8" vac tubes	5916
Vac-Con w/ 24ft 8" vac tubes	5931
Ford F150	5929
Ford F450 CCTV Pearpoint	5924
Godwin 4" pump trailer mounted	5934
Godwin 3" pump trailer mounted	5933
Streets Depart. 6" pump	5128

Traffic Control	# of Items
Cones	100
Signs	14
Sign Board	2

APPENDIX C

City of Brentwood
Water Quality Monitoring Plan
December 11, 2014

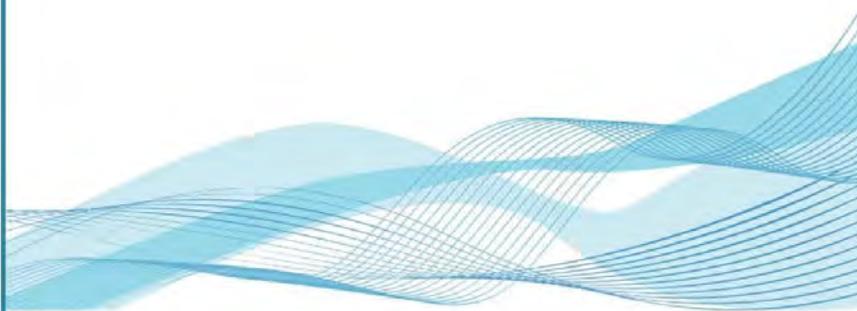

© 2014 DKF Solutions Group, LLC

Table of Contents

1. PURPOSE OF PROGRAM PLAN	3
2. DEFINITIONS	3
3. RESPONSIBILITY	5
4. AUTHORITY AND REFERENCES	6
5. IDENTIFICATION OF LOCAL SURFACE WATERS AND CHARACTERISTICS	7
A. Background Monitoring	
B. Surface Waters of Concern	
6. LAB SELECTION	11
A. Analytical Lab	
B. Getting Samples to the Lab	
C. Lab Contact Info	
7. SAMPLING PARAMETERS	11
A. Required Sampling Parameters	
B. Sampling Parameters for Brentwood	
8. SAMPLING EQUIPMENT AND CALIBRATION	17
A. Sampling Equipment Used At Brentwood	
B. Calibration and Record Keeping	
9. SAMPLING PROCEDURES	18
A. Sample Location and Identification Procedures	
B. Sample Types	
C. Decontamination Procedures	
D. Sample Labeling and Chain of Custody Procedures	
E. Safety Considerations	
F. Stream Velocity Measurements	
G. Grab-n-Go Sampling Kit	
H. Surface Water Maps	
I. Follow Up Sampling	
J. Surface Water Sampling Standard Operating Procedure (SOP)	
10. NOTIFICATIONS OF SENSITIVE RECEPTORS AND REGULATORY AGENCIES	25
11. TECHNICAL REPORT	26
12. RECORDKEEPING	26
13. TRAINING	27
14. INTERNAL REVIEW AND UPDATE OF THE WQMP	28
ATTACHMENTS	
A. Change Log	29
B. Surface Water Sampling Standard Operating Procedure (SOP).....	31
C. Chain of Custody Form	33
D. Surface Water Sampling Worksheet	35
E. Technical Report.....	37
F. Surface Water Maps	39

1. PURPOSE OF PROGRAM PLAN

The purpose of this Water Quality Monitoring Program Plan (WQMP or Plan) is to implement the recent requirements for sampling of sanitary sewer overflows (SSOs) greater than 50,000 gallons that reach surface waters. This plan conforms to the State Water Resources Control Board Waste Discharge Requirements Order No. 2006-0003-DWQ, Section D.7(v) and Monitoring and Reporting Program (MRP) Section D, Water Quality Monitoring Requirements issued by executive order number WQ 2013-0058-EXEC effective on September 9, 2013. This WQMP provides the City of Brentwood (City) policies and procedures to assure consistent conformance to the regulatory requirements and to establish procedures for City staff and contractors in their responses to large releases of sanitary sewage that reach surface waters. This WQMP is consistent with and supplemental to the Brentwood Overflow Emergency Response Plan, Element VI of its SSMP. Finally, this document will be used to coordinate training for the City's new employees and regular refresher training for existing employees.

Additionally this Plan should also be useful for monitoring and sampling requirements that may be imposed upon the City from citizen suits under the Clean Water Act (CWA) resulting in settlement agreements, stipulated orders or consent decrees that can require monitoring and sampling of sanitary sewer overflows of any kind or size. This Plan establishes procedures for the identification of sampling locations, protocols for the proper collection of samples, the chain of custody for sample collections, the handling of samples, the reporting and recordkeeping to assure the legal integrity of monitoring for compliance with regulatory requirements. The plan will also establish policies and procedures that will be used to assure proper coordination between the taking and testing of samples, as well as assure that samples taken will satisfy the local regulatory agency's Basin Plan and the unique character of the City's local service area and surface waters.

This Program Plan is intended to establish protocols for all sampling including when, where and how, establish the required water quality sample analyses that will be conducted, identifying the access and safety requirements related to sampling considerations as well as the identification of any local concerns that this monitoring plan should address. In addition, the Plan establishes the requirements for equipment calibration, notification requirements related to an overflow, recordkeeping requirements, staff training issues and requirements for the regular reviews and audits of the WQMP. Finally, all City forms used for water quality monitoring are included and available for any incident.

2. DEFINITIONS

The following definitions and acronyms are used in this Program Plan:

BACTERIA	Prokaryotic microorganisms typically a few micrometers in length, with shapes from spheres to rods and spirals
CalOES	State of California Office of Emergency Services
CALOSHA	California Division of Occupational Safety and Health
CFR	Code of Federal Regulations
CFS	Cubic feet per second
CIWQS	California Integrated Water Quality System
CSRMA	California Sanitation Risk Management Association

CWA	Clean Water Act
DH2O	Distilled Water
DEET	N,N-Diethyl-meta-toluamide
DOHS	California Department of Health Services
E. Coli	Escherichia coli (bacteria)
ELAP	Environmental Laboratory Accreditation Program
EPA	Environmental Protection Agency
Field QC	Field Quality Control
GPM	Gallons per minute
GWDR	General Waste Discharge Requirements or WDR
GIS	Geographic Information System
LIMS	Laboratory Information Management System
LRO	Legally Responsible Official
mg/l	Milligrams per liter
ml	Milliliter
MPN	Most probable number
MRP	Monitoring and Reporting Program
NH3	Ammonia
NH3-N	Ammoniacal Nitrogen
NPDES	National Pollution Discharge and Elimination System
OERP	Overflow Emergency Response Plan
OES	See CalOES
PPE	Personal Protective Equipment
ppm	Parts per million
QA/QC	Quality Assurance/Quality Control
RWQCB	Regional Water Quality Control Board

- SOP Standard Operating procedure
- SSC Sewer Service Charge
- SSMP Sanitary Sewer Management Plan
- SSO Sanitary Sewer Overflow
- SSO GWDR Sanitary Sewer Overflow General Waste Discharge Requirements

SURFACE WATER

All waters whose surface is naturally exposed to the atmosphere; for example, rivers, lakes, reservoirs, ponds, streams, seas, estuaries, etc., and all springs, wells, or other collectors directly influenced by surface water.

- SWRCB State Water Resources Control Board
- WQMP Water Quality Monitoring Program Plan
- WQ Water Quality
- WDR Waste Discharge Requirements
- VOC Volatile Organic Compound

3. RESPONSIBILITY

The City shall designate responsibility for all WQMP roles to appropriate classifications in the City to assure conformance of all activities for the monitoring of SSOs greater than 50,000 gallons reaching surface waters (Category 1 SSO), to reduce potential liability, protect public health, and to assure those responsible for this Plan are trained in their roles and responsibilities for the performance of proper protocols. It is further recognized that the proper application of this Plan will assure that all monitoring can withstand regulatory or legal scrutiny of the State, Regional Board, or from the actions of a citizen lawsuit. These roles and responsibilities are intended to be compliant with WDR Sections D.13(vi), G and Section C.5 and D of the September 9, 2013 MRP.

The following table contains the roles and responsibilities as assigned by the City to individual classifications or service contractors of the City:

<u>Roles and Responsibility</u>	<u>Responsible Classification</u>
Provide and document regular training on WQMP for all City classifications that have a role or responsibility in the WQMP and identified herein	Wastewater Operations Manager
Identification and assessment of potential impacts to local areas with surface waters that may require WQMP (i.e. aerial crossings, creeks, waterways, rivers, bays, estuaries, etc.)	Wastewater Operations Manager
Determination of specific sampling protocols and analytic methods to be used for the City-required	Regulatory Compliance Supervisor

City of Brentwood
Water Quality Monitoring Program Plan

testing	
Determination of appropriate bacterial indicators for sampling	Regulatory Compliance Supervisor
Annual review of all standard operating procedures related to this WQMP especially the Sample Collection procedures	Wastewater Operations Manager
Decision to invoke a WQMP and direct the monitoring program to conclusion	Wastewater Operations Manager
Selection of sampling locations	Regulatory Compliance Supervisor
Coordination of field sampling	Regulatory Compliance Supervisor
Conduct field sampling per City protocols	Regulatory Compliance Supervisor, Laboratory Technicians, Collections System Workers, or Public Works Standby Personnel
Authorization and direction for placement of public notifications and signage	Wastewater Operations Manager
Photographs of sampling and signage placed to protect public health and safety	Collections System Workers
Preparation of Chain of Custody for all samples taken including proper labeling	Regulatory Compliance Supervisor
Determination of spill travel time, if applicable.	Wastewater Operations Manager
Review and evaluate lab results for termination of sampling and to determine the nature and impact of the release	Wastewater Operations Manager
Decision to terminate sampling	Wastewater Operations Manager
Preparation of detailed sampling location map	Wastewater Operations Manager
Conduct sample analysis	City of Brentwood Laboratory, FGL Environmental, Caltest
Preparation of water quality sampling activities narrative for Technical Report	Wastewater Operations Manager
Certification and placement of Technical report in the CIWQS spill reporting system.	Wastewater Operations Manager
Failure Analysis Investigation of all water quality monitoring from the SSO event to determine all necessary changes or modifications to the WQMP	Wastewater Operations Manager
Audits of the WQMP as required by City SSMP Element 10, Audit.	Wastewater Operations Manager
Management of Change responsibilities for the WQMP and all associated forms and documents required for use during an incident	Wastewater Operations Manager

It is recommended that this list of responsibilities be placed on a laminated card and kept in the Monitoring and Sampling Kit for easy access during an SSO sampling incident.

4. AUTHORITY AND REFERENCES

The authority for the monitoring and sampling of sanitary sewer overflows are contained in the following regulations:

1. State Water Resources Control Board Waste Discharge Requirements Order No. 2006-0003-DWQ, Section D.7(V).

2. State Water Resources Control Board Monitoring and Reporting Program (MRP) Sections C.5 D, Executive Order number WQ 2013-0058-EXEC effective September 9, 2013
3. Standard Methods for the Examination of Water and Wastewater, 22nd Edition, American Public Health Organization et al.
4. Clean Water Act Sections 301(a), 304(h), and 501(a).
5. Code of Federal Regulations, Title 40, Part 136.

There are a number of applicable references that are available to assist with a proper Water Quality Monitoring Program as follows:

- A. Basin Plan of the Regional Water Quality Control Board
- B. Best Management Practices for Sanitary Sewer Overflow (SSO) Reduction Strategies, Central Valley Clean Water Associates and Bay Area Clean Water Agencies, December 2009
- C. City Overflow Emergency Response Plans
- D. Field Guide for Surface Water Sample and Data Collection, Air Program, USDA Forest Service, June 2001.
- E. Standard Operating Procedures for Surface Water Quality Sampling, Arizona Department of Environmental Quality, Surface Water Section, September 2012
- F. Surface Water Sampling_AF.R3, Document Number SESDPROC-201-R3, Region 4, Environmental Protection Agency, Science and Ecosystem Support Division, Athens, Georgia, February 28, 2013.

5. IDENTIFICATION OF LOCAL SURFACE WATERS AND CHARACTERISTICS

An important element of any water quality monitoring program is the proper and thorough understanding of the service area and the various challenges the geography and sanitary sewer infrastructure of the service area present for the potential of wastewater reaching surface waters or storm water facilities. By evaluating the areas of concern in a service area such as lakes, rivers, dry creeks, aerial pipeline crossings over water ways and all storm water related infrastructure, the City can be better prepared to timely respond to any SSO reaching surface waters and to minimize the impacts of an SSO in or around local surface waters and storm water infrastructure.

A. Background Monitoring

Background monitoring of surface waters in the City's service area is intended to provide a profile of the water quality with respects to the constituents measured on a semi-annual basis. This background data will serve as a reference point for determining the level, if any, of water quality impairment following an SSO impacting surface waters in the service area.

1. The Regulator Compliance Supervisor, Laboratory Technician, or Collection System Worker will perform background monitoring of Marsh Creek.
2. Background monitoring will occur twice annually, once in the dry weather season and once in the wet weather season.
3. Background monitoring will measure the following constituents:
 - Ammonia-N
 - Fecal Coliform
 - pH
 - Temperature

4. Samples will be analyzed in accordance with Sections 6.0 and 7.0.
5. Sample results will be filed and retained by the Regulatory Compliance Supervisor.

B. Surface Waters of Concern

For the purposes of this Plan, surface waters are defined as all waters whose surface is naturally exposed to the atmosphere, for example, rivers, lakes, reservoirs, ponds, streams, seas, estuaries, etc., and all springs, wells, or other collectors directly influenced by surface water. In addition, the City will also identify and evaluate areas where collection system pipelines and force mains cross over or under waterways as these crossings can require additional resources and equipment to properly address any SSO from these collection system assets.

Surface waters of concern are those surface waters with the City's service area that may be impacted by a sanitary sewer overflow from the City's sanitary sewer collection system. Prior review and evaluation of potential failure mechanisms can help minimize any potential impacts to surface waters or storm water infrastructure when and if the WQMP must be invoked. Any review of these important areas of potential surface water contamination in advance of an SSO should allow the City to be better prepared to respond to an SSO with the proper equipment and a better understanding of the procedures that may need to be invoked during the SSO such as flow rate of a creek or stream, and potential areas of significant environmental concern such as shell fish beds or fish habitats. In addition, having all storm water infrastructure located on the collection system field maps will help the City's responders quickly determine if SSOs may flow into storm drains reach and impact surface waters.

The following (Table 5.1) are the surface waters of concern within the City's jurisdiction:

Table 5.1: Surface Waters of Concern

Name	Type (see legend, below)	Map Location	Background Monitoring?	Access Considerations	Safety Considerations
Marsh Creek and Balfour Road	Stream	Attachment F	Yes	No special considerations	Always exercise caution, may be slippery
Marsh Creek and Sand Creek Road	Stream	Attachment F	Yes	No special considerations	Always exercise caution, may be slippery
Marsh Creek - approx. 300 feet downstream of WWTP Discharge point	Stream	Attachment F	Yes	No special considerations	Always exercise caution, may be slippery
Marsh Creek Tributaries - Sand Creek - Deer Creek - Dry Creek	Stream		No	No special considerations	Always exercise caution, may be slippery

- Bog:** Freshwater wetlands that are poorly drained and characterized by a buildup of peat.
- Brackish Water:** Generally, water containing dissolved minerals in amounts that exceed normally acceptable standards for municipal, domestic, and irrigation uses. Considerably less saline than sea water. Also, Marine and Estuarine waters with Microhaline salinity (0.5 to 30 due to ocean salts). Water containing between 1,000-4,000 parts per million (PPM) Total Dissolved Solids (TDS). The term brackish water is frequently interchangeable with Saline Water. The term should not be applied to inland waters.
- Brook:** A natural stream of water, smaller than a river or creek; especially a small stream or rivulet which breaks directly out of the ground, as from a spring or seep; also, a stream or torrent of similar size, produced by copious rainfall, melting snow and ice, etc.; a primary stream not formed by tributaries, though often fed below its source, as by rills or runlets; one of the smallest branches or ultimate ramifications of a drainage system.
- Canal:** A constructed open channel for transporting water.
- Channel:** An area that contains continuously or periodically flowing water that is confined by banks and a stream bed.
- Culvert:** A buried pipe that allows streams, rivers, or runoff to pass under a road.
- Ditch:** A long narrow trench or furrow dug in the ground, as for irrigation, drainage, or a boundary line.
- Diversion channel:** (1) An artificial channel constructed around a town or other point of high potential flood damages to divert floodwater from the main channel to minimize flood damages.
 (2) A channel carrying water from a diversion dam.
- Drainage Channel:** For the purposes of complying with the Statewide Sanitary Sewer Order, (1) a man-made canal used to transport storm water as part of a municipal separate storm sewer system, or (2) an intermittent or perennial stream bed.
- Dry Wash:** A streambed that carries water only during and immediately following rainstorms.

- Ephemeral Streams:** Streams which flow only in direct response to precipitation and whose channel is at all times above the water table.
- Freshwater marsh:** Open wetlands that occur along rivers and lakes.
- Intermittent stream:** Any nonpermanent flowing drainage feature having a definable channel and evidence of scour or deposition. This includes what are sometimes referred to as ephemeral streams if they meet these two criteria.
- Perennial streams:** Streams which flow continuously.
- Pipe crossing:** Crossing of a pipe or force main over or under a surface water body.
- Riverine:** Relating to, formed by, or resembling a river including tributaries, streams, brooks, etc.
- Slough:** A shallow backwater inlet that is commonly exposed at low tide.
- Stream:** A general term for a body of flowing water; natural water course containing water at least part of the year. In Hydrology, the term is generally applied to the water flowing in a natural channel as distinct from a canal. More generally, as in the term Stream Gaging, it is applied to the water flowing in any channel, natural or artificial.

For additional definitions refer to the glossary at <http://www.streamnet.org/glossary/stream.html>.

6. LAB SELECTION

A. Analytical Lab

Samples collected for background monitoring purposes pursuant to Section 5.0 will be analyzed at the Brentwood Wastewater Treatment Plant (WWTP) lab, utilizing FGL Lab in Stockton or CalTest in Napa as backups. These labs are accredited through California's Department of Public Health Environmental Laboratory Accreditation Program (ELAP). ELAP provides evaluation and accreditation of environmental testing laboratories to ensure the quality of analytical data used for regulatory purposes to meet the requirements of the State's drinking water, wastewater, shellfish, food, and hazardous waste programs. The State agencies that monitor the environment use the analytical data from these accredited labs. The ELAP-accredited laboratories have demonstrated capability to analyze environmental samples using approved methods.

B. Getting Samples to the Lab

At all times, sample hold times identified below will be observed in accordance with Section 7.0. Once samples are collected, they will be transported to the lab as follows:

1. During Business Hours: Placed in the sample storage refrigerator at the WWTP Lab
2. After Hours: Placed in the sample storage refrigerator at the WWTP Lab

C. Lab Contact Info

Name: Jacqueline Parsons, Regulatory Compliance Supervisor

Address: 2251 Elkins Way, Brentwood WWTP

Hours Samples Are Accepted: 24 hours per day

Phone: 925-616-6074

Alternate or After Hours Phone: 925-382-1924

Emergency contact information: 925-382-1924

7. SAMPLING PARAMETERS

A. Required Sampling Parameters

The RWQCB Basin Plan and/or NPDES permit set the water quality standards against which one can judge the levels of impacts of an SSO on surface waters.

In accordance with the SWRCB Revised MRP WQ 2013-0058, the following parameters will be sampled:

1. Ammonia

Ammonia-N, is a key indicator of the extent of the gross pollution of the receiving water from a SSO. Untreated wastewater or partially-treated wastewater is generally high in ammonia-N (typical 20-30 mg/L). In comparison the natural background concentration in the surface water is low, typically, less than 0.5 mg/L. Therefore, the elevated concentration of ammonia of the

surface water downstream or at the site of the SSO, as compared to that upstream of the site is a reasonable indication of the extent of gross contamination from the SSO.

2. Bacteriological Indicator as specified in the local Basin Plan

Fecal coliform count is an indicator of potential public health impacts of an SSO on the receiving waters. If the concentrations of this group of bacteria are elevated above and beyond the natural background and/or above the RWQCB Basin Plan Water Quality Standards (objective), public notification and posting may be necessary.

It should be noted that there may be non SSO-related causes of elevated bacteria in surface water, for example, animal sources or storm drain discharge. The upstream and or other samples may reflect the extent of bacterial contamination from these sources. Sometimes the extent of the SSO may be indistinguishable from the other natural sources beyond the City's control. This is particularly true when taking Source samples based on an estimated downstream location of the SSO plume (reference Section 7F).

Generally, if the concentrations of these groups of bacteria at the downstream or at the site of impact are within the range of the non-impacted site (i.e. upstream) or levels indicated in historical background monitoring levels, the water quality impacts of the SSO are considered insignificant.

The surface water quality objectives of these groups of bacteria are shown in Table 7.1 and 7.2, below.

Table 7.1: Water Quality Objectives for Coliform Bacteria^a

Beneficial Use	Fecal Coliform (MPN/100ml)	
Water Contact Recreation	Geometric mean < 200 90 th percentile < 400	
Shellfish Harvesting ^b	N/A	
Non-contact Water Recreation ^d	N/A	
Municipal Supply: <ul style="list-style-type: none"> • Surface Water^e • Groundwater 	Geometric Mean < 2.2	

NOTES:

- a. Based on a minimum of five consecutive samples equally spaced over a 30-day period.
- b. Source: National Shellfish Sanitation Program.
- c. Based on a five-tube decimal dilution test or 300 MPN/100ml when a three-tube decimal dilution test is used.
- d. Source: Report of the Committee on Water Quality Criteria, National Technical Advisory Committee, 1968.
- e. Based on multiple tube fermentation technique; equivalent test results based on other analytical techniques, as specified in the National Primary Drinking Water Regulation, 40 CFR, Part 1421.21 (f), revised June 10, 1992, are acceptable.

Source: Sacramento River and San Joaquin River Basin (Region 2)
 Water Quality Control Plan (Basin Plan)
 California RWQCB, Central Valley Region
 October 2011

Table 7.2 – U.S. EPA Bacteriological Criteria for Water Contact Recreation^{1,2}
 (in colonies per 100 ml)

Steady State (all areas)	Fresh Water		Salt Water
	Enterococci	E. Coli	Enterococci
	33	126	35
Maximum at:			
• Designated beach	81	235	104
• Moderately used area	89	298	124
• Lightly used area	108	406	276
• Infrequently used area	151	576	500

NOTES:

1. The criteria were published in the Federal Register, Vol. 51, No. 45 / Friday, March 7, 1986 / 8012-8016. The criteria are based on:
 - a. Cabelli, V.J. 1983. Health Effects Criteria for Marine Recreational Waters, U.S. EPA, EPA 600/1-80-031, Cincinnati, Ohio, and
 - b. Dufour, A.P. 1984, Health Effects Criteria for Fresh Recreational Waters, U.S. EPA, EPA 600/1-84-004, Cincinnati, Ohio.

2. The U.S. EPA criteria apply to water contact recreation only. The criteria provide for a level of production based on the frequency of usage of a given water contact recreation area. The criteria may be employed in special studies within this region to differentiate between pollution sources or to supplement the current coliform objectives for water contact recreation.

B. Sampling Parameters for City of Brentwood

1. Ammonia
 - Discussion: See Section 7A
 - Sample Container: Plastic/glass
 - Sample Type: Grab
 - Sample Volume Required: 200 ml. minimum
 - Hold Time: 28 days
 - Preservative: Sulfuric acid
 - Analytical Method: Method 4500-XX R and C, Standard Methods for the Examination of Water or Wastewater, 21st Edition

2. Total Coliform/Fecal
 - Discussion: See Section 7A.2
 - Sample Container: Plastic (sterile)
 - Sample Type: Grab
 - Sample Volume Required: 100 ml. minimum
 - Hold Time: 8 hours
 - Preservative: None if waters are not chlorinated
 - Analytical Method: Method 9221 B, C and E, Standard Methods for the Examination of Water or Wastewater, 21st Edition

3. Enterococcus (not currently used by City in this Plan)
 - Discussion: See Section 7A.2
 - Sample Container: Plastic (sterile)
 - Sample Type: Grab
 - Sample Volume Required: 100 ml. minimum
 - Hold Time: 8 hours
 - Preservative: None if waters are not chlorinated
 - Analytical Method: IDEXX Enterolert® Test Kit, Method 9230D, Standard Methods for the Examination of Water or Wastewater, 21st Edition

4. pH
 - Discussion: Just as "degree" is a measure of temperature, pH is a measure of how acidic or basic the water is. Water pH is critical to fish habitat because it can affect fish egg production and survival, aquatic insect survival and emergency, and the toxicity of other pollutants such as heavy metals or ammonia. Like water temperature, pH naturally varies both daily and seasonally.

Most daily cycles in pH occur as a result of the photosynthesis of aquatic plants. Through photosynthesis, plants convert the sun's energy into chemical products they need to live and grow. During daylight hours, aquatic plants consume carbon dioxide (an acid), and produce hydroxide (a base). As a result, water becomes more basic during the day (pH values get higher) and usually peaks mid- to late-

afternoon. Virtually all aquatic organisms product carbon dioxide (an acid) through their normal metabolism of food (respiration). As a result, water becomes more acid during the night (pH values drop) and usually is lowest just before sunrise.

- Sample Container: None, in-field measurement
- Sample Type: Grab
- Hold Time: 15 minutes
- Preservative: None
- Analytical Method: Direct read pH meter, calibrated per manufacturer's instructions prior to use.

5. Temperature

- Discussion: Water temperature is a key factor affecting the growth and survival of all aquatic organisms. The effect of stream temperature on fish, amphibians, macroinvertebrates, etc. varies between species and within the life cycle of a given species (Armour 1991; Beschta et al. 1987; Bjornn and Reiser 1991; Lantz 1971; DEQ 1995). As stream temperatures increase, the amount of dissolved oxygen (DO) available to aquatic biota decreases. As a result, even if food is abundant at higher temperatures, decreases in DO may metabolically stress aquatic organisms, further increasing their susceptibility to disease.

- Sample Container: None, in-field measurement
- Sample Type: Grab
- Hold Time: None
- Preservative: None
- Analytical Method: Direct read temperature meter, calibrated per manufacturer's instructions prior to use.

6. Dissolved Oxygen

- Discussion: The dissolved oxygen concentration is an indication of the potential impacts of the spill on the biological community of the receiving water. The dissolved oxygen concentration of <2 mg/L downstream or at the site of the spill is an indication of serious biological impacts including potential fish kill. Generally, the dissolved oxygen at the downstream should not drop below 5 & 7 mg/L for warm and cold water, respectfully.

- Sample Container: Non, in-field measurement
- Sample Type: Grab
- Hold Time: 15 minutes
- Preservative: None
- Analytical Method: Direct read temperature meter, calibrated per manufacturer's instructions prior to use.

8. SAMPLING EQUIPMENT AND CALIBRATION

A. Sampling Equipment Used At the City of Brentwood

The following are the sampling equipment used by the City

- Sampling pole with fixed container
- Sampling pole with removable container
- Portable pH and temperature probe
 - Make and model
- Portable dissolved oxygen meter
 - Make and model
- Sampling pail and rope
- Stream velocity meter
 - Make and model
- Grab-n-Go Sample Kit containing:
 - Ice pack
 - Waterproof pen
 - Sample labels
 - Camera
 - Sample bottles
 - Etc.

B. Calibration and Record Keeping

Each piece of equipment is required to have an up-to-date calibration and maintenance logbook. The logbook will be maintained to have consecutively numbered pages and shall contain at least the following:

- Date
- Calibration Results
- Calibration comments
- Initials of the individual calibrating the instrument

Each instrument must be clearly identified (*e. g.*, the make, model, serial and/or ID number) to differentiate among multiple meters.

The appropriate calibration procedure must be followed pursuant to City standard calibration operating procedure and if the instrumentation does not have an electronic program that maintains a running calibration log, then the results must be recorded in the logbook each time a piece of field equipment is used, along with the date and name/initials of the person performing the calibration.

If difficulty is encountered in calibrating an instrument, or if the instrument will not hold calibration, this information must also be recorded. Malfunctioning equipment should not be used to collect data. Steps should be taken to correct the problem as soon as possible. All equipment maintenance should be recorded in the logbook indicating what was done to correct the problem, along with the date and signature/initials of the staff person that corrected the problem.

9. Sampling Procedures

A. Sample Location and Identification Procedures:

Samples will be collected by the Regulatory Compliance Supervisor, Laboratory Technicians, Collection System Workers, or Public Works Standby personnel. The most precise and accurate analytical measurements are worthless and even detrimental if performed on a sample that was improperly collected and stored, or was contaminated in the process. The purpose of sampling and analysis is to provide data that can be used to interpret the quality or condition of the water under investigation.

Unfortunately, water quality characteristics are not spatially or temporally uniform from one effluent to another. A sampling program must recognize such variations and provide a basis for compensations for their effects. The sample must be:

1. Representative of the material being examined;
2. Uncontaminated by the sampling technique or container;
3. Of adequate size for all laboratory examinations;
4. Properly and completely identified;
5. Properly preserved, and
6. Delivered and analyzed within established holding times.

These six requirements are absolutely necessary for a proper assessment of water quality.

It is impossible to establish hard and fast rules concerning sampling locations. However, the following general guidelines should be applied whenever City personnel conduct surface water sampling.

1. The sampling location should be far enough upstream or downstream of confluences or point sources so that the surface water and SSO volume is well mixed. Natural turbulence can be used to provide a good mixture.
2. Samples should be collected at a location where the velocity is sufficient to prevent deposition of solids, and to the extent practical, should be in straight reach having uniform flow. All flow in the reach should be represented, so divided flow areas should be avoided and samples should be taken towards the middle of the reach where feasible.
3. Sampler must always stand downstream of the collection vessel, and sample "into the current". Care must be taken to avoid introducing re-suspended sediment into the sample.

B. Sample Types:

Grab samples are appropriate for the characterization of surface waters at a particular time and place, to provide information about minimum and maximum concentrations, to allow for the collection of variable sample volume.

Grab samples may be collected directly into the sample container, or a clean decontaminated intermediate container may be used if a wading sample is not possible or safe. If an intermediate container is used, when in the field, double rinse the sampling device (bucket, automatic sampler) with sample water prior to collecting the sample and be sure to discard

rinse water downstream of where sample will be collected. If samples are collected in a bucket and distributed a consolidation collection container, swirl the contents of the bucket as it is being poured into the consolidation collection container to avoid settling of solids (and pour in back and forth pattern – e.g., 1-2-3-3-2-1).

Grab Sample: A grab sample is defined as an individual sample collected at a given time. Grab samples represent only the condition that exists at the time the sample is collected (US EPA 1977).

Surface Grab Sample: A sample collected at the water surface (i.e. skimming) directly into the sample container or into an intermediate container such as a clean bucket. A single or discrete sample collected at a single location.

Field Blanks are used to evaluate the potential for contamination of a sample by site contaminants from a source not associated with the sample collected (e.g., airborne dust, etc.). Sterile, deionized water is taken into the field in a sealed container. This is the stock water. The stock water is then poured into the sample container. The containers and sample submission forms are labeled as "Field Blank". The same template selected for the test samples should be used. Field blanks are subject to the same holding time limitations as samples. The appropriate FIELD QC box on the sample Chain of Custody form should be checked.

C. Decontamination Procedures

Removing or neutralizing contaminants from sampling equipment minimizes the likelihood of sample cross contamination, reduces or eliminates transfer of contaminants to clean areas, and prevents the mixing of incompatible substances.

Gross contamination can be removed by physical decontamination procedures. These abrasive and non-abrasive methods include the use of brushes, air and wet blasting, and high and low pressure water cleaning.

The decontamination procedure described above may be summarized as follows:

1. Physical removal
2. Non-phosphate detergent wash
3. Tap water rinse
4. Distilled/deionized water rinse
5. 10% nitric acid rinse
6. Distilled/deionized water rinse
7. Solvent rinse (pesticide grade)
8. Air dry
9. Distilled/deionized water rinse

D. Sample Labeling and Chain of Custody Procedures

A sample is a physical evidence of a facility or the environment. An essential part of all enforcement investigations is that evidence gathered be properly documented. To accomplish this, the following sample identification and chain of custody procedures are established.

1. The method of sample identification depends on the type of measurement or analyses performed. When in-situ measurements are made, the data are recorded directly in Field Data Worksheets with identifying information, field observations, and remarks. Examples of in-situ measurements are:

- pH
- Temperature
- Dissolved Oxygen
- Stream Flow Measurement

Samples other than in situ measurements must be identified by a sample label. These samples are removed from the sample location and transported to a laboratory for analyses. Before removal, however, a sample is often separated into portions depending upon the analyses to be performed. Each portion is preserved in accordance with applicable procedures and each sample container is identified by a sample label.

2. At a minimum, the following grab samples will be collected, in duplicate:

- Field Blank: See Section 9.B for discussion.
- Upstream: This sample will be collected far enough upstream of the SSO's point of entry into the surface water as to be free of contaminants from the SSO. Typically, 50-feet is sufficient, but this may vary on circumstances of the spill.
- Source: Immediate vicinity where the SSO entered the surface water. This point will actually be downstream of the actual SSO entry point for SSO's that have stopped entering the surface water to be sampled. If the SSO has stopped, calculate the approximate downstream distance from the original SSO location by dividing the time since the SSO occurred by the estimated velocity. This is the approximate downstream distance from the SSO discharge point to the "source" sampling location.
 - Due to possible tidal action in the surface water or other factors, another method may be used to determine the "source" location at the discretion of the *Wastewater Operations Manager*.
 - See Section 9.F for information on determining velocity of the surface water in order to determine the Source sample location.
- "Downstream" of SSO: This sample will be collected far enough downstream to be representative of the water quality of the surface water after adequate mixing of the surface water and the SSO have occurred. Typically, this location will be 50-feet downstream of the Source sample, but this may vary on the size and velocity of the surface water to be sampled.

3. Sample labels shall be completed for each sample, using waterproof ink. The information recorded on the sample tag/label includes:

- Date: a six digit number indicating the year, month, day of collection
- Time: a four-digit number indicating military time of collection (e.g., 0954)
- Sample Location: sampling location description as either Upstream, Source, or Downstream

- Samplers: each sampler is identified
 - Parameter/preservative: the analysis to be conducted for the sample /sample preservation
4. Photos or video of each sample location will be taken, properly labeled with date, time, and view direction and a map of the photo locations completed. Photos and videos shall include relevant landmarks to identify sampling locations and their surroundings.

Due to the evidentiary nature of samples collected during enforcement investigations, possession must be traceable from the time the samples are collected until they are analyzed. To maintain and document sample possession, chain of custody procedures (Attachment C) are followed. A sample is under custody if:

- It is in your possession, or
 - It is in your view, after being in your possession, or
 - It was in your possession and under your control to prevent tampering, or
 - It is in a designated secure area.
5. As few people as possible should handle samples. The person taking the samples is personally responsible for the care and custody of the samples collected until they are transferred or dispatched properly.
6. Samples are accompanied by a chain of custody record. When transferring the possession of samples, the individuals relinquishing and receiving will sign, date, and note the time on the record. This record documents sample custody transfer from the sampler, often through another person, to the analyst at the laboratory. The samples are typically transferred to the sample-receiving custodian at the laboratory.

E. Safety Considerations

Personal safety of staff engaged in any fieldwork activity (e.g., in transit, walking or hiking, and any field activities while at the sample site) is of primary importance. Staff should never place themselves in dangerous or risky situations. Any hazards that are known by field personnel should be communicated to other members of the field crew.

Fieldwork should be postponed if there is indication that engagement in the field activity could cause bodily harm. Working during lightning storms, at night, in heavy vegetation or poison oak, near aggressive wildlife or domestic animals, traversing steep or rugged terrain, unstable slopes or creek banks, near swiftly moving water or potential flash flood conditions, or during snowy weather is not considered "normal risk". If any member of the field crew is uncomfortable with a reasonable self-determined hazardous field condition, it is that person's responsibility to bring this to the attention of the on site field supervisor or their supervisor. A "reasonable self-determined hazardous field condition" is defined as other than normal risk. Supervisors shall not dismiss any person's spoken concerns that field conditions are too hazardous to complete the work assignment.

The person taking the samples must have adequate protection, including protective clothing. They must wear gloves, as protection against chemical and/or bacteriological hazards, while they are sampling or handling samples that are known or suspected to be hazardous (e.g. visible solids or sheens, downstream from sewage spills, etc.), or if hands have open wounds. The type of gloves worn shall be determined by the sampling circumstance and type of pollutants expected – for instance longer gloves are needed when samples must be taken well below the surface.

When wading in a stream, a personal floatation device shall be worn at all times. Other protective measures shall be taken in accordance with Brentwood safety procedures.

Upon arrival at a sampling site, safety equipment such as signs, cones, lights, etc. shall be set out as appropriate. Vehicles shall be parked in locations and directions to minimize traffic disruption and avoid sample contamination. Photos should be ultimately taken of the placement of all safety equipment and signage.

The following guidelines apply to all fieldwork by City staff.

- No sample or measurement is worth the risk of injury.
- All staff shall use proper personnel protective gear as appropriate for the incident (e.g., life preservers, gloves, goggles, etc.)
- Field sampling crews should consist of at least two members unless otherwise approved by a supervisor.
- Be conscious of the whereabouts of rattlesnakes, mountain lions, and other dangerous animals.
- Open body wounds are entry sites for infection; take the necessary precautions for self-protection.
- If there is storm activity in the work area, wait for safer conditions to develop or postpone the sampling.
- Do not sample at night without approval from your supervisor.
- Do not trespass on private property, or posted restricted public lands without prior permission and written approval from property owner or administrator.
- If strange or suspicious looking people are in the work area, either wait for them to leave or postpone the work to a later time. Do not force confrontations with strangers and back away from any confrontations with the public. Be courteous and understanding of public concerns of the situation.
- Take the necessary precautions against exposure to harmful weather conditions such as heat, wind, snow, cold, rain, etc.
- Carefully evaluate a given on-site situation to determine if the task can be performed safely.
- Wear protective footwear when entering streams.
- Do not enter the stream if the water is flowing too fast.

F Stream Velocity Measurements

If sampling is performed after the SSO has stopped, the velocity of the impacted surface water must be determined in order to estimate SSO travel time and select an accurate Source

sample location. One way to measure the SSO travel time is to use a velocity probe (such as a Global Water FP111-S Flow Probe) to determine the rate of flow in the water body. In cases where a water velocity probe is used, the manufacturer's instructions will be followed.

G. Grab-n-Go Sampling Kit

The City maintains a Grab-n-Go sampling kit located at the WWTP Lab. The kit is inspected quarterly by a Collections System Worker. Additionally, any Brentwood staff utilizing the kit is responsible for notifying the Regulatory Compliance Supervisor of the need for decontaminating sampling equipment and field monitoring devices and replenishing the kit.

SSO Sample Collection Kit Inventory:

- Cooler
- Surface Water Sampling SOP (Attachment B)
- Ice Pack (stored in freezer)
- 5 Ammonia sample bottles, preserved (3 for samples, 1 for Field Blanks and 1 extra in the event of contamination, spillage of the preservative or other contingency)
- 6 sample bottles (4 for samples, 1 for Field Blanks and 1 extra in the event of contamination, or other contingency)
- Field monitoring device(s) for pH, temperature, and salinity (calibrated on regular basis) and extra batteries for each device
- Latex gloves
- Safety glasses/goggles
- Surface Water Sampling Worksheet (Attachment D)
- Sampling Pole
- Field Lights
- Waterproof Pen
- Minimum of 20 blank sample bottle labels
- Chain of Custody form (Attachment C)
- Velocity probe
- Personal floatation device (if applicable)

- H. **Surface Water Maps**
 Maps of surface waters in the Brentwood service area that may be impacted by an SSO are located in Attachment F.
- I. **Follow Up Sampling**
1. Sampling will be repeated every 24 hours, or as directed by the RWQCB or County Environmental Health Department, until such time as one of the following criteria have been met:
 - The County Environmental Health Department or the RWQCB indicates follow up sampling is no longer required, or
 - Both the ammonia and bacteria levels downstream are approximately equal to or less than the upstream levels; or
 - The concentration of fecal coliform levels is below the applicable water quality objective for the beneficial use (400 MPN/100ml).

Table 9.1 Summary of the October 2011 Sacramento & San Joaquin River Basin Plan

Beneficial Use	Fecal Coliform (MPN/100mL)	Total Coliform (MPN/100mL)	Enterococcus Bacteria (MPN/100mL)		E. coli (MPN/100mL)
			Estuarine and Marine	Fresh Water	Fresh Water
Water Contact Recreation	90th percentile < 400				
Shellfish Harvesting					
Non-contact Water Recreation					

- J. **Surface Water Sampling SOP**
 The Surface Water Sampling SOP, Attachment B, provides step-by-step procedures to collect samples and deliver them for analysis in accordance with Sections 6, 7 and 9.

10. NOTIFICATIONS OF SENSITIVE RECEPTORS AND REGULATORY AGENCIES

Table 10.1 describes regulatory and other notifications that must be made in accordance with the triggers indicated:

Table 10.1 Notifications of Sensitive Receptors and Regulatory Agencies				
Contact	Trigger	Deadline	How	Person(s) Responsible
OES	If SSO is greater than or equal to 1,000 gallons and reaches or has potential to reach surface waters.	2 hours after awareness of SSO	Call CalOES at (800) 852-7550.	
County Environmental Health	N/A	N/A	N/A	
SWRCB	If 50,000 gal or more were not recovered.	45 days after SSO end time, Submit SSO Technical Report.	CIWQS*	

** In the event that the CIWQS online SSO database is not available, notify the State Water Resources Control Board (SWRCB) by phone or email and provide required information until the CIWQS online SSO database becomes available.*

11. TECHNICAL REPORT

The MRP requires that in the event of a 50,000 gal or greater overflow spilled to surface waters, the City must prepare and submit an SSO Technical Report that includes a description of all water quality sampling activities conducted, a location map of all water quality sampling points, and the analytical results and evaluation of the results, pursuant to Section B.5 of the MRP. In addition, this report must be submitted to the CIWQS Online SSO Database within 45 days of the end of the SSO and must be certified by the City's Legally Responsible Official, the Wastewater Operations Manager.

12. RECORDKEEPING

All sampling related records associated with this WQMP should be contained in the appropriate SSO incident file designated with a specific locator record number. These records shall include at least the following documents related to the WQMP:

- A narrative description of water quality sampling activities associated with the event.
- Timeline of the sampling activities until sampling is terminated.
- All surface water sampling worksheets.
- Computations of spill travel time in surface waters, if appropriate.
- Chain of Custody for all samples.
- Sampling Map of all sample locations.
- All photos or video showing sampling activities.
- Final analytical results from the certified laboratory conducting the sample analysis along with an Agency evaluation of the results to determine the nature and impact of the release.
- Failure analysis reviews of the WQMP including recommendations for changes and modifications.
- Calibration records for specific equipment used in the sampling processes.
- Notification documentation for all public and private agencies involved with or requiring monitoring related to final sample results.

The City shall maintain all records including records from service contractors associated with this WQMP as part of the file records for an SSO as required by the WDR and MRP. These records shall be maintained for a minimum period of five-years from the end date of the SSO unless required by regulatory enforcement action, request of the State or Regional Board or as support for claims litigation resulting from the SSO. All records associated with the SSO shall be destroyed upon reaching the end of the file retention period or as otherwise required by the Regional or State Board.

Samples of all City forms and records used in this WQMP are included as attachments.

13. TRAINING

Training will be provided in accordance with Table 13.1.

Table 13.1 Brentwood surface water sampling training program	
Who Is Trained To Collect Surface Water Samples?	Collection System Staff Public Works Standby Staff
Trainer Qualifications	The trainer shall, by virtue of training, experience, education or a combination thereof demonstrate expertise in surface water sampling science, techniques and documentation.
Training Curriculum	at a minimum, training shall include: <ul style="list-style-type: none"> • The City of Brentwood Water Quality Monitoring Plan • Sampling technique, including hands on practice • Sampling equipment calibration, use and decontamination procedures, including hands on practice • Sampling safety • Completion of the Sampling Equipment Calibration/Maintenance Log, Surface Water Sampling Report and Chain of Custody
Training Documentation	Attendees shall be required to sign-in to all training on the appropriate forms used by the City.
Refresher Training Frequency	Annual
Who is Responsible for Ensuring Training Occurs?	Wastewater Operations Manager
Required Training Records	Employee training sign in log
Who is Responsible for Maintaining Records?	Wastewater Operations Manager

14. INTERNAL REVIEW AND UPDATE OF THE WQMP

The WQMP is a requirement of the WDR and MRP regulations and therefore the WQMP must be adopted by the City governing board when completed and thereafter at the same time as the new adoption of the SSMP every five years or when major changes to the SSMP are required. Internal reviews of the WQMP should be conducted at a minimum with City SSMP audits or with a failure analysis following a SSO event requiring the use of this WQMP. This latter evaluation should be used to determine if any procedures or program changes would improve the WQMP.

The internal review of the WQMP must include a thorough review of the then existing WQMP against actual performance by the agency staff and testing laboratory during and after the event. All documents associated with the water quality sampling should be reviewed and included in the SSO file and compared to the requirements in this Plan. Particular attention should be given to all dates and times associated with the monitoring, proper tests in support of the Regional Board Basin Plan, proper completion of the Chain of Custody, equipment calibration documentation of all equipment used for sampling and available photographs or video of the sampling processes, review and sign-offs by all responsible parties, review of the sampling locations map, final lab results and the certification report that the Technical Report was submitted within 45 calendar days of the end of the SSO to the CIWQS system.

In addition, the City should also conduct regular reviews of the WQMP at least annually or along with the bi-annual SSMP Audit required by the WDR. The review should be undertaken to determine that all information in the Program is current, that all classification responsibilities have not changed, that all forms are still appropriate and that all contract relationships with testing laboratories, if not associated with the agency, are still current and available 24 hours per day and 7 days per week. The review should also include a review of the Regional Board Basin Plan to assure continuing conformance with the Basin Plan.

This internal review should be conducted by senior management of the collection systems personnel, laboratory management and any outside contract laboratory services subsequent to any event or once per year if the WQMP has not had to be invoked during the preceding year.

Finally, a schedule and assignment of responsibility for completion of the recommended changes should be prepared along with additions to the SSMP Change Log for these changes and modifications of the WQMP.

CHANGE LOG


The new MRP, Section E.3 requires that all changes to the Sanitary Sewer Management Plan be recorded and documented using an SSMP Change Log indicating what section is being change, a description of the changes, and the person or persons authorizing the changes. Because the WQMP is required by the WDR and MRP, it is also necessary that changes to the WQMP be included in the documentation of changes to the SSMP. Any changes resulting from Section 14 above should be added to the Change Log of the SSMP upon implementation and adoption of the changes as required by the WDR.

ATTACHMENT A
Water Quality Monitoring Plan Change Log

ATTACHMENT B
Surface Water Sampling SOP

City of Brentwood
Water Quality Monitoring Program Plan

Surface Water Sampling Standard Operating Procedure

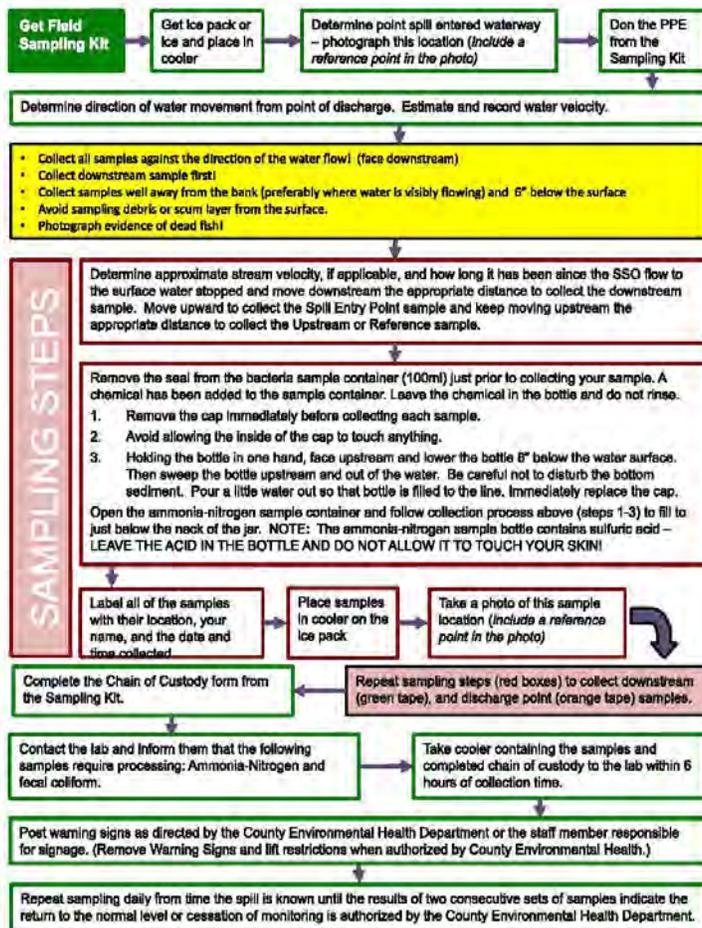

ATTACHMENT C
Sample Collection Chain of Custody Record

City of Brentwood Water Quality Monitoring Program Plan
Surface Water Sample Collection Chain of Custody Record

Customer Name		<input type="checkbox"/> Hazardous Waste	PO#	
Customer Address		<input type="checkbox"/> Unknown Material	WO#	
Customer Telephone	Mail Code	CONTRACT LAB INFORMATION		Turnaround Requirement
Program Name		Ship to:	<input type="checkbox"/> Normal (21 days)	
Lab Program Coordinator	Phone #	Ship Date:	<input type="checkbox"/> Rush:	
Sampled By		Courier:	<input type="checkbox"/> Other:	

LIMS# (Issued by Lab)	SAMPLE COLLECTION INFORMATION							Analysis Requested				QA/QC Requirements		Remarks/Notes		
	Date	Time	Type		Sample Location	Field pH	Field Temp	# Containers	Matrix*	Ammonia	Enterococcus				<input checked="" type="checkbox"/> Lab Standard	<input type="checkbox"/> Special (see attached)
			Composite	Grab											<input type="checkbox"/>	<input type="checkbox"/>
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Upstream			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Entry Point			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input checked="" type="checkbox"/>	Downstream			2	A	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
			<input type="checkbox"/>	<input type="checkbox"/>				2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

*Matrix: P = Potable Water, W = Wastewater, A = Ambient Water, G = Groundwater, S = Soil, B = Biosolids, I = Industrial, O = Other (specify in remarks)

Relinquished	Date	Time	Relinquished to	Date	Time	Transport/Shipping Information		
						<input type="checkbox"/> USPS	<input type="checkbox"/> UPS	<input type="checkbox"/> FedEx
						Tracing #:		
						<input type="checkbox"/> Other:		

Sample Receiving Documentation

Container intact? <input type="checkbox"/> Yes <input type="checkbox"/> No	Correct container? <input type="checkbox"/> Yes <input type="checkbox"/> No	Field preserved? <input type="checkbox"/> Yes <input type="checkbox"/> No	Custody tape intact? <input type="checkbox"/> Yes <input type="checkbox"/> No
Cooled? <input type="checkbox"/> Yes <input type="checkbox"/> No	Temp. Blank? <input type="checkbox"/> Yes <input type="checkbox"/> No (°C)	Comments:	
Sample distribution: <input type="checkbox"/> Lab bench <input type="checkbox"/> Ice chest <input type="checkbox"/> Walk-in cooler shelf #	Disposal Date:	Disposed by: (inits.)	
C-O-C Distribution Date: By:	<input type="checkbox"/> Lab Admin File <input type="checkbox"/> Prog/proj Mgr <input type="checkbox"/> Lab Prog. Coord.	<input type="checkbox"/> Delivery courier <input type="checkbox"/> Pick-up courier	

ATTACHMENT D
Surface Water Sampling Worksheet

Surface Water Sampling Worksheet

Sample Date:	Sample Time: <input type="checkbox"/> AM <input type="checkbox"/> PM	Sample Location:
Sampler(s) Name(s):		
Sampler(s) Signature(s):		
What is being sampled? <input type="checkbox"/> Stream <input type="checkbox"/> Pond <input type="checkbox"/> Lake <input type="checkbox"/> Lagoon <input type="checkbox"/> Bay/Estuary <input type="checkbox"/> Ocean <input type="checkbox"/> River <input type="checkbox"/> Other	If the SSO was not actively entering the surface water during sampling: A. Stream Velocity: _____ CFS B. How Long Has the SSO NOT Been Entering the Surface Water? _____ minutes X 60sec/min = _____ seconds C. How Far Downstream Did You Travel To Collect The SOURCE Sample? (A X C = Feet): _____ feet D. Explain why you travelled a different distance, if you did, to collect the source sample.	
Weather at time of sampling: <input type="checkbox"/> Sunny <input type="checkbox"/> Overcast <input type="checkbox"/> Sprinkling <input type="checkbox"/> Raining <input type="checkbox"/> Snowing		
Was the SSO actively entering the surface water during Sampling? <input type="checkbox"/> YES <input type="checkbox"/> NO If no, complete A-D in the gray box to the right →		

Comment [CW1]: We only have one surface water body, Marsh Creek.

NOTE: Calibrate equipment prior to use and record in the Equipment Calibration/Maintenance Log

Sample Location	# of Samples*	pH	Temp. (°C)	DO (mg/l)	Photo ID# of Sample Location	Visual Observations and/or Interferences
Upstream						
Source						
Downstream						
Field Blank						

* Minimum of 2 per location

FINISH CHECKLIST	NOTES / OBSERVATIONS
<input type="checkbox"/> All Samples Labeled with: <input type="checkbox"/> Date: a six-digit number indicating the year, month, day of collection <input type="checkbox"/> Time: a four-digit number indicating military time of collection. e.g. 0954 <input type="checkbox"/> Sample Location: Upstream, Source, or Downstream <input type="checkbox"/> Samplers: each sampler is identified <input type="checkbox"/> Parameter/preservative: analysis to be conducted for sample/sample preservation <input type="checkbox"/> Chain of Custody Completed <input type="checkbox"/> Samples on Ice in Cooler <input type="checkbox"/> Pictures Taken of Each Sample Location and the Photo ID# Noted Above <input type="checkbox"/> All Sampling Equipment Collected	

ATTACHMENT E
Technical Report Outline


City of Brentwood
Water Quality Monitoring Program Plan

**Technical Report
Outline**

1. Introduction
 - Agency/system description
2. SSO Technical Report - Contents and Responses
 - a. Causes and Circumstances of the SSO
 - i. Detailed explanation of how and when SSO was discovered
 - ii. Diagram indicating SSO "Cause point", appearance point, and final destination (use attachments, maps and diagrams as needed)
 - iii. Detailed description of methodology employed and available data used to calculate the SSO volume and any volume recovered
 - iv. Detailed description of the cause(s) of the SSO
 - v. Copies of the original field crew records used to document the SSO (attachment)
 - vi. Historical maintenance records for the lines involved in the cause of the SSO (attachment)
 - b. Agency's Response to the SSO
 - i. Chronological narrative description of actions taken by agency to terminate the SSO
 - ii. Description of how the OERP was implemented to respond to and mitigate any impacts of the SSO
 - iii. Final corrective action(s) completed and/or planned, including a schedule for actions not yet completed
 - c. Water Quality Monitoring
 - i. Description of all water quality sampling activities conducted, including analytical results and evaluation of the results
 - ii. Detailed location map illustrating all water quality sampling points
3. Conclusions

ATTACHMENT F
SURFACE WATER MAPS



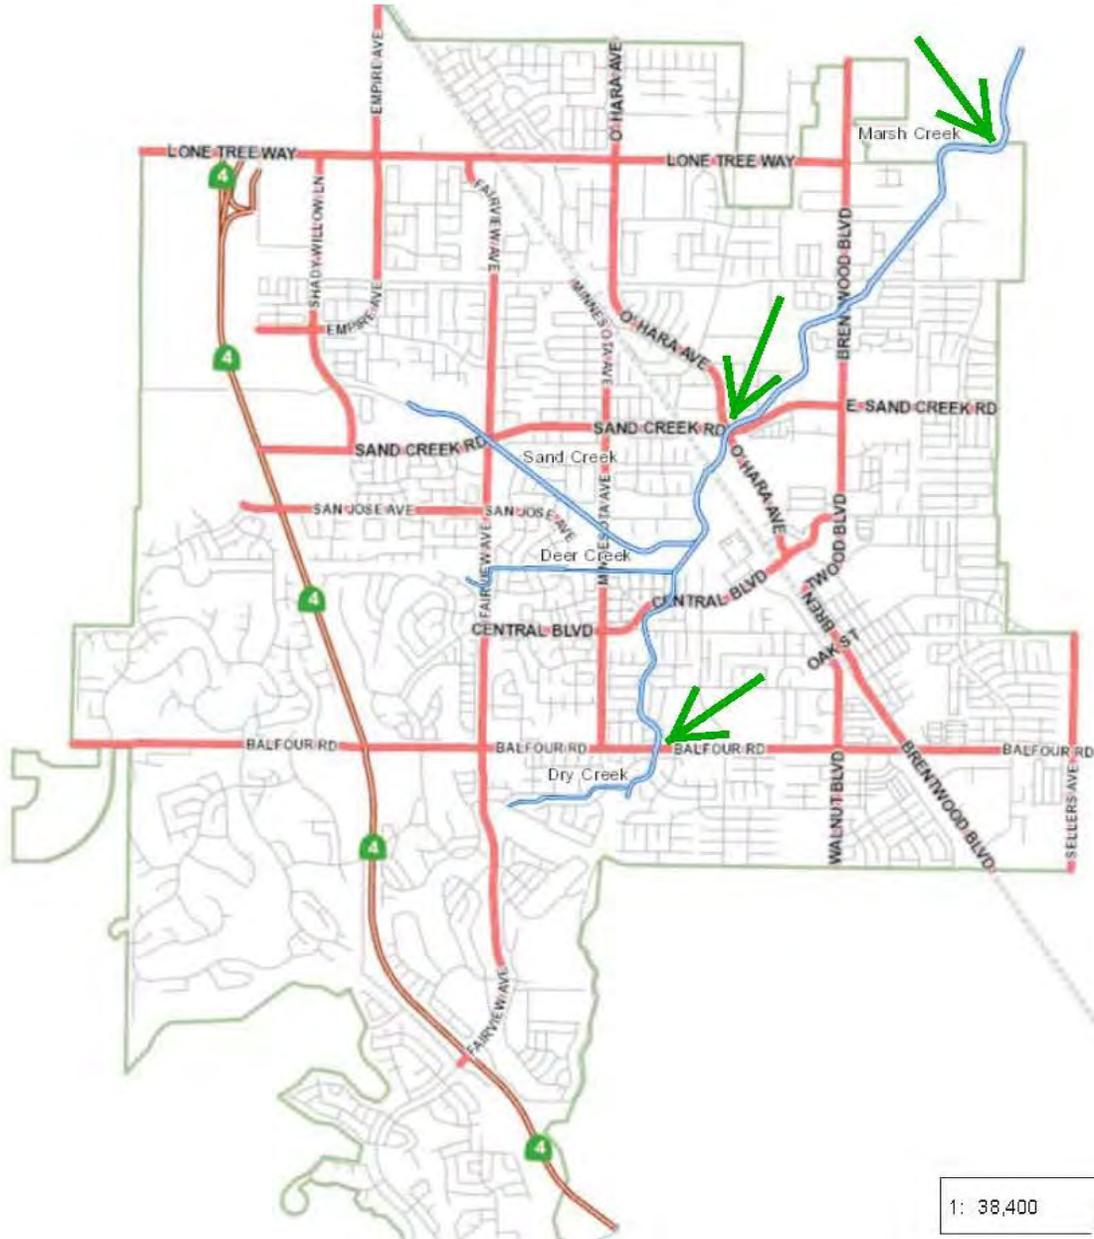

1: 38,400 

6,400.0	0	3,200.01	6,400.0Feet
<p>This map is a user generated static output from an Internet mapping site and is for reference only. Data layers that appear on this map may or may not be accurate, current, or otherwise reliable. THIS MAP IS NOT TO BE USED FOR NAVIGATION</p>			

Notes:

APPENDIX D


LIST OF EATING ESTABLISHMENTS FOR FOG & STORM WATER INSPECTION

SIC Code 5812001

Account	Firm Name	Street #	Suite #	Firm Address	Priority	Grease Trap	Grease Interceptor	Tallow Bin	Est. MH
021102	M. Balfour Inc. Db: Mc Donald's	2351		Balfour Rd	High				2
022381	The Pasta Cucina	3120		Balfour Rd	High				2
010900	Subway Sandwiches -- T C B Y	4431	E	Balfour Rd	High				2
022971	Taco Delmar	3101		Balfour Rd.	High				2
023489	Chapala Mexican Restaurant	3130	E	Balfour Rd.	High		X	X	2
019177	Panda Express #950	3140	A	Balfour Rd.	High		X	X	2
019169	Starbucks Coffee #6738	3150	A	Balfour Rd.	High				2
023301	Bagel Street Cafe	3181	A	Balfour Rd.	High				2
016043	Aladino's Pizza, Inc.	4411	A	Balfour Rd.	High				2
015653	Panama Bay Coffee Co.	4431		Balfour Rd.	High				2
020344	Papa Johns Pizza	4550	E	Balfour Rd.	High				2
015298	Mc Donald's	7455		Brentwood Blvd	High				2
010955	El Camino Resturant	6611		Brentwood Blvd.	High	X		X	2
019529	La Tea Da	6675	B	Brentwood Blvd.	High				2
023013	Loards Ice Cream Of Bentwood	7760	C	Brentwood Blvd.	High				2
022168	Starbucks Coffee #13216	7760		Brentwood Blvd.	High				2
010713	KFC/AW - Harman Brentwood Inc	7810		Brentwood Blvd.	High				2
010315	Taco Bell 3437	7814		Brentwood Blvd.	High				2
020527	Canton Garden	7840		Brentwood Blvd.	High	X			2
017827	Cafeteria Diaz	7856		Brentwood Blvd.	High				2
004438	Birrieria Diaz	7876		Brentwood Blvd.	High				2
020467	Tailgaters Sports Bar & Grill	8065	6	Brentwood Blvd.	High	X		X	2
010810	Chef Chen Restaurant	8065	9	Brentwood Blvd.	High	X		X	2
018241	Brentwood's Hickory Pit	8065		Brentwood Blvd.	High			X	2
019407	Silver Skillet Restaurant	8300	A	Brentwood Blvd.	High	X			2
019963	P P S I Pizza Inc.	8300		Brentwood Blvd.	High				2
021446	Sticky Chicken & Ribs	8335	C	Brentwood Blvd.	High				2
015530	Jalisco's Resturant	8335		Brentwood Blvd.	High				2
022502	Brentwood Cafe	8500		Brentwood Blvd.	High	X		X	2
010823	El Gallito Drive In	8540		Brentwood Blvd.	High	X		X	2
019330	Starbucks Coffee #5944	8610	1	Brentwood Blvd.	High				2

019389	Quizno's Sub	8610	A	Brentwood Blvd.	High				2
023463	Beyerholm Corporation	8610	F	Brentwood Blvd.	High				2
019791	China Villa Restaurant	8610	G	Brentwood Blvd.	High	X		X	2
021653	Pizza Guys	8610	H	Brentwood Blvd.	High				2
018427	Adams Cheese Steak Shop	8610		Brentwood Blvd.	High		X		2
020486	Jamba Juice #706	8630		Brentwood Blvd.	High				2
003241	Pee Wee Muldoons	8900		Brentwood Blvd.	High	X		X	2
021560	Shutters Brasserie	2013	A1	Elkins Way	High				2
022538	Jazzed Espresso Cafe	2013		Elkins Way	High				2
023643	La Huasteca Restaurant & Market	2415	201 B	Empire Ave.	High		X	X	2
021211	Brentwood Dining Inc.	613	100	First St.	High				2
016499	Gooseberry Fool	622		First St.	High				2
010563	La Fuente Mexican Resturant	642	3	First St.	High	X		X	2
010840	Grazie	642		First St.	High				2
022519	A Fine Time For Tea	655		First St.	High				2
021189	Gabby's Grind	729	C	First St.	High				2
022325	Lone Tree Thai Cuisine	5401	150	Lone Tree Way	High				2
020583	Bluefin Enterprises, Inc.	5401		Lone Tree Way	High				2
022466	Tavo's Pizzeria & Restaurant	5411	L-100	Lone Tree Way	High				2
020435	Peet's Operating Company Inc.	5411	L-130	Lone Tree Way	High				2
019823	In - N - Out Burger	5581	189	Lone Tree Way	High				2
020655	Baja Fresh Mexican Grill	5601	100	Lone Tree Way	High		X	X	2
023170	L & L Hawaiian Barbeque	5611	120	Lone Tree Way	High				2
020399	Pick Up Stix #7437	5611		Lone Tree Way	High				2
020279	Eastbay Equities Inc.	6021		Lone Tree Way	High				2
022619	Chuck E. Cheese's	6061	A	Lone Tree Way	High				2
022659	Pizza Guys #162	6271	F	Lone Tree Way	High				2
022526	Golden Dragon Buffet	6281		Lone Tree Way	High		X	X	2
023417	Harman Slingsby Inc	6371		Lone Tree Way	High				2
023233	Orbium Inc. D B A Melo's Pizza &	6580		Lone Tree Way	High				2
022798	Charley's Grilled Sub Db a Ooea	6660	1	Lone Tree Way	High				2
019653	El Taco Factory	6660	5	Lone Tree Way	High		X	X	2
020706	Dexter Dogs	6670	5	Lone Tree Way	High				2
023236	Red Rhino Ultra Sports Bar &	6670	182	Lone Tree Way	High				2
019391	Straw Hat Pizza	6680		Lone Tree Way	High				2
015528	Lone Tree Drive Inn	8383		Lone Tree Way	High				2

022333	Brentwood Star Llc	629'		Lone Tree Way	High				2
010360	Caps Oak Street Bar & Grill	144		Oak St.	High	X		X	2
019923	Sweeny's Grill	301		Oak St.	High				2
017966	Caffe Bacio	313		Oak St.	High				2
021088	La Costa Taqueria	335		Oak St.	High				2
022399	Dragon City Restaurant	71		Sand Creek Rd.	High				2
022448	Sunny's Pizza & Deli	50	30	Sand Creek Rd.	High				2
020079	Mangetsu Japanese Cuisine	50	36	Sand Creek Rd.	High	X		X	2
017275	Mia's Mexican Restaurant	71	A-H2	Sand Creek Rd.	High	X		X	2
000026	Ralph's Catering	71	C	Sand Creek Rd.	High				2
018669	Hawaiian Bar- B- Q	2300	G1	Sand Creek Rd.	High	X		X	2
019778	Lucy's Asia Bistro Inc.	2500	A	Sand Creek Rd.	High		X	X	2
020801	Strings Italian Cafe	2500	B	Sand Creek Rd.	High		X		2
021870	Quiznos	2540	A-5	Sand Creek Rd.	High				2
017230	Round Table Pizza	2540		Sand Creek Rd.	High				2
022148	Starbucks Coffee #6719	2540		Sand Creek Rd.	High				2
022455	Perko's Cafe & Grill	1135		Second St.	High				2
017484	Papa Murphy's Pizza	1145		Second St.	High				2
019905	Willy's Bagel And Blends Llc	1155	D	Second St.	High				2
015115	Togo's Eatery	1155		Second St.	High				2
020438	Mountain Mikes Pizza	1185	M	Second St.	High				2
018797	Jack In The Box Restaurant #4349	60		Technology Way	High				2
020135	Little Caesars Pizza	3940		Walnut Blvd.	High				2
023153	Willys Bagels And Blends L L C	390		West Country Club Dr.	High				2

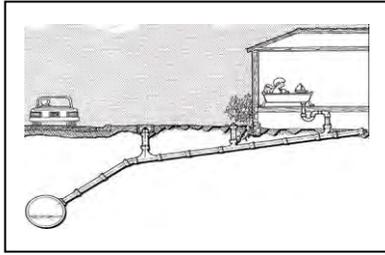

Ways to Prevent Backups in Your Sewer Lateral and in the City Main

Property owners can do many things to prevent their laterals from backing up. If everyone would be very careful about how they dispose of certain products, our system would be a much more efficient. There would be fewer backups/overflows; saving the City and homeowners the cost of correction and/or replacement.

- **Grease:** Cooking oil should be poured into a heat-resistant container and disposed in the garbage after it cools off, **not** down the drain. When the grease goes down the drain, cools off, and solidifies either in the drain, the property owner's line, or in the sewer main; the line can become constricted, and potentially clog causing a sewer overflow.
- **Paper Products:** Paper towels, diapers, and feminine products cause a great deal of problems in the property owner's lateral as well as in the City main. These products do not deteriorate quickly, unlike bathroom tissue. They become lodged in a portion of the lateral/main, causing a sewer overflow. These products should also be disposed of properly in the garbage.
- **Roots:** Shrubs and trees, seeking moisture, will make their way into sewer line cracks and connections. These roots can cause extensive damage. They may start out small, but as the tree or shrub continues to grow, so do the roots. In time, this may cause your sewer line to break, which in turn allows debris to hang up in the line on the roots, thus causing a backup. When planting greenery; place 5-7 feet from your sewer line to help prevent root intrusion. If you have continuing problems with roots in your lateral, you may have to remove the tree or shrub associated with the roots.
- **Sewer Odor:** Another concern property owners have is they can smell sewer odors inside their home or building. Under each drain in your plumbing system, there is a "P-Trap". If there is water in this fitting, odors or gasses from the sewer cannot enter through the drain from either the property owner's lateral or the City main. Periodically check to make sure unused floor drains, sinks etc. have water in the "P-trap". Another way to prevent sewer odor is to ensure the vents, which are located on your roof, are free from bird nests, leaves, etc. When these vents are clear, the sewer odors will escape through these vents.
- **Illegal Plumbing Connections:** Do not connect French drains, sump pumps and other flood control systems to your sanitary sewer. It is *illegal*, and debris and silt will clog your line. You may need to consult a plumber to correct any illegal connections.
- **Needles:** The presence of hypodermic needles in the wastewater collection system presents special and possible deadly problems for wastewater collection and wastewater treatment employees. **PLEASE DO NOT FLUSH NEEDLES.** The proper method of disposal is to re-cap the needle and put it into a "sharps container". When full, tape the container securely, and call your local pharmacy for advice on proper disposal methods. For disposal sites in the area go to <http://www.safeneedledisposal.org/centers.html> to find the nearest location. **PLEASE DO NOT FLUSH THEM OR THROW THEM INTO THE GARBAGE!**



What Causes a Sewer Back-up?

- Kitchen grease, food scraps, egg shells, potato peels, excessive toilet paper, disposable diapers, baby wipes and feminine products can accumulate and cause a blockage
- Tree roots seeking moisture can grow through joints and cracks in the lines, causing a blockage
- Vandals have stopped up lines by putting bricks, concrete, wood, oil filters, construction debris, and garbage into the sewer lines
- Illegal hookups allow excess water into the lines. Outside stairwell drains, sump pumps, roof leaders, and drain gutters should never be connected to the sewer system. A sewer system is designed to carry a predetermined amount of sewage. Rain water not only overloads the system, but also raises the cost of the treatment process

To protect your property follow these simple **Do's** and **Don'ts**;

- **DON'T** Put diapers or sanitary napkins in the toilet
- **DON'T** Dispose of grease down the drain
- **DON'T** Plant trees near sewer lines
- **DON'T** Connect any drains or sump pumps to the sewer system
- **Do** locate and keep accessible the sewer cleanout in your front yard. If you do not have a cleanout, have one installed by a plumber. The cleanout is the property owner's responsibility
- **Do** check your homeowner's insurance policy. If you are not covered for back-ups, call your agent for information on costs and coverage options

Do You Know Where Your Cleanout Is?

- The cleanout is a pipe located near the property line which rises from your sewer line to about 4" below ground level and is capped in a sewer cleanout box
- Quite frequently, the cleanout becomes buried or hidden over the years and is forgotten. In some cases, older homes may never have had a cleanout installed
- As a property owner, you are responsible for your cleanout. If the cleanout is buried, a plumber should be able to locate and raise it for you


What About The Cost Involved In The Clean Up?

The Wastewater Division is very sensitive to your feelings for the inconvenience caused by a sewer back-up in your home. The City is responsible for maintaining the wastewater lines from the main line to your property line. We clean a quarter of the City's sewer system each year and take pride in eliminating sewer back up all together. The City also checks all areas of concern each day to make sure we are doing our part to eliminate overflows. Public Works personnel will respond immediately to investigate and resolve collection system or storm drain issues...with your help; we can reduce sewer back-ups.

It is the homeowners' responsibility to maintain the house cleanouts and sewer lateral from the property line to the house.

OTHER CAUSES OF SEWER OVERFLOWS

The continual flow of nutrient-filled water found in sewer lines can attract tree roots through pipe joints and manholes. The roots can then grow, forming blockages in the pipes. Always avoid planting trees and shrubs near residential and City sewer lines.

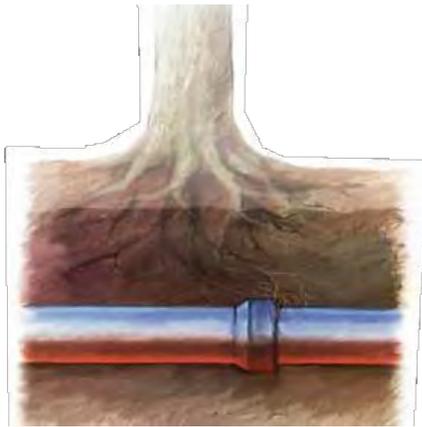

Rock, debris, vandalism and construction are also factors which can contribute to sewer overflows.



Report Sewer Overflows!!
 If you see or smell something you think might be a sewer spill, report it immediately by calling: **925-516-6060**
 After Hours Water or Sewer Emergency contact Police Dispatch (925) 778-2441



About The City of Brentwood

The City of Brentwood's sanitary sewer system collects and treats an average of 3.3 million gallons of wastewater per day at its city owned and operated treatment plant.

The city serves an estimated 48 thousand residents and more than 216 current businesses within the city limits.

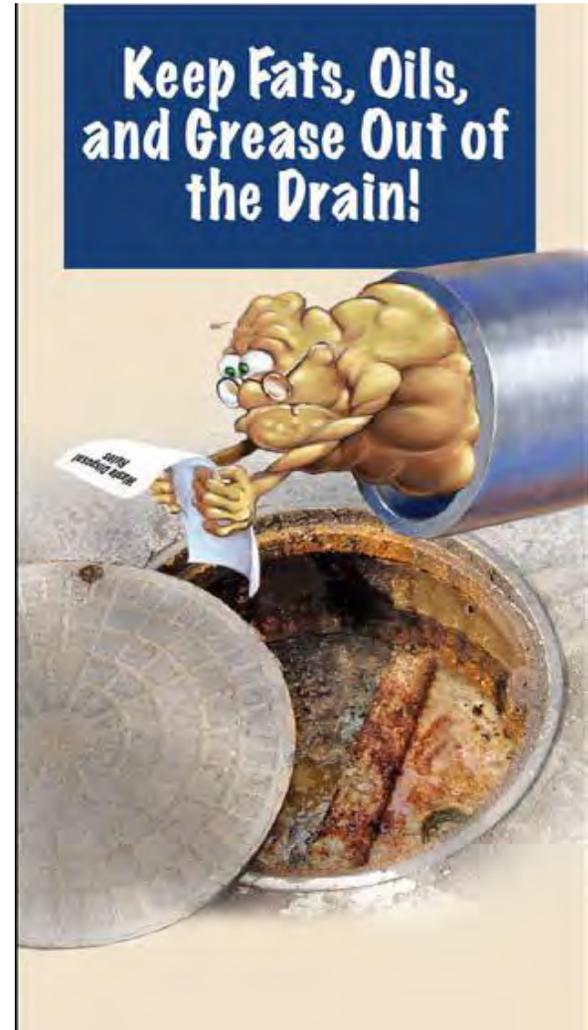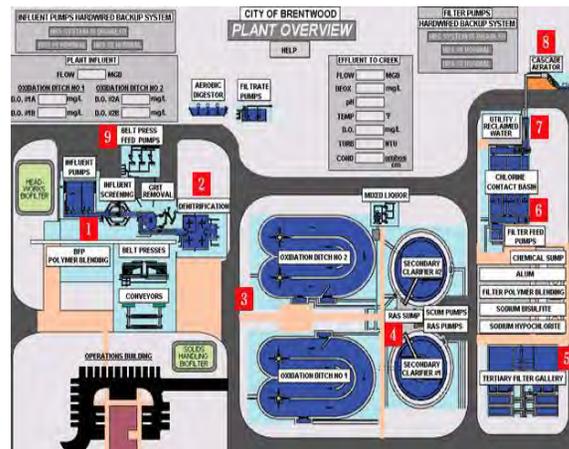

COOKING GREASE

Cooking grease is one of the primary causes of sewer overflows throughout the City of Brentwood's sanitary sewer system. Sewer overflows can not only pollute streams, rivers, and the Bay, they can endanger public health.



All cooking oils disposed of improperly can cause problems in the sewer system. These include:

- **Frying oil**
- **Salad oil**
- **Soups**
- **Meat drippings**
- **Bacon fat**
- **Greasy leftovers**

IMPORTANT FACTS

Cooking grease clogs pipelines in much the same way fatty foods clog human arteries. The grease clings to the inside of a pipe, builds up and eventually causes a complete blockage.

Costly home plumbing bills are often the result of grease-clogged pipes. Residential laterals can clog easily since they are only 4" inches in diameter.



Many people are unaware that pouring hot water and detergent down the drain only breaks up grease temporarily. Grease should never be poured down the drain. If a small amount of grease gets in your drain, flush immediately.



Step 1

Small amounts of cooking oil and grease should be poured into a disposable container (can, milk or juice carton) and put in the trash. Larger amounts of used cooking oil should be brought to the Household Hazardous Waste Collection Facility for disposal. Call **800-646-1431** for any information.

Step 2

Dishes and pots coated with grease should be wiped clean with a disposable paper towel prior to being washed in the sink or dishwasher.

Step 3

Do not put egg shells, meat trimmings, or scraps in the garbage disposal; always put them in the trash.

APPENDIX E

**City of Brentwood
2015 SSMP Internal Audit**

Table of Contents

Introduction	2
Background and System Overview	2
Summary of SSO Events and Data	2
Audit Approach	7
1. Audit of Goals – State Order D.13.i	7
2. Audit of Organization – State Order D.13.ii	9
3. Audit of Legal Authority – State Order D.13.iii	9
4. Audit of Operation and Maintenance Program – State Order D.13.iv	10
5. Audit of Design and Performance Provisions – State Order D.13.v	11
6. Audit of Overflow Emergency Response Plan – State Order D.13.vi	11
7. Audit of FOG (Fats, Oils, and Grease) Control Plan– State Order D.13.vii	11
8. Audit of System Evaluation and Capacity Assurance Plan – State Order D.13.viii	12
9. Audit of the Monitoring, Measurement, and Program Modifications – State Order D.13.ix	13
10. Audit of SSMP Program Audits – State Order D.13.x	13
11. Audit of Communication Program – State Order D.13.xi	13

Introduction

In May 2, 2006, the California State Water Resources Control Board adopted Order No. 2006-0003 (State Order) to create an equitable statewide mechanism to manage all publicly owned wastewater collection agencies with more than one mile of pipeline, to reduce the number and severity of Sanitary Sewer Overflows (SSOs), and to set up a central depository for online reporting of SSOs when they do occur.

A principal element of the State Order is the requirement that the collection agencies adopt and maintain a management plan for the system, referred to as a Sewer System Management Plan (SSMP).

The City of Brentwood's SSMP was certified and implemented on July 31, 2009, in accordance with the State Order.

One of the provisions of the State Order is that agencies perform an internal audit of the SSMP every two years. These audits are to focus on evaluating the effectiveness of the SSMP and the Enrollee's compliance with the SSMP requirements identified in section D.13., including identification of any deficiencies in the SSMP and what steps are/will be taken to correct them. The due date for this audit is March 15, 2013.

The SSMP must be updated every five years, and the update must include any significant program changes. If significant changes are made, the SSMP must be re-certified by the City Council. A revised version of the SSMP, based on the 2013 Internal Audit, was presented to the City Council and approved on May 14, 2014.

Background and System Overview

The City of Brentwood (City) was incorporated in 1948 as a General Law City. The City is predominately a bedroom community of approximately 54,000 residents that collects and treats wastewater generated primarily by domestic (household) users. The City currently has no categorical significant industrial users. The bulk of the commercial businesses are retail food establishments, retail grocery stores, home improvement centers and retail department stores.

The City has a service area of nearly 12 square miles with roughly 209 miles of City owned and maintained sanitary sewer piping systems and two lift stations. The City's sewer mains range in diameter from six inches to 42 inches with approximately 80% of these lines being eight inches in diameter or smaller. Nearly all of the sewer laterals are four inches in diameter. Similar to other organizations, the City owns a portion of the sewer laterals. The City owns the "lower" lateral, which is defined as the portion of the lateral extending from the edge of the property line to the sewer main.

Summary of SSO Events and Data

The City of Brentwood had two SSO's in 2011 (total volume = 15 gallons), three SSO's in 2012 (total volume = 857 gallons), one SSO in 2013 (total volume = 29 gallons), and no SSO's in 2014. This equates to an average SSO events per 100 miles of sewer main average ratio of 1.06 in 2011 and 1.60 in 2012. These ratios are considered to be indicative of a very high performing collection system. A 6-year historical chart (Figure 1) shows that the City consistently has a very high performing collection system, with a 6-year average ratio of 0.96 SSO events per year per 100 miles of sewer main.

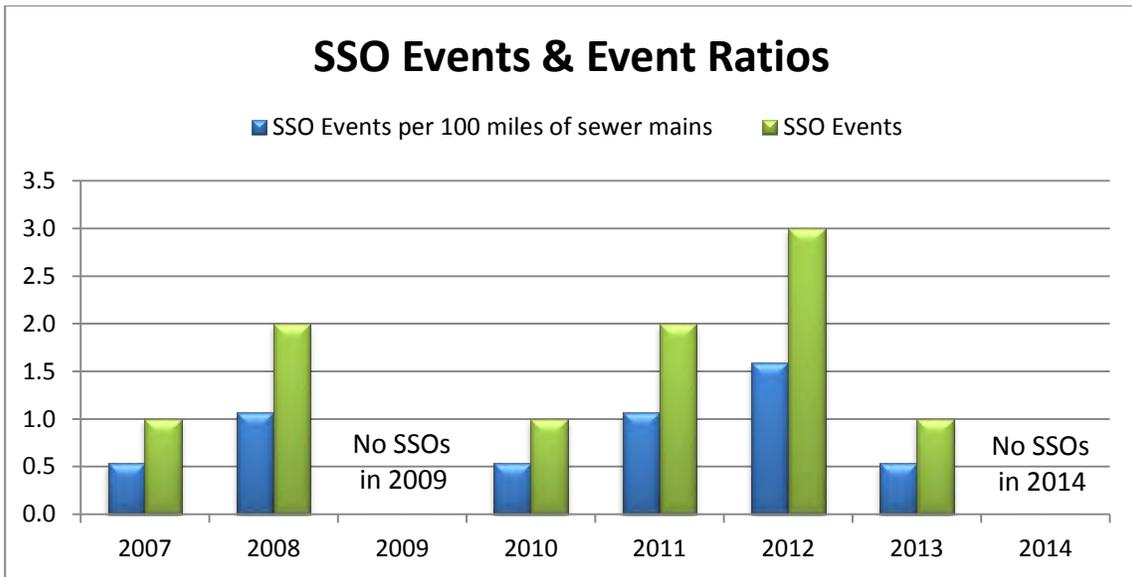


Figure 1

Figure 2 shows an 8-year history of SSO volumes. Of the 1,355,780,000 gallons of sewage that flowed through the City’s collection system in 2014 none was lost as SSOs. Since the City began measuring SSOs the highest annual total of SSO volume was 1225 gallons. The 8-year average total SSO volume is 410 gallons per year, with a per-event average volume of 328 gallons. There was one SSO in 2013 and none in 2014, resulting in an average volume of sewage overflow per event of 15 gallons during the last two years, which is well below the previous 6-year average.

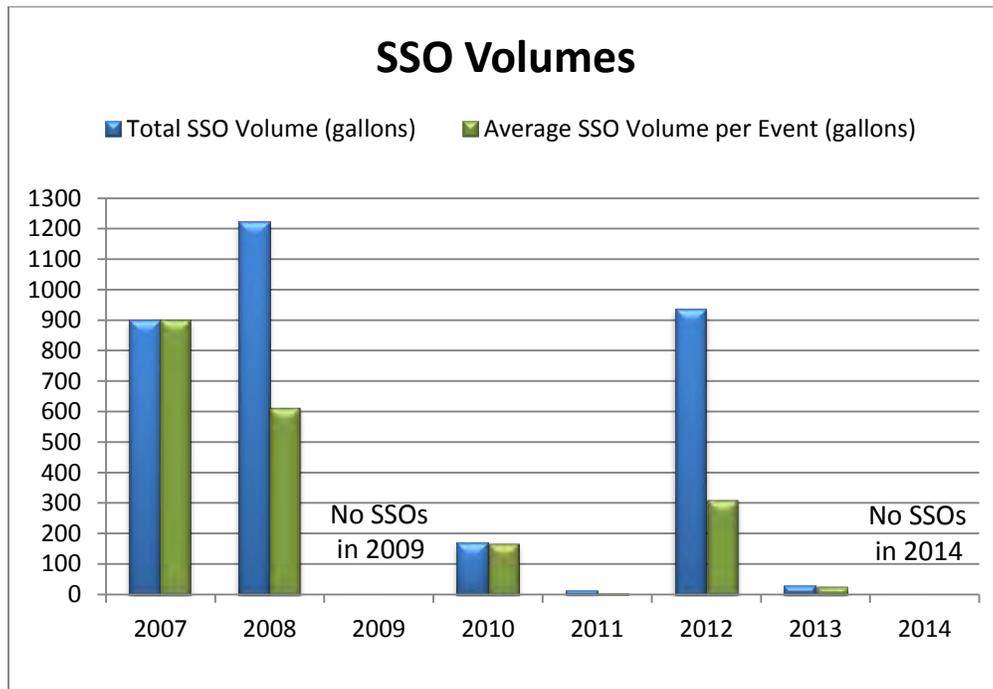


Figure 2

Table 1 below lists the data used in Figures 1 and 2 above.

Management, Operation and Maintenance System-Performance Metrics											
Source	Main Line SSOs per Year								Total	Average per Year	Average per 100 miles of sewer
	2007	2008	2009	2010	2011	2012	2013	2014			
Main Line SSOs	1	2	0	1	2	3	1	0	10	1	0.006
Volume (gal)	900	1225	0	170	15	937	29	0	3276	410	1.959

Table 1

Of the SSOs recorded since the State Order became effective, the City has kept track of the volume and percentage of each overflow that that is recovered, and not discharged to a water of the State. Since 2007 the City has averaged an SSO recovery rate of 92% (Figure 3).

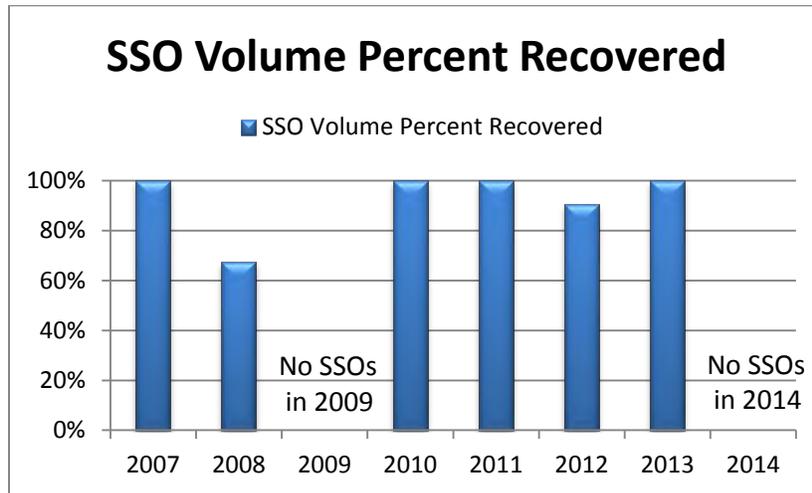


Figure 3

Table 2 below provides a breakdown of the causes of each of the SSOs recorded since 2007.

	Mainline Stoppages by Cause									
	2007	2008	2009	2010	2011	2012	2013	2014	Total	%
Debris - General						1			1	10
Debris - Rags									0	0
Flow exceeded capacity									0	0
Grease (FOG)		1		1	2	2	1		7	70
Operator Error									0	0
Pipe structural problem/failure									0	0
Pump station failure									0	0
Rainfall exceeded design									0	0
Root intrusion									0	0
Vandalism									0	0
Contractor Causes	1	1							2	20
TOTAL	1	2	0	1	2	3	1	0	10	100

Table 2

Up until 2013, the City footage of sewer mainline cleaning had been relatively consistent. Beginning in 2013 the City transitioned to more of a proactive investigation of sewer mainlines rather than a “blind cleaning” method. In 2014 the City actually CCTV’d more footage of mainlines than it cleaned. Figure 4 below illustrates the City’s trend toward more CCTV’ing than cleaning, and the overall footage maintained per year.

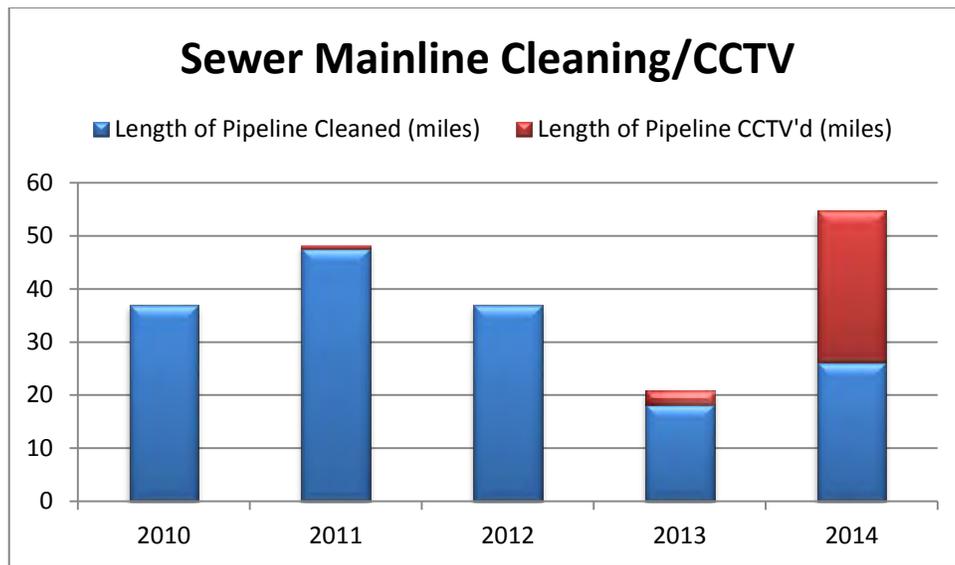


Figure 4

Figure 5 is a map of the City's entire collection system with the locations of all the SSOs since 2007. There are only two instances where SSOs occurred in the same area. The two SSOs on Tarragon Dr. occurred one year apart and were both attributed to swimming pool contractors washing debris into the sewer system. The SSOs on Berry Ln. and Central Blvd. occurred three years apart. This map serves as an indicator of overall system health. Since the SSOs occur in random places, the City can reasonably conclude that there are no overly problematic areas that are in danger of having SSOs or needing repair.



Historical SSO Map 2007-2014



6,400.0 0 3,200.00 6,400.0 Feet

This map is a user generated static output from an Internet mapping site and is for reference only. Data layers that appear on this map may or may not be accurate, current, or otherwise reliable. THIS MAP IS NOT TO BE USED FOR NAVIGATION

Notes:

Audit Approach

As specified in the State Order, the SSMP is comprised of eleven sections or subsets of Section D.13 of the State Order, as follows:

D.13.i	Goals
D.13.ii	Organization
D.13.iii	Legal Authority
D.13.iv	Operation and Maintenance Program
D.13.v	Design and Performance Provisions
D.13.vi	Overflow Emergency Response Plan
D.13.vii	FOG (fats, oils, & grease) Control Plan
D.13.viii	System Evaluation and Capacity Assurance Plan
D.13.ix	Monitoring, Measurement and Program Modifications
D.13.x	SSMP Program Audits
D.13.xi	Communication Program

This internal audit is focused on the above eleven categories as required by the State Order. The evaluation of each element in each category is standardized with sufficiency. Compliance ranking has been based on State Order audit guidelines and sufficiency. A recommendation has been provided when there is enough information to support it.

The format for audit reporting is as follows:

- State Order Section/Subsection
- Sufficiency Ranking
 - Complies,
 - Substantially complies,
 - Partially complies,
 - Marginally complies,
 - Does not comply
- Findings
- Reference Information
- Recommendation when appropriate

1. Audit of Goals – State Order D.13.i

Review the SSMP to determine if it complies with the State Order by having a goal to provide a plan to manage, operate, and maintain all parts of the City of Brentwood Wastewater Collection System.

Sufficiency: **Complies.**

Findings: The City has established a list of goals in its SSMP that complies with the goals established in the State Order.

The City's Goals for the SSMP together with progress to date are as follows:

1. To minimize the number and impact of SSOs;

Complete. Adherence to the SSMP has helped limit the number of SSOs to ten SSO events in the last eight years with an average annual SSO volume of 328 gallons.

2. To maintain existing infrastructure and plan for future Capital Improvement Projects (CIPs);

Complete. Adherence to the SSMP coupled with sound planning has resulted in an up to date infrastructure with no major deficiencies. The average age of the collection system piping is approximately 15 years, significantly less than most collection systems. Future CIPs are planned to ensure that infrastructure continues to be kept in good working condition.

3. To continue to provide capacity evaluation for the collection system and plan for future growth;

Complete. The Wastewater Collection System Master Plan was prepared in 2001. The Plan was subsequently updated in 2006 to accommodate a rapidly growing community. Another update was prepared in 2010 to forecast collection system flow conditions at “build-out”, and provided recommendations for capital improvements to optimize the collection system to handle the planned growth.

4. To develop a plan to increase the number of staff to meet the obligations of the SSMP;

Ongoing. Increasing staffing levels to meet the obligations of the SSMP has proven challenging. Economic difficulties associated with the housing bubble resulted in a hiring freeze for several years. The City added one full-time Collection System Worker in FY 2014/15.

5. To prevent public health hazards;

Complete. Adherence to the SSMP has prevented public health hazards.

6. To detect and reduce inflow and infiltration into the Collection System;

Complete. The influent flow comparison below shows flow from December 2013 through November 2014. This comparison (see Figure 3) shows that there is no evidence of excessive inflow and infiltration in the winter months. In fact, the winter months exhibited the lowest flows of the year.

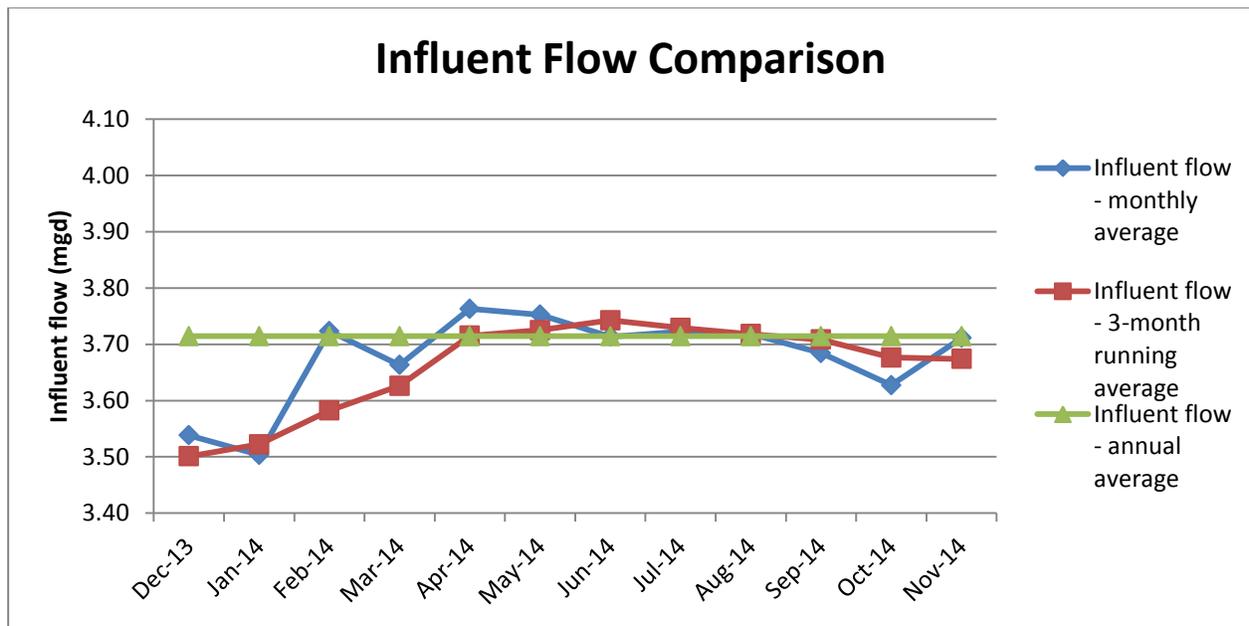


Figure 3

7. To operate the Collection System in a safe and efficient manner, thus maximizing production;

Complete. There were no lost-time injuries associated with the collection system since the last audit period.

Reference: City of Brentwood SSMP (COB SSMP).

Recommendation: None. The City is in compliance with the *Goals requirement of the State Order*.

2. Audit of Organization – State Order D.13.ii

Review the SSMP to determine if it complies with the State Order by having the names of authorized representatives published and updated in the SSMP.

Sufficiency: **Substantially Complies.**

Findings: The City has identified the names of its authorized representative, management, administration, and maintenance personnel and has shown the chain of communication for reporting SSOs. The organization chart needs to be updated to reflect personnel changes within the City

Reference: City of Brentwood Authorized Representatives List, COB SSMP, Appendix A

City of Brentwood Organization Chart, COB SSMP, Page 4.

City of Brentwood Communication Flow Chart, COB SSMP, Page 6

Recommendation: Update the organization chart to reflect current personnel and vacancies.

3. Audit of Legal Authority – State Order D.13.iii

Review the SSMP to determine if it complies with the State Order by having ordinances and agreements in place and updated to prevent illicit discharges, provide for proper design of sewers and connections,

ensure access for maintenance, inspection, and repair of laterals, limit the discharge of blockage causing debris, and enforce any violation of sewer ordinances.

Sufficiency: **Complies**

Findings: The City has an adopted Municipal Code that addresses the legal authority required to carry out actions identified in the SSMP. Specifically, section 13 of the Brentwood Municipal Code prohibits illicit discharges, sets standards for the design of sewers and connections, and provides a means to enforce violations of the provisions within the Code. At the time of this report's preparation, the City is in the process of updating section 13 (Sewers) of the Municipal Code. The update will include clarification on regulations pertaining to potential industrial users, and reinforcement of other portions of the code ensuring compliance with the SSMP and Federal Pretreatment Regulations.

Reference: COB SSMP, Appendix D

City of Brentwood Municipal Code, Section 13.

Recommendation: None

4. Audit of Operation and Maintenance Program – State Order D.13.iv

Review the SSMP and activities of staff, consultants, and contractors to determine compliance with the State Order by having (a) an up to date map of the Collection System that shows all pipe reaches, manholes, siphons, diversion structures, and pump stations and (b) a routine preventative maintenance program, (c) a rehabilitation and replacement plan, (d) an operations and maintenance training program, and (e) a parts inventory program including identification of critical replacement parts.

Sufficiency: **Complies**

Findings: The Collection System Map is kept up-to-date electronically through a GIS program (GeoVault) and managed by the Engineering division. The map is available on the City's intranet. Collections crews have access to the electronic map room via a laptop in the field, and through desktop computers in the office.

As outlined in the COB SSMP the routine preventative maintenance program consists of quarterly hot-spot cleaning, and CCTVing/cleaning of the balance of the collection system on a 4-year basis. The City utilizes Maintenance Connection, an enterprise asset management software package to track all the O&M activities of the collection system.

Rehabilitation and Replacement are accomplished through capital improvement projects. The City has an annual CIP project on the books and funded to cover any urgent major pipeline repairs. In addition to this project, periodic CIP's are done on a case-by-case basis. The latest example of this was a manhole coating and repair project completed in FY 2013/14.

The City sets aside a budget for collection system training each year. Collections staff participates in several industry-wide training events annually.

The City maintains a sufficient spare parts inventory of critical equipment.

Reference: Spare Parts Inventory List, COB SSMP, Appendix E

Recommendation: Increase level of training for collection system personnel.

5. Audit of Design and Performance Provisions – State Order D.13.v

Review the SSMP to determine if it complies with the State Order by having design and construction standards and specifications for installation of new facilities, including coverage for testing of new facilities prior to acceptance.

Sufficiency: **Complies**

Findings: The City has adopted Standard Plans and Specifications for, among other things, construction of sewers and sewer appurtenances. A copy of the applicable Standard Specifications (Section 71 and 75) are attached to the COB SSMP. These specifications also address testing necessary for acceptance.

Reference: COB SSMP, Appendix F

City of Brentwood Standard Plans and Specifications

Recommendation: None

6. Audit of Overflow Emergency Response Plan – State Order D.13.vi

Review the SSMP to determine if it complies with the State Order by having an overflow emergency response plan that includes (a) proper notification procedures, (b) a program that assures proper response to all overflows (c) procedures that ensure prompt notification of regulatory agencies and other affected entities, (d) procedures to ensure that appropriate personnel are aware of the plan and appropriately trained, (e) procedures to address traffic control and crowd control, and, (f) implementation of steps to prevent SSOs from reaching waters of the United States.

Sufficiency: **Complies**

Findings: The City has a stand-alone Overflow Emergency Response Plan (OERP) that is incorporated into the SSMP. This plan effectively addresses notification procedures, assures proper response to overflows, contains procedures to ensure the proper regulatory notifications are made, and has provisions to address traffic control associated with SSOs. Copies of the Sewer Overflow Reports used by staff are found in the SSMP in Appendix B.

Reference: City of Brentwood Overflow Emergency Response Plan

COB SSMP, Appendix B

Recommendation: None

7. Audit of FOG (Fats, Oils, and Grease) Control Plan– State Order D.13.vii

Review the SSMP to determine if it complies with the State Order by having a FOG Control plan with (a) a public education outreach element, (b) a plan for the disposal of FOG, (c) ordinances, rules and

regulations to prevent FOG, (d) requirements to install FOG traps together with standard drawings for traps, owner maintenance, record keeping, and reporting requirements, (e) FOG inspection and enforcement authority and staffing, (f) FOG mapping and cleaning schedule, and (g) source control measures.

Sufficiency: **Substantially Complies**

Findings: The City’s FOG program accomplishes the above requirements with the exception of (e). The Municipal Code establishes the enforcement authority for FOG inspections, but there is currently no staff devoted exclusively to FOG inspection/prevention/enforcement.

Reference: COB SSMP, Appendix C

Recommendation: Develop a plan for staffing FOG inspection/enforcement as economic growth dictates.

8. Audit of System Evaluation and Capacity Assurance Plan – State Order D.13.viii

Review the SSMP to determine if it complies with the State Order by having a Capital Improvement Plan (CIP) that considers (a) Evaluation of those portions of the Collection System that experience SSO’s due to hydraulic deficiency, (b) Design Criteria commensurate with the Collection System, (c) Capacity Enhancement Measures and steps to address short term and long term CIP goals and an implementation schedule, and (d) Schedule for completion of items identified in (a) – (c).

Sufficiency: **Complies**

Findings: The City has a Wastewater Collection System Master Plan that addresses the requirements identified in State Order D.13.viii. The City initially prepared the Wastewater Collection System Master Plan in 2001 following adoption of the “City of Brentwood General Plan 2021”. Due to an extremely accelerated growth rate in the years immediately following 2001, the City updated the Wastewater Collection System Master Plan in 2006. This Plan was updated again in 2010. The 2010 update includes a capacity assessment based on hydraulic modeling of the collection system with future design flows at ultimate “build-out” development of the City. This modeling identified nine CIPs that will ultimately require some sections of the sewer main piping to be replaced with larger diameter piping, or have parallel piping installed.

The City has not experienced any sanitary sewer overflows caused by hydraulic deficiencies in the existing wastewater collection system. As the City grows, the hydraulic capacity of the system will continue to be monitored and the previously identified sections requiring replacement or parallel piping will be implemented as CIPs.

The City has comprehensive design criteria and standards relating to collection system design and construction. These criteria may be found in the City of Brentwood Standard Plans and Specifications.

References: COB SSMP, Appendix F

Recommendations: None.

9. Audit of the Monitoring, Measurement, and Program Modifications – State Order D.13.ix

Review the SSMP to determine if it complies with the State Order by (a) maintaining relevant information that can be used to establish and prioritize appropriate SSMP activities, (b) measuring the effectiveness of each element of the SSMP, (c) assessing the success of the preventative maintenance program, (d) updating program elements, based on monitoring or performance evaluations, and (e) identifying and illustrating SSO trends, including frequency, location and volume.

Sufficiency: **Complies**

Findings: The City began collecting data on SSOs upon the implementation of the State Order. This data is summarized in the figures and tables in the Summary of SSO Events and Data since the Last SSMP Audit section on pages 3 and 4 of this document. This data continues to support the notion that the City's SSMP is working effectively to properly manage the collection system. SSO trends based on frequency, location, and volume are readily available, as are records of pipeline cleaning.

References: COB SSMP

2015 SSMP Internal Audit, Summary of SSO Events and Data

Recommendations: None.

10. Audit of SSMP Program Audits – State Order D.13.x

Perform an internal audit of the SSMP to determine if it complies with the State Order by evaluating the effectiveness of the SSMP and the City's compliance with the SSMP requirements including identification of any deficiencies in the SSMP and steps to correct them.

Sufficiency: **Complies**

Findings: The City has embarked on this audit of its SSMP within the two-year requirement specified in the State Order. The previous audit was performed in March of 2013 and submitted on March 15th, 2013. This audit is due March 15th 2015, with the next audit due March 15th, 2017.

References: COB SSMP, Appendix H

Recommendations: None

11. Audit of Communication Program – State Order D.13.xi

Review the activities of staff to determine if they have complied with the State Order by (a) communicating the performance of the SSMP with the public, and (b) providing the public the opportunity to provide input.

Sufficiency: **Complies**

Findings: Public input was solicited during the development of the SSMP in 2006 and 2007. Since the adoption of the SSMP, there has been little public input to the program.

With the completion of each audit, City staff makes the audit available to the general public by posting it, along with a copy of the SSMP, on the City website.

References: City of Brentwood website, www.brentwoodca.gov

Recommendations: None.